

Applications

Protection of motors against short-circuits and overloads



3

Tripping threshold on short-circuit	13 In			
Standard motor power ratings in AC-3, 415 V	Up to 15 kW	Up to 30 kW	37 kW	
Operational current at 415 V	0.1...32 A	9...65 A	56...80 A	
Breaking capacity at 415 V (Icu) to IEC 60947-2	10...100 kA	35...100 kA	50...100 kA	15 kA
Door interlock mechanism	Without	With	With	Without
Circuit-breaker type	GV2 ME	GV2 P	GV3 P	GV3 ME80
Pages	3/47 and 3/48	3/49	3/49	3/49

**Protection of motors with high current peak
on starting**



20 In

7.5...110 kW

Up to 11 kW

12...220 A

0.25...23 A

35 and 36 kA

70 kA

15...100 kA

With

With

GV7 RE

GV7 RS

GV2 RT

3/49

3/50 and 3/51

Applications

Protection of motors

Magnetic circuit-breakers provide short-circuit protection. They must be combined with thermal overload relays to provide motor overload protection.



3

Tripping threshold on short-circuit

13 In

Standard motor power ratings in AC-3, 415 V

Up to 15 kW

Operational current at 415 V

0.4...32 A

Breaking capacity at 415 V (Icu) to IEC 60947-2

10...100 kA

35...100 kA

Door interlock mechanism

With

Circuit-breaker type

GV2 LE

GV2 L

Pages

3/52


3/53




		6...14 In	8...13 In	6.3...12.5 In
Up to 30 kW	37 kW	0.37...250 kW		
25...65 A	80 A	1.5...500 A		
50...100 kA	35 kA	25.7 and 150 kA	35.7...150 kA	45.7...150 kA
With	With	With		
GV3 L	GK3 EF80	NS 80	NS 100 to NS 250	NS 400 and NS 630
3/53	3/53	Please consult the Schneider Electric catalogue - Low Voltage Distribution		

TeSys protection components

Thermal-magnetic motor circuit-breakers
GV2, GV3 and GV7




GV2 ME
with screw clamp
terminals




GV2 ME
with spring terminals
connections



GV3 P



GV2 P



GV7 R

Presentation

GV2 ME, GV2 P, GV3 ME, GV3 P and GV7 R motor circuit-breakers are 3-pole thermal-magnetic circuit-breakers **specifically designed for the control and protection of motors**, conforming to standards IEC 60947-2 and IEC 60947-4-1.

Connection

GV2

GV2 ME and GV2 P circuit-breakers are designed for connection by screw clamp terminals.

Circuit-breaker GV2 ME can be supplied with lugs or spring terminal connections. Spring terminal connections ensure secure, permanent and durable clamping that is resistant to harsh environments, vibration and impact and are even more effective when conductors without cable ends are used. Each connection can take two independent conductors.

GV3

GV3 circuit-breakers feature connection by BTR screws (hexagon socket head), tightened using a n° 4 Allen key.

This type of connection uses the **EverLink®** system with creep compensation (1) (Schneider Electric patent).

This technique makes it possible to achieve accurate and durable tightening torque, in order to avoid cable creep.

GV3 circuit-breakers are also available with connection by lugs. This type of connection meets the requirements of certain Asian markets and is suitable for applications subject to strong vibration, such as railway transport.

GV7

GV7 circuit-breakers: with connection by screw clamp terminals (for bars and lugs) and by clip-on connectors.

Operation

Control is manual and local when the motor circuit-breaker is used on its own. Control is automatic and remote when it is associated with a contactor.

GV2 ME and GV3 ME80

Pushbutton control.

Energisation is controlled manually by operating the Start button "I" 1.

De-energisation is controlled manually by operating the Stop button "O" 2, or automatically by the thermal-magnetic protection elements or by a voltage trip attachment.

GV2 P, GV3 P and GV7 R

- Control by rotary knob: for GV2 P and GV3 P

- Control by rocker lever: for GV7 R.

Energisation is controlled manually by moving the knob or rocker lever to position "I" 1.

De-energisation is controlled manually by moving the knob or rocker lever to position "O" 2.

De-energisation due to a fault automatically places the knob or rocker lever in the "Trip" position 3.

Re-energisation is possible only after having returned the knob or rocker lever to position "O".

(1) Creep: normal crushing phenomenon of copper conductors, that is accentuated over time.

Presentation (continued)

Protection of motors and personnel

Motor protection is provided by the thermal-magnetic protection elements incorporated in the motor circuit-breaker.

The **magnetic** elements (short-circuit protection) have a non-adjustable tripping threshold, which is equal to 13 times the maximum setting current of the thermal trips.

The **thermal** elements (overload protection) include automatic compensation for ambient temperature variations.

The rated operational current of the motor is displayed by means of a graduated knob **4**. Personnel protection is also provided. All live parts are protected against direct finger contact from the front panel.

The addition of an undervoltage trip allows the circuit-breaker to be de-energised in the event of an undervoltage condition. The user is therefore protected against sudden starting of the machine when normal voltage is restored, since the Start button "I" has to be pressed to restart the motor.

With the addition of a shunt trip, de-energisation of the unit can be remotely controlled.

The operators on both open-mounted and enclosed motor circuit-breakers can be locked in the Stop position "O" by up to 4 padlocks.

Because they are suitable for isolation, these circuit-breakers, in the open position, provide an adequate isolation distance and indicate the actual position of the moving contacts by the position of the operators.

Special features

These motor circuit-breakers are easily installed in any configuration thanks to their universal fixing arrangement: screw fixing or clip-on mounting on symmetrical, asymmetrical or combination rails.

Environment		GV2 ME	GV2 P	GV3 P	GV3 ME80	GV7 R
Circuit-breaker type						
Conforming to standards		IEC 60947-1, 60947-2, 60947-4-1, EN 60204, UL 508, CSA C 22.2 n° 14-05, NF C 63-650, 63-120, 79-130, VDE 0113, 0660	IEC/EN 60947-1, 60947-2, 60947-4-1, UL 508 type E, CSA C 22.2 n° 14-05 type E	IEC/EN 60947-1, 60947-2, 60947-4-1, UL 508 type E, CSA C 22.2 n° 14-05 type E	IEC/EN, NF EN, BS EN, DIN EN 60947-2, 60947-4-1	IEC 60947-1, 60947-2, 60947-4-1, EN 60947-1, 60947-2, EN 60947-4-1, NF C 63-650, NF C 63-120, 79-130, VDE 0113, 0660
Product certifications		UL, CSA, CCC, CEBEC, GOST, TSE, BV, GL, LROS, DNV, PTB, EZU, SETI, RINA, ATEX	UL (1), CSA, PTB, EZU, GOST, TSE, DNV, LROS, GL, BV, RINA, CCC, ATEX	UL, CSA, CCC, GOST, ATEX, BV, GL, DNV, RINA, LROS (pending)	UL, CSA, LROS	UL, DNV, CCC
Protective treatment		"TH"		"TH"	"TC"	"TC"
Degree of protection	Conforming to IEC 60529	Open mounted	IP 20	IP 20	IP 20	IP 405 with terminal shrouds
		In enclosure	GV2 M•01: IP 41 GV2 M•02: IP 55	–	GV3 PC01 and GV3 PC02: IP 55	GV3 CE01: IP 55
Shock resistance	Conforming to IEC 60068-2-27		30 gn -11 ms	On: 15 gn -11 ms Off: 30 gn -11 ms	22 gn - 20 ms	15 gn -11 ms
Vibration resistance	Conforming to IEC 60068-2-6		5 gn (5...150 Hz)	4 gn (5...300 Hz)	2.5 gn (0...25 Hz)	2.5 gn (25 Hz)
Ambient air temperature	Storage	°C	- 40...+ 80	- 40...+ 80	- 40...+ 80	- 55...+ 95
	Operation	Open mounted	°C	- 20...+ 60	- 20...+ 60	- 20...+ 60 (2)
		In enclosure	°C	- 20...+ 40	- 20...+ 40	- 20...+ 40
Temperature compensation	Open mounted	°C	- 20...+ 60	- 20...+ 60	- 20...+ 60	- 25... + 55 (3)
	In enclosure	°C	- 20...+ 40	- 20...+ 40	- 20...+ 40	- 20...+ 40
Flame resistance	Conforming to IEC 60695-2-1	°C	960	960	960	960
Maximum operating altitude		m	2000	3000	3000	2000
Suitable for isolation	Conforming to IEC 60947-1 § 7-1-6		Yes	Yes	–	Yes
Resistance to mechanical impact		J	0.5	0.5	10	0.5
			IK 04		IK 09 (in enclosure)	–
Sensitivity to phase failure		Yes, conforming to IEC 60947-4-1 § 7-2-1-5-2				

Technical characteristics		GV2 ME	GV2 P	GV2 RT	GV3 P	GV3 ME80	GV7 R•20...R•100	GV7 R•150	GV7 R•220
Circuit-breaker type									
Utilisation category	Conforming to IEC 60947-2	A			A	A	A		
	Conforming to IEC 60947-4-1	AC-3			AC-3	AC-3	AC-3		
Rated operational voltage (Ue)	Conforming to IEC 60947-2	V	690		690	690	690		
Rated insulation voltage (Ui)	Conforming to IEC 60947-2	V	690		690	690	750		
Rated voltage	Conforming to CSA C22-2 n° 14, UL 508	V	600		600	600 (B600)	600		
Rated operational frequency	Conforming to IEC 60947-4-1 UL, CSA	Hz	50/60		50/60	50/60	50/60		
Rated impulse withstand voltage (U imp)	Conforming to IEC 60947-2	kV	6		6	6	8		
Total power dissipated per pole		W	2.5		8	8	5	8.7	14.5
Mechanical durability (C.O.: Close, Open)		C.O.	100 000		50 000	30 000	50 000	40 000	20 000
Electrical durability	440 V In/2 for AC-3 duty	C.O.	100 000		–	30 000	50 000	40 000	20 000
	440 V In	C.O.	–		50 000	–	30 000	20 000	10 000
Duty class (maximum operating rate)		C.O./h	25		25	25	25		
Maximum conventional rated thermal current (Ith)	Conforming to IEC 60947-4-1	A	0.16...32	0.16...32	0.40...23	13...65	80	12...100	150
Rated duty	Conforming to IEC 60947-4-1	Continuous duty							

(1) UL 508 type E for GV2 P•0H7


(2) Leave a space of 9 mm between 2 circuit-breakers: either an empty space, or side mounting add-on contact blocks. Side by side mounting is possible up to 40 °C.

(3) For operation up to 70 °C, please consult your Regional Sales Office.

Mounting characteristics

Operating position


Without derating, in relation to normal vertical mounting plane (1)

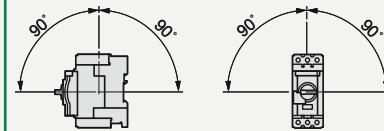

Connection characteristics

Connection to screw clamp terminals or spring terminals

Bare cables



Circuit-breaker type

Connection to screw clamp terminals

(2)
(Max. number of conductors x c.s.a.)

Solid cable

mm²

GV2 ME

GV2 P

GV3 P

GV3 ME80

Min.

Max.

Min.

Max.

Flexible cable without cable end

2 x 1.5

2 x 6

2 x 1.5

2 x 6

2 x 1

2 x 4

2 x 1

2 x 4

2 x 1

1 x 25 and 1 x 35

1 x 2.5

2 x 16

Tightening torque

Solid cable

mm²

2 x 1 (3)

2 x 6

—

—

—

—

—

—

Connection to spring terminals

Number of conductors x c.s.a.

Flexible cable without cable end

mm²

2 x 1.5 (3)

2 x 4

—


—

—

—

Connection by bars or lugs

Bars or lugs

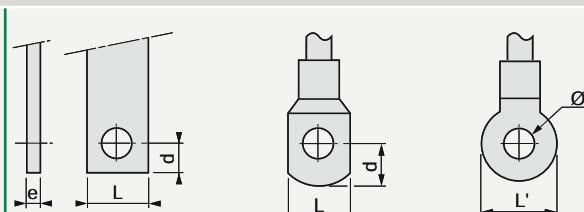

Circuit-breaker type

Pitch

Without spreaders

mm

13.5

17.5

GV7 R•20...R•100

35

35

35

With spreaders

With spreaders

mm

—

—

45

45

45

45

Bars or cables with lugs

e

mm

≤ 6

≤ 6

≤ 6

≤ 6

≤ 6

≤ 6

L

mm

≤ 9.5

≤ 13.5

≤ 25

≤ 25

≤ 25

≤ 25

L'

mm

≤ 9.5

≤ 16.5

—

—

—

—

d

mm

≤ 10

≤ 10

≤ 10

≤ 10

≤ 10

≤ 10

Screws

Tightening torque

N.m

1.7

6

10

15

15

Bare cables (copper or aluminium) with connectors

Height (h)

mm

—

—

20

20

20

C.s.a.

mm²

—

—

1.5...95

1.5...95

1.5...185

Tightening torque

N.m

—

—

15

15

15

(1) When mounting on a vertical rail, fit a stop to prevent any slippage.

(2) For motor circuit-breakers GV3 P: BTR hexagon socket head screws, EverLink® system.

Require use of an insulated Allen key, in compliance with local electrical wiring regulations.

(3) For cross-sections 1 to 1.5 mm², the use of an LA9 D99 cable end reducer is recommended.

Breaking capacity of GV2 ME and GV2 P		Circuit-breaker type	A	GV2 ME										GV2 P									
Rating	230/240 V	Icu		kA	01 to 06	07	08	10	14	16	20	21 & 22	32	01 to 06	07	08	10	14	16	20	21 & 22	32	
Breaking capacity conforming to IEC 60947-2					0.1 to 1.6	2.5	4	6.3	10	14	18	23 & 25	32	0.1 to 1.6	2.5	4	6.3	10	14	18	23 & 25	32	
230/240 V	Icu				★	★	★	★	★	★	★	50	50	★	★	★	★	★	★	★	★	★	
		Ics % (1)			★	★	★	★	★	★	★	100	100	★	★	★	★	★	★	★	★	★	
400/415 V	Icu				★	★	★	★	★	★	15	15	15	10	★	★	★	★	★	★	50	50	
		Ics % (1)			★	★	★	★	★	★	50	50	40	50	★	★	★	★	★	★	50	50	
440 V	Icu				★	★	★	50	15	8	8	6	6	★	★	★	★	★	★	50	20	20	
		Ics % (1)			★	★	★	100	100	50	50	50	50	★	★	★	★	★	★	75	75	75	
500 V	Icu				★	★	★	50	10	6	6	4	4	★	★	★	★	★	★	50	42	10	10
		Ics % (1)			★	★	★	100	100	75	75	75	75	★	★	★	★	★	★	100	75	75	75
690 V	Icu				★	3	3	3	3	3	3	3	3	★	8	8	6	6	6	4	4	4	
		Ics % (1)			★	75	75	75	75	75	75	75	75	★	100	100	100	100	100	100	100	100	
Associated fuses (if required) if $I_{sc} >$ breaking capacity Icu conforming to IEC 60947-2	230/240 V	aM	A	★	★	★	★	★	★	★	80	80	★	★	★	★	★	★	★	★	★	★	
		gG	A	★	★	★	★	★	★	★	100	100	★	★	★	★	★	★	★	★	★	★	
400/415 V	aM		A	★	★	★	★	★	★	63	63	80	80	★	★	★	★	★	★	★	100	100	
		gG	A	★	★	★	★	★	★	80	80	100	100	★	★	★	★	★	★	★	125	125	
440 V	aM		A	★	★	★	50	50	50	50	63	63	★	★	★	★	★	★	★	50	63	80	
		gG	A	★	★	★	63	63	63	63	80	80	★	★	★	★	★	★	★	63	80	100	
500 V	aM		A	★	★	★	50	50	50	50	50	50	★	★	★	★	★	★	★	50	50	50	
		gG	A	★	★	★	63	63	63	63	63	63	★	★	★	★	★	★	★	63	63	63	
690 V	aM		A	★	16	25	32	32	40	40	40	40	40	★	20	25	40	40	50	50	50	50	
		gG	A	★	20	32	40	40	50	50	50	50	50	★	25	32	50	50	63	63	63	63	

★ > 100 kA.

(1) As % of Icu.

Breaking capacity of GV2 ME and GV2 P (used in association with current limiter GV1 L3)

Circuit-breaker type	Rating	A	GV2 ME										
			01 to 06 0.1 to 1.6	07 2.5	08 4	10 6.3	14 10	16 14	20 18	21 23	22 25	32 32	
Breaking capacity conforming to IEC 60947-2	230/240 V	Icu	kA	★	★	★	★	★	★	★	★	★	
		Ics % (1)		★	★	★	★	★	★	★	★	★	
	400/415 V	Icu	kA	★	★	★	★	★	100	100	100	100	
		Ics % (1)		★	★	★	★	★	50	50	40	40	
	440 V	Icu	kA	★	★	★	★	★	50	20	20	20	
		Ics % (1)		★	★	★	★	★	75	75	75	75	
	500 V	Icu	kA	★	★	★	★	50	42	10	10	10	
		Ics % (1)		★	★	★	★	100	100	75	75	75	
Circuit-breaker type			GV2 P										
Rating		A	01 to 06 0.1 to 1.6	07 2.5	08 4	10 6.3	14 10	16 14	20 18	21 23	22 25	32 32	
Breaking capacity conforming to IEC 60947-2	230/240 V	Icu	kA	★	★	★	★	★	★	★	★	★	
		Ics % (1)		★	★	★	★	★	★	★	★	★	
	400/415 V	Icu	kA	★	★	★	★	★	★	★	★	★	
		Ics % (1)		★	★	★	★	★	★	★	★	★	
	440 V	Icu	kA	★	★	★	★	★	100	100	100	100	
		Ics % (1)		★	★	★	★	★	50	50	50	50	
	500 V	Icu	kA	★	★	★	★	100	100	100	100	100	
		Ics % (1)		★	★	★	★	50	50	50	50	50	
	690 V (3)	Icu = Ics	kA	★	50	50	50	50	50	50	50	50	
Circuit-breaker type			GV2 ME										
Rating		A	01 to 06 0.1 to 1.6	07 2.5	08 4	10 6.3	14 10	16 14	20 18	21 23	22 25	32 32	
Cable protection against thermal stress in the event of short-circuit (PVC insulated copper cables)	Minimum c.s.a. protected at 40 °C at Isc max.	1 mm ²		●	●	●	≤ 10 kA	≤ 6 kA	(2)	(2)	(2)	(2)	
		1.5 mm ²		●	●	●	≤ 20 kA	≤ 10 kA	(2)	(2)	(2)	(2)	
		2.5 mm ²		●	●	●	●	●	●	●	●	(2)	
		4...6 mm ²		●	●	●	●	●	●	●	●	●	

★ > 100 kA

● Cable c.s.a. protected

(1) As % of Icu

(2) Cable c.s.a. not protected

(3) With limiter LA9 LB920

Breaking capacity of GV3 P and GV3 ME80

Motor circuit-breaker type		A	GV3 P							GV3 ME80
			13	18	25	32	40	50	65	
Rating		A	13	18	25	32	40	50	65	80
Breaking capacity conforming to IEC 60947-2	230/240 V	Icu	kA	100	100	100	100	100	100	100
		Ics % (1)		100	100	100	100	100	100	100
	400/415 V	Icu	kA	100	100	100	100	50	50	50
		Ics % (1)		100	100	100	100	100	100	50
	440 V	Icu	kA	50	50	50	50	50	50	10
		Ics % (1)		100	100	100	100	100	100	60
	500 V	Icu	kA	12	12	12	12	12	12	4
		Ics % (1)		50	50	50	50	50	50	100
	690 V	Icu	kA	6	6	6	6	6	6	2
		Ics % (1)		50	50	50	50	50	50	100
Associated fuses, if required if $Isc > $ breaking capacity Icu	230/240 V	aM	A	★	★	★	★	★	★	★
		gG	A	★	★	★	★	★	★	★
	415 V	aM	A	★	★	★	★	125	125	125
		gG	A	★	★	★	★	160	160	160
	440 V	aM	A	63	80	125	125	125	125	315
		gG	A	80	100	160	160	160	160	400
	500 V	aM	A	63	63	63	63	80	80	200
		gG	A	80	80	80	80	100	100	250
	690 V	aM	A	50	50	50	50	63	63	200
		gG	A	63	63	63	63	80	80	250


★ Fuse not required: breaking capacity $Icn > Isc$.(1) As % of Icu .

Breaking capacity of GV7 R									
Circuit-breaker type			GV7						
			RE20...RE100	RS20...RS100	RE150	RS150	RE220	RS220	
Rating	A		12...20 to 60...100		90...150	90...150	132...220	132...220	
Breaking capacity conforming to IEC 60947-2	230/240 V	Icu	kA	85	100	85	100	85	100
		Ics % (1)		100	100	100	100	100	100
	400/415 V	Icu	kA	36	70	35	70	35	70
		Ics % (1)		100	100	100	100	100	100
	440 V	Icu	kA	36	65	35	65	35	65
		Ics % (1)		100	100	100	100	100	100
	500 V	Icu	kA	18	50	30	50	30	50
		Ics % (1)		100	100	100	100	100	100
	690 V	Icu	kA	8	10	8	10	8	10
		Ics % (1)		100	100	100	100	100	100
Cable protection against thermal stress in the event of short-circuit (PVC insulated copper cables)	Minimum c.s.a. protected at 40 °C at Isc max.	4 mm ²		≤ 6 kA	≤ 6 kA	(2)	(2)	(2)	(2)
		6 mm ²	•		≤ 25 kA	(2)	(2)	(2)	(2)
		10...50 mm ²	•	•	•	•	•	•	•

(1) As % of Icu.


• Cable c.s.a. protected.

(2) Cable c.s.a. not protected.

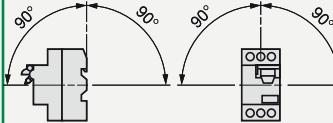Environment				
Circuit-breaker type		GV2 LE	GV2 L	
Conforming to standards		IEC 60947-1, 60947-2, EN 60204, NF C 63-650, NF C63-120, 79-130, VDE 0113, 0660.		
Product certifications		CSA, CCC		CSA, CCC, BV, DNV, GL, LROS, RINA
Protective treatment		"TH"		"TH"
Shock resistance	Conforming to IEC 60068-2-27	30 gn		30 gn
Vibration resistance	Conforming to IEC 60068-2-6	5 gn (5 to 150 Hz)		5 gn (5 to 150 Hz)
Ambient air temperature	Storage	°C	- 40...+ 80	
	Operation	°C	- 20...+ 60	
Flame resistance	Conforming to IEC 60695-2-1	°C	960	
Maximum operating altitude		m	2000	
Operating position				
Connection (Max. number of conductors x c.s.a)	Solid cable	mm²	Min.	Max.
			2 x 1	2 x 6
	Flexible cable without cable end	mm²	2 x 1.5	2 x 6
	Flexible cable with cable end	mm²	2 x 1	2 x 4
Tightening torque		N.m	1.7	
Suitable for isolation	Conforming to IEC 60947-1 § 7-1-6		Yes	
Resistance to mechanical impact		J	0.5	
Technical characteristics				
Utilisation category	Conforming to IEC 60947-2		A	
	Conforming to IEC 60947-4-1		AC-3	
Rated operational voltage (Ue)	Conforming to IEC 60947-2	V	690	
Rated insulation voltage (Ui)	Conforming to IEC 60947-2	V	690	
Rated operational frequency	Conforming to IEC 60947-2	Hz	50/60	
Rated impulse withstand voltage (U imp)	Conforming to IEC 60947-2	kV	6	
Total power dissipated per pole		W	1.8	
Mechanical durability (C.O.: Closing, Opening)	For AC-3 duty	C.O.	100 000	
Electrical durability for AC-3/415V duty (C.O.: Closing, Opening)		C.O.	100 000	
Duty class (maximum operating rate)		C.O./h	40	
Rated duty	Conforming to IEC 60947-4-1		Continuous duty	

Circuit-breaker type		A	GV2 LE										GV2 L												
			03 to 06	07	08	10	14	16	20	22	32		03 to 05	06 & 07	08	10	14	16	20	22	32				
Rating		A	0.4 to 1.6	2.5	4	6.3	10	14	18	25	32	0.4 to 1	1.6 to 2.5	4	6.3	10	14	18	25	32					
Breaking capacity conforming to IEC 60947-2	230/240 V	Icu	kA	★	★	★	★	★	★	50	50	★	★	★	★	★	★	★	★	★	★	50	50		
		Ics % (1)		★	★	★	★	★	★	★	100	100	★	★	★	★	★	★	★	★	★	★	100	100	
	400/415 V	Icu	kA	★	★	★	★	★	★	15	15	15	10	★	★	★	★	★	★	★	★	★	50	50	
		Ics % (1)		★	★	★	★	★	★	50	50	40	50	★	★	★	★	★	★	★	★	★	50	50	
	440 V	Icu	kA	★	★	★	50	15	8	8	6	6	★	★	★	★	★	★	★	★	★	★	20	20	
		Ics % (1)		★	★	★	100	100	50	50	50	50	★	★	★	★	★	★	★	★	★	★	75	75	
	500 V	Icu	kA	★	★	★	50	10	6	6	4	4	★	★	★	★	★	★	★	★	★	★	10	10	
		Ics % (1)		★	★	★	100	100	75	75	75	75	★	★	★	★	★	★	★	★	★	★	100	75	
	690 V	Icu	kA	★	3	3	3	3	3	3	3	3	★	4	4	4	4	4	4	4	4	4	4	4	
		Ics % (1)		★	75	75	75	75	75	75	75	75	★	100	100	100	100	100	100	100	100	100	100	100	
Associated fuses (if required) if Isc > breaking capacity Icu conforming to IEC 60947-2 amendment 1	230/240 V	aM	A	★	★	★	★	★	★	★	80	80	★	★	★	★	★	★	★	★	★	★	★	100	100
		gG	A	★	★	★	★	★	★	★	100	100	★	★	★	★	★	★	★	★	★	★	★	125	125
	400/415 V	aM	A	★	★	★	★	★	★	63	63	80	80	★	★	★	★	★	★	★	★	★	★	80	100
		gG	A	★	★	★	★	★	★	80	80	100	100	★	★	★	★	★	★	★	★	★	★	100	125
	440 V	aM	A	★	★	★	50	50	50	50	63	63	★	★	★	★	★	★	★	★	★	★	★	50	80
		gG	A	★	★	★	63	63	63	63	80	80	★	★	★	★	★	★	★	★	★	★	★	63	100
	500 V	aM	A	★	★	★	50	50	50	50	50	50	★	★	★	★	★	★	★	★	★	★	★	50	50
		gG	A	★	★	★	63	63	63	63	63	63	★	★	★	★	★	★	★	★	★	★	★	63	63
	690 V	aM	A	★	16	25	32	32	40	40	40	40	★	20	25	40	40	50	50	50	50	50	50	50	
		gG	A	★	20	32	40	40	50	50	50	50	★	25	32	50	50	63	63	63	63	63	63	63	
Cable protection against thermal stress in the event of short-circuit (PVC insulated copper cables) Minimum c.s.a. protected at 40 °C and at Isc max.	1 mm ²		kA	●	●	●	≤ 10	≤ 6	(2)	(2)	(2)	(2)	●	●	●	≤ 10	≤ 6	(2)	(2)	(2)	(2)				
	1.5 mm ²		kA	●	●	●	≤ 20	≤ 10	(2)	(2)	(2)	(2)	●	●	●	≤ 20	≤ 10	(2)	(2)	(2)	(2)				
	2.5 mm ²			●	●	●	●	●	●	●	●	(2)	●	●	●	●	●	●	●	●	●	●	(2)		
	4...6 mm ²			●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●		

★ > 100 kA
 ● Cable c.s.a. protected
 (1) As % of Icu
 (2) Cable c.s.a. not protected

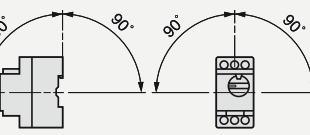Environment						
Circuit-breaker type			GV3 L	GK3 EF80		
Conforming to standards			IEC/EN 60947-1, 60947-2	IEC 60947-2, EN 60204		
Protective treatment			"TH"	"TC"		
Degree of protection	Conforming to IEC 60529		IP 20	IP 20		
Shock resistance	Conforming to IEC 60068-2-27		On : 15 gn -11 ms Off : 30 gn -11 ms	22 gn -20 ms		
Vibration resistance	Conforming to IEC 60068-2-6		4 gn (5...300 Hz)	2.5 gn (0...25 Hz)		
Flame resistance	Conforming to IEC 60695-2-1		°C 960	960		
Ambient air temperature	Storage	°C	- 40...+ 80	- 40...+ 80		
	Operation	°C	- 20...+ 60 (1)	- 20...+ 70 open mounted		
Maximum operating altitude	m	3000		3000		
Operating position	Without derating, in relation to normal vertical mounting plane (2)			Any position		
Connection (Max. number of conductors x c.s.a)	Solid cable	mm²	Min. 2 x 1	Max. 1 x 25 1 x 35	Min. 1 x 2.5	Max. 1 x 35
	Flexible cable without cable end	mm²	2 x 1	1 x 25 1 x 35	1 x 2.5 or 2 x 2.5	1 x 25 or 2 x 16
	Flexible cable with cable end	mm²	2 x 1	1 x 25 1 x 35	1 x 2.5 or 2 x 2.5	1 x 25 or 2 x 16
Tightening torque	N.m	5	5 : 25 mm² 8 : 35 mm²		5	
Suitable for isolation	conforming to IEC 60947-1 § 7-1-6		Yes	Yes		
Technical characteristics						
Rated insulation voltage (Ui)	Conforming to IEC 60947-2		V 690	750		
Rated impulse withstand voltage (U imp)	Conforming to IEC 60947-2		kV 6	10		
Rated operational voltage (Ue)	Conforming to IEC 60947-2		V 690	690		
Rated operational frequency			Hz 50/60	50...60		
Electrical durability for AC-3/415V duty (C.O.: Close - Open)			C.O. 50 000	1500		
Mechanical durability (C.O.: Closing, Opening)			C.O. 50 000	20 000		
Maximum operating rate			C.O./h 25	40		
Operating threshold of magnetic trips			14 l max	3363		
Utilisation category	Conforming to IEC 60947-2		A	A		

(1) Leave a space of 9 mm between 2 circuit-breakers: either an empty space or side-mounting add-on contact blocks. Side by side mounting is possible up to 40 °C.

(2) When mounting on a vertical rail, fit a stop to prevent any slippage.

Breaking capacity of GV3 L and GK3 EF80											
Type	230/240 V	Icu	kA	GV3 L25	GV3 L32	GV3 L40	GV3 L50	GV3 L65	GK3 EF80		
Breaking capacity of the circuit-breaker only or of the circuit-breaker combined with a thermal overload relay	230/240 V	Icu	kA	100	100	100	100	100	50		
			Ics % (1)	100	100	100	100	100	40		
	400/415 V	Icu	kA	100	100	50	50	50	35		
			Ics % (1)	100	100	100	100	100	25		
	440 V	Icu	kA	50	50	50	50	50	25		
			Ics % (1)	100	100	100	100	100	30		
	500 V	Icu	kA	12	12	12	12	12	15		
			Ics % (1)	50	50	50	50	50	30		
	690 V	Icu	kA	6	6	6	6	6	6		
			Ics % (1)	50	50	50	50	50	50		
Associated fuses (if required) for use with circuit-breaker only or circuit-breaker combined with a thermal overload relay if Isc > breaking capacity	230/240 V	aM	A	★	★	★	★	★	200		
			gG	A	★	★	★	★	315		
	415 V	aM	A	★	★	★	★	125	200		
			gG	A	★	★	★	160	250		
	440 V	aM	A	63	80	125	125	125	160		
			gG	A	80	100	160	160	250		
	500 V	aM	A	63	63	63	63	80	160		
			gG	A	80	80	80	100	200		
	690 V	aM	A	50	50	50	50	63	125		
			gG	A	63	63	63	80	160		
Use of circuit-breakers without fuses				Minimum cable length (in metres) limiting the maximum short-circuit current to 35 kA maximum, so enabling breakers GK3 EF80 to be used without fuses							
Cable c.s.a.			mm ²	≤ 25	35	50	70	95	120		
Isc (rms) 3-phase, incoming (Ue = 415 V)			50 kA	m	5	6	8	10	13		
			45 kA	m	5	5	7	8	10		
			40 kA	m	5	5	5	8	9		
			37 kA	m	5	5	5	5	5		

★ Fuse not required: breaking capacity $Icn > Isc$.

(1) As % of Icu

Characteristics

TeSys protection components

Thermal-magnetic motor circuit-breakers

GV2, GV3 P and GV3 L

Auxiliary contacts

Type of contacts			Instantaneous auxiliary GV AN, GV AD							Fault signalling GV AD, GV AM11 (1)				Instantaneous auxiliary GV AE				
Rated insulation voltage (Ui) (associated insulation coordination)	Conforming to IEC 60947-1	V	690							690				250 (690 in relation to main circuit)				
	Conforming to CSA C22-2 n° 14 and UL 508	V	600							300				300				
Conventional thermal current (Ith)	Conforming to IEC 60947-5-1	A	6							2.5				2.5				
	Conforming to CSA C22-2 n° 14 and UL 508	A	5							1				1				
Mechanical durability (C.O.: Close - Open)		C.O.	100 000							1000				100 000				
Operational power and current conforming to IEC 60947-5-1. a.c. operation			AC-15/100 000 C.O.							AC-14/1000 C.O.				AC-15/100 000 C.O.				
Operational power and current conforming to IEC 60947-5-1. d.c. operation	Rated operational voltage (Ue)	V	48	110	230	380	440	500	690	24	48	110	230	24	48	110	230	
	Operational power, normal conditions	VA	300	500	720	850	650	500	400	36	48	72	72	48	60	120	120	
	Occasional breaking and making capacities, abnormal conditions	kVA	3	7	13	15	13	12	9	0.22	0.3	0.45	0.45	0.48	0.6	1.27	2.4	
	Rated operational current (le)	A	6	4.5	3.3	2.2	1.5	1	0.6	1.5	1	0.5	0.3	2	1.25	1	0.5	
Low power switching reliability of contact			DC-13/100 000 C.O.							DC-13/1000 C.O.				DC-13/100 000 C.O.				
Minimum operational conditions d.c. operation		V	24	48	60	110	240	(2)	-	-	24	48	60	-	24	48	60	-
Short-circuit protection		mA	140	240	180	140	120	-	-	-	24	15	9	-	24	15	9	-
Cabling, screw clamp terminals			W							W				100			100	
Cabling, spring terminal connections			Occasional breaking and making capacities, abnormal conditions							50				50			-	
Tightening torque		N.m	Rated operational current (le)							1				0.3			0.15	
Flexible cable without cable end		mm²	GV AN only							0.75...2.5				-			0.75...1.5	
Operation of instantaneous auxiliary contacts																Operation of fault signalling contacts		
GV2			GV3P, GV3L							GV AM11				Change of state following tripping on short-circuit.				
Power pole		0	Power pole							GV AD10●● and GV AD01●●				Change of state following tripping on short-circuit, overload or undervoltage.				
GV AN20		F	GV AN20							GV AE1				GV AE11				
GV AN11		F	GV AN11							GV AE20				GV AE20				
GV AE1		O	GV AE1							GV AE11				GV AE11				
GV AE20		F	GV AE20							GV AD10●●				GV AD10●●				
GV AE11		O	GV AE11							GV AED101				GV AED101				
GV AD10●●		F	GV AD10●●							GV AED011				GV AED011				
GV AD11●●		O	GV AD11●●							Contact open				Contact closed				

(1) For application example of fault signalling contact and short circuit signalling contact, see page 3/82.

(1) For application example of fault signalling contact and short-circuit
 (2) Add an RC circuit type I A4 D to the load terminals, see page 5/81

Characteristics

TeSys protection components

Thermal-magnetic motor circuit-breakers

GV3 ME80


Auxiliary contacts

3

Type of contacts		Instantaneous auxiliary contacts GV3 A01...A07								Fault signalling contacts GV3 A08 and A09								
Rated insulation voltage (Ui)	Conforming to IEC 60947-1	V	690								690							
	Conforming to CSA C22-2 n° 14, UL 508	V	600 (B600)								600 (B600)							
Conventional rated thermal current (I _{th})	Conforming to IEC 60947-5-1	A	6								6							
	Conforming to CSA C22-2 n° 14, UL 508	A	5 (B600)								5 (B600)							
Mechanical durability (C.O.: Close - Open)		C.O.	100 000								1000							
Operational power and current conforming to IEC 60947-5-1 a.c. operation	Rated operational voltage (Ue)	V	48	110	220	380	440	500	690	48	110	220	380	440	500	690		
	Operational power		AC-11/100 000 C.O.								AC-11/1000 C.O.							
	Occasional breaking and making capacities	kVA	350	500	800	850	700	700	400	240	460	800	850	450	450	200		
	Operational current (Ie)	A	6	4.5	3.5	2.2	1.5	1.5	0.6	5	3.6	3.5	2.2	1	1	0.3		
Operational power and current conforming to IEC 60947-5-1 d.c. operation	Rated operational voltage (Ue)	V	24	48	60	110	220			24	48	60	110	220				
	Operational power		DC-11/100 000 C.O.								DC-11/1000 C.O.							
	Occasional breaking and making capacities	W	180	240	180	140	120			120	120	90	70	60				
	Operational current (Ie)	A	240	360	240	210	180			180	180	135	105	90				
Short-circuit protection			By GB2 CB08 circuit-breaker or gG fuse, 6A max															
Connection	Number of conductors		1				2											
	Solid cable	mm ²	1...2.5				1...2.5											
	Flexible cable without cable end	mm ²	0.75...2.5				0.75...2.5											
	Flexible cable with cable end	mm ²	0.75...2.5				0.75...1.5											

Contact operation GV3

GV3 A08 and A09 change state following tripping on short-circuit or overload

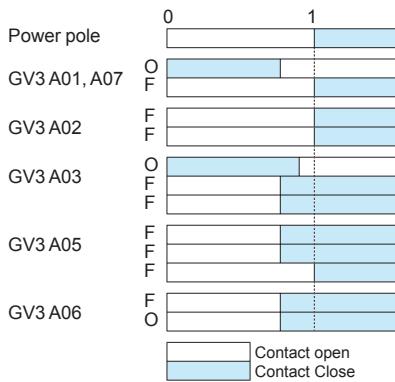

Auxiliary contact characteristics

Type of contacts		V	GV7 AE11						GV7 AB11								
Rated insulation voltage(Ui) (associated insulation coordination)	Conforming to IEC 60947-1	V	690						690								
Conventional thermal current (Ith)	Conforming to IEC 60947-5-1	A	6						6								
Mechanical durability (C.O.: Close - Open)		C.O.	50 000						50 000								
Operational current conforming to IEC 60947-5-1 a.c. operation	Rated operational voltage (Ue)	V	AC-12 or AC-15. 50 000 C.O.						AC-12 or AC-15. 50 000 C.O.								
	Rated operational current (Ie)	AC-12	A	24	48	110	230/ 240	380/ 415	440	690	24	48	110	230/ 240	380/ 415	440	690
		AC-15	A	6	6	5	4	3	3	0.1	5	5	4	3	2.5	2.5	0.1
Operational current conforming to IEC 60947-5-1 d.c. operation	Rated operational voltage (Ue)	V	DC-12 or DC-14. 50 000 C.O.						DC-12 or DC-14. 50 000 C.O.								
	Rated operational current (Ie)	DC-12	A	2.5	2.5	0.8		0.3	2		2		0.5		—		
		DC-14	A	1	0.2	0.5		0.03	0.5		0.1		0.25		—		
Minimum operational conditions d.c. operation		V	17						12								
		mA	5						5								
Short-circuit protection			By GB2 CB•• circuit-breaker (rating according to operational current for Ue ≤ 415 V) or gG fuse, 10 A max.														
Cabling	Solid cable	mm ²	1 x 1.5 conductor						1 x 1.5 conductor								
	Flexible cable without cable end	mm ²	1 x 1.5 conductor						1 x 1.5 conductor								
	Flexible cable with cable end	mm ²	1 x 1.5 conductor						1 x 1.5 conductor								

Characteristics of Start-Stop and fault signalling contacts

Rated insulation voltage (Ui)	Conforming to IEC 60947-1	V	500					
Rated operational voltage (Ue)	Conforming to IEC 60947-1	V	500					
Conventional thermal current (ith)	Conforming to IEC 60947-5-1	A	6					
Operational power and current conforming to IEC 60947-5-1 a.c. operation (C.O.: Close - Open)	Rated operational voltage (Ue)	V	AC-15. 20 000 C.O. 48	110/127	220/240	380/415	440	500
	Operational power	VA	360	500	800	850	700	700
	Occasional breaking and making capacities	VA	4000	12 000	20 000	20 000	15 000	15 000
	Rated operational current (le)	A	6	4.5	3.5	2.2	1.5	1.5
Operational power and current conforming to IEC 60947-5-1 d.c. operation (C.O.: Close - Open)	Rated operational voltage (Ue)	V	DC-13. 1000 C.O. 24	48	60	110	220	
	Operational power	W	180	240	180	140	120	
	Occasional breaking and making capacities	W	240	280	240	210	180	
	Rated operational current (le)	A	6	5	3	1.3	0.5	
Short-circuit protection	Conforming to IEC 60947-5-1		By GB2 CB08 circuit-breaker or gG fuse, 6A max					
Cabling	Solid cable	mm ²	1 x 1...4 conductor					
	Flexible cable without cable end	mm ²	1 x 2.5 conductor					
	Flexible cable with cable end	mm ²	1 x 1...2.5 conductor or 2 x 1...2.5 conductors					
Tightening torque		N.m	0.8					

Characteristics of electric trips									
Circuit-breaker type			GV2 ME, GV2 P GV3 P, GV3 L		GV2 ME only	GV3 ME80		GV7 R	
Type of trip			GV AU	GV AS	GV AX (1)	GV3 B	GV3 D	GV7 AU	GV7 AS
Rated insulation voltage (Ui)	Conforming to IEC 60947-1	V	690	690	500	690	690	690	690
	Conforming to CSA C22-2 n° 14, UL 508	V	600	600	—	600 (B600)	600 (B600)	600	600
Operational voltage	Conforming to IEC 60947-1	V	0.85... 1.1 Un	0.7... 1.1 Un	0.85... 1.1 Un	0.8...1.1 Un		0.85... 1.1 Un	0.7... 1.1 Un
Drop-out voltage		V	0.7... 0.35 Un	0.75... 0.2 Un	0.7... 0.35 Un	0.7...0.35 Un		0.35... 0.7 Ue	0.2... 0.75 Ue
Inrush consumption	~	VA	12	14	12	12		< 10	
	—	W	8	10.5	8	7		< 5	
Sealed consumption	~	VA	3.5	5	3.5	7		< 5	
	—	W	1.1	1.6	1.1	2.5		< 5	
Operating time	Conforming to IEC 60947-1	ms	From the moment the voltage reaches its operational value until opening of the circuit-breaker.				10	15	< 50
On-load factor			100 %			100 %		100 %	
Cabling	Number of conductors		2 or 4			1 or 2		1	
	Solid cable	mm ²	1...2.5			1...2.5		1.5	
	Flexible cable without cable end	mm ²	0.75...2.5			0.75...2.5		1.5	
	Flexible cable with cable end	mm ²	0.75...1.5			0.75...2.5		1	
Tightening torque		N.m	1.4 max			1.2		1.2	
Mechanical durability (C.O.: Close - Open)		C.O.	30 000 (GV2 ME and GV2 P) 10 000 (GV3 P and GV3 L)			50 % of the mechanical durability of the circuit-breaker			

(1) Wiring scheme of undervoltage trip for dangerous machines (conforming to INRS) on **GV2 ME** only, see page 3/82.

Characteristics

TeSys protection components

Thermal-magnetic and magnetic motor circuit-breakers GV2 and GV3
Accessories

3

Characteristics of 3-pole busbars GV2 G●●● and GV3 G●64

		GV2 G●●●	GV3 G●64
Rated insulation voltage (Ui)	Conforming to IEC 60947-1	V 690	690
Conventional thermal current (I_{th})	Conforming to IEC 60439-1	A 63	115
Permissible peak current (I peak)		kA 11	20
Permissible thermal limit (I²t)		kA ² s 104	300
Degree of protection	Conforming to IEC 60529		IP 20
Terminal block		Yes	-

Characteristics of terminal blocks GV2 G05 and GV1 G09 (for GV2 ME and GV2 P)


Rated insulation voltage (Ui)	Conforming to IEC 60947-1	V	690
Conventional thermal current (I_{th})	Conforming to IEC 60439-1	A	63
Degree of protection	Conforming to IEC 60529		IP 20
Connection	Solid cable	mm ²	1 x 1.5 to 25 conductor or 2 x 1.5 to 6 conductors
	Flexible cable without cable end	mm ²	1 x 1.5 to 16 conductor or 2 x 2.5 to 4 conductors
	Flexible cable with cable end	mm ²	1 x 1.5 to 10 conductor or 2 x 1.5 to 2 conductors
	Flexible or solid cable AWG		1 AWG 4
Tightening torque	Connector	N.m	2.2
	Screw clamp terminals	N.m	1.7

Characteristics of current limiters (GV2 ME and GV2 P)

Type		GV1 L3	LA9 LB920
Rated insulation voltage (Ui)	Conforming to IEC 60947-1	V 690	690
Conventional thermal current (I_{th})	Conforming to IEC 60947-1	A 63	63
Rated operational current (I_e)		A 32	32
Operating threshold	rms current	A 1500 (non adjustable threshold)	1000 (non adjustable threshold)
Connection		1 conductor	2 conductors
	Solid cable	mm ² 1.5...25	1.5...10
	Flexible cable without cable end	mm ² 1.5...25	2.5...10
	Flexible cable with cable end	mm ² 1.5...16	1.5...4
Tightening torque		N.m 2.2	

Thermal-magnetic tripping curves for GV2 ME and GV2 P

Average operating times at 20 °C related to multiples of the setting current

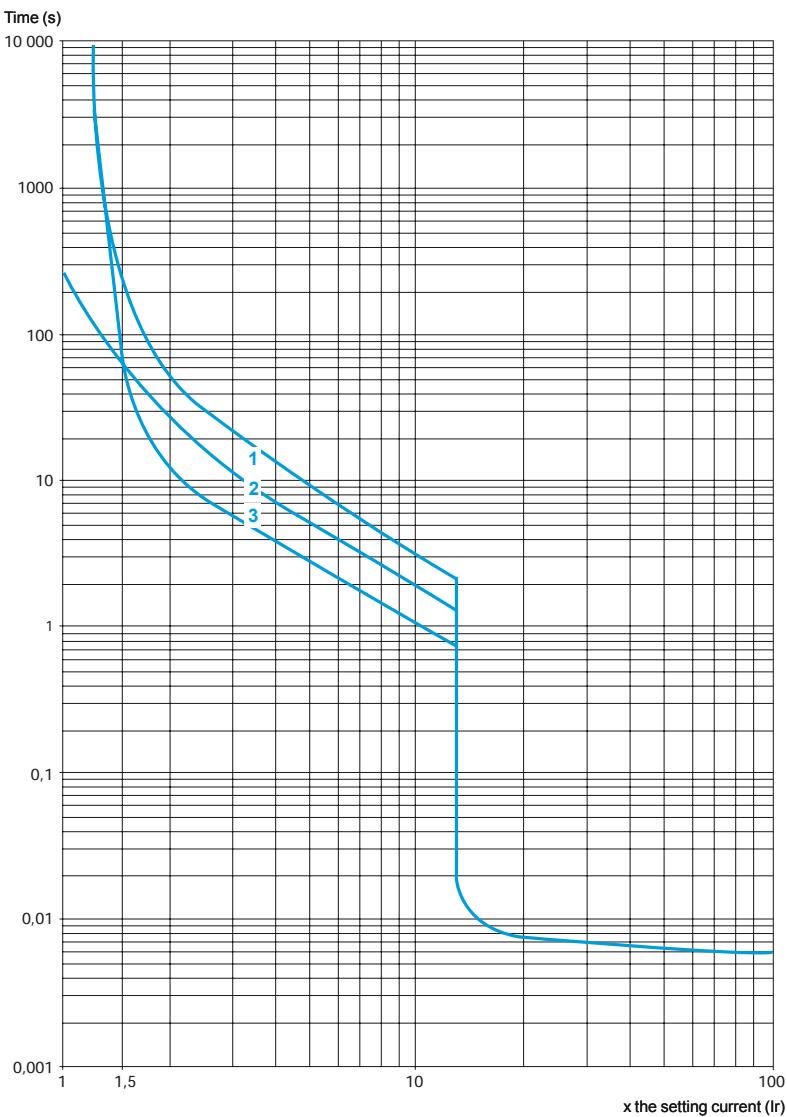

1 3 poles from cold state

2 2 poles from cold state


3 3 poles from hot state

Current limitation on short-circuit for GV2 ME and GV2 P (3-phase 400/415 V)

Dynamic stress

I peak = f (prospective Isc) at 1.05 Ue = 435 V

Limited peak current (kA)

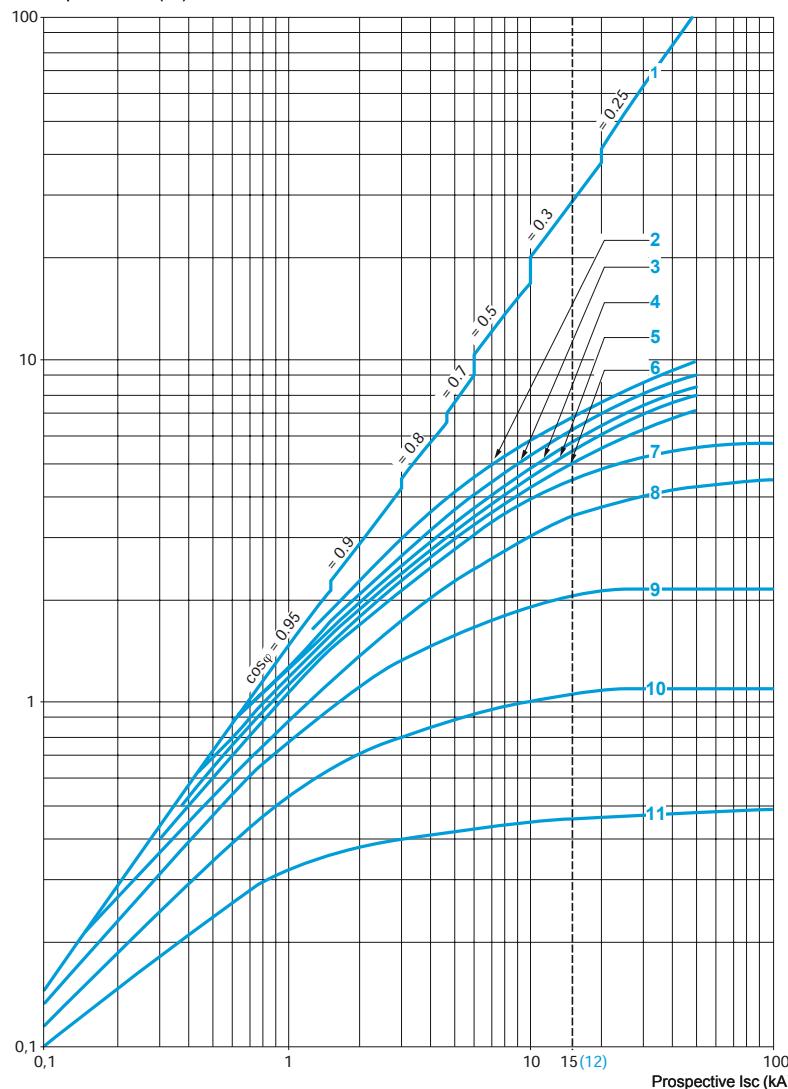

1 Maximum peak current

2 24 -32 A

3 20 -25 A

4 17 -23 A

5 13 -18 A

6 9 -14 A

7 6 -10 A

8 4 -6.3 A

9 2.5 -4 A

10 1.6 -2.5 A


11 1 -1.6 A

12 Limit of rated ultimate breaking capacity on short-circuit of GV2 ME (14, 18, 23 and 25 A ratings)

Thermal limit on short-circuit for GV2 ME


Thermal limit in kA²s in the magnetic operating zone

Sum of $I^2dt = f$ (prospective Isc) at 1.05 Ue = 435 V

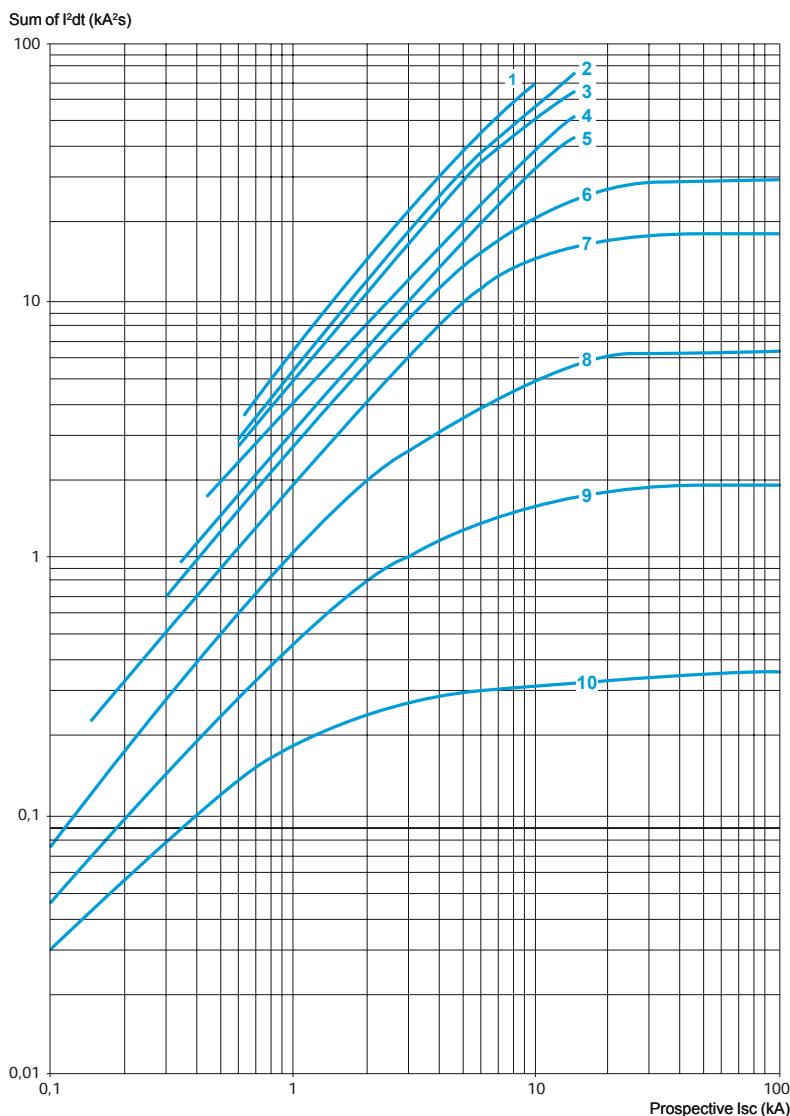

- 1** 24 -32 A
- 2** 20 -25 A
- 3** 17 -23 A
- 4** 13 -18 A
- 5** 9 -14 A
- 6** 6 -10 A
- 7** 4 -6.3 A
- 8** 2.5 -4 A
- 9** 1.6 -2.5 A
- 10** 1 -1.6 A

Thermal limit on short-circuit for GV2 P

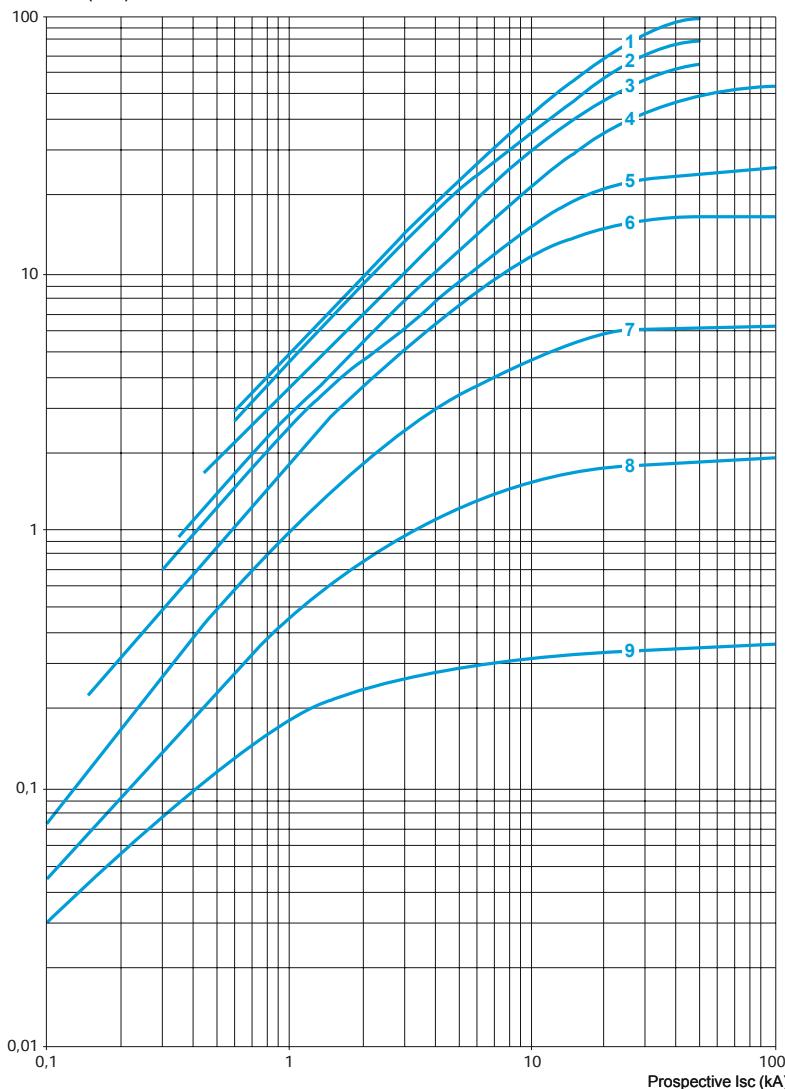
Thermal limit in kA²s in the magnetic operating zoneSum of $I^2dt = f$ (prospective Isc) at 1.05 Ue = 435 VSum of I^2dt (kA²s)

- 1** 24 -32 A
- 1** 20 -25 A
- 2** 17 -23 A
- 3** 13 -18 A
- 4** 9 -14 A
- 5** 6 -10 A
- 6** 4 -6.3 A
- 7** 2.5 -4 A
- 8** 1.6 -2.5 A
- 9** 1 -1.6 A

3

Thermal-magnetic tripping curves

Average operating times at 20 °C related to multiples of the setting current

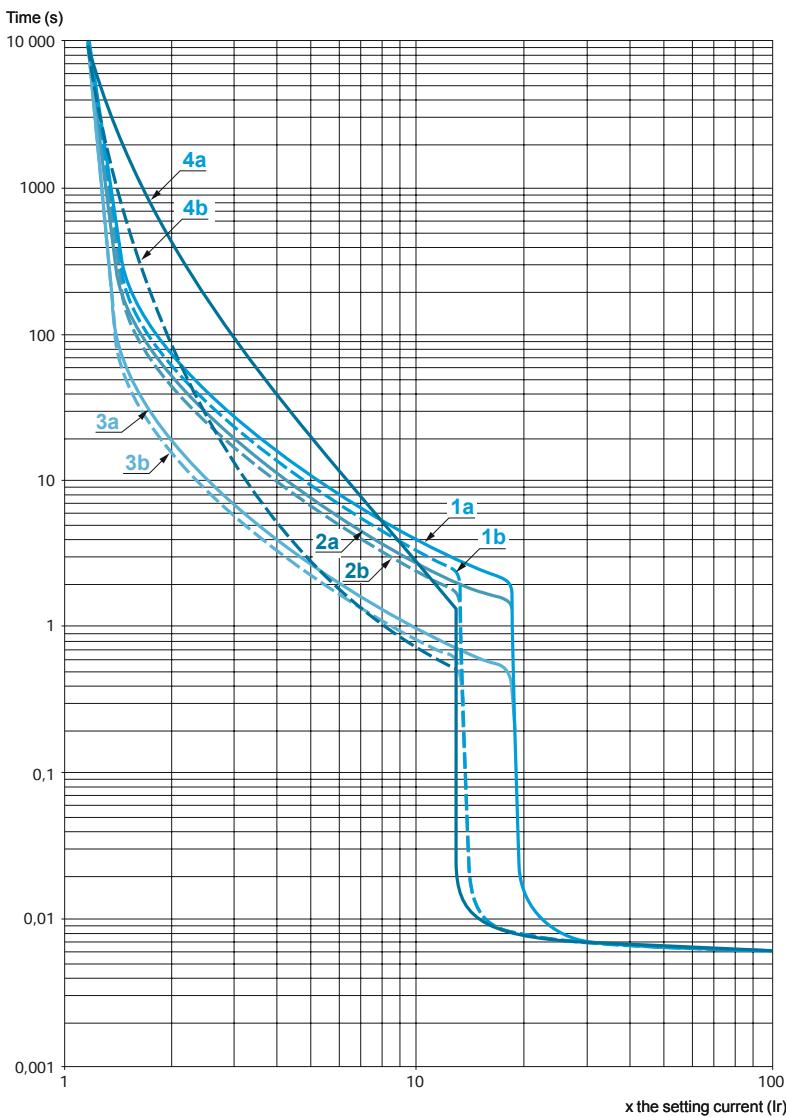


- 1a**: 3 poles from cold state (I_r mini.) : GV3 P
- 1b**: 3 poles from cold state (I_r maxi.) : GV3 P
- 2a**: 2 poles from cold state (I_r mini.) : GV3 ME80
- 2b**: 2 poles from cold state (I_r maxi.) : GV3 ME80
- 3a**: 3 poles from hot state (I_r mini.) : GV3 P
- 3b**: 3 poles from hot state (I_r maxi.) : GV3 P
- 4a**: 3 poles from hot state (I_r mini.) : GV3 ME80
- 4b**: 3 poles from hot state (I_r maxi.) : GV3 ME80

Current limitation on short-circuit (3-phase 400/415 V)

Dynamic stress

I peak = f (prospective Isc) at 1.05 Ue = 435 V

Limited peak current (kA)

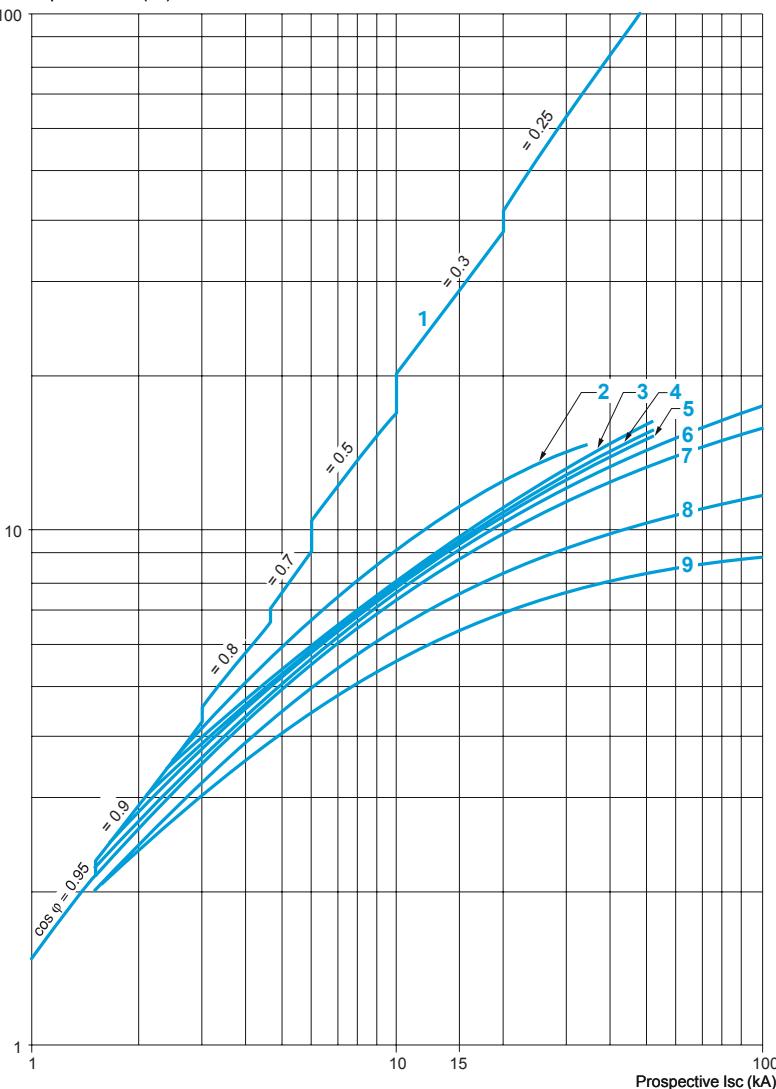

1 Maximum peak current

2 56 -80 A

3 48 -65 A

4 37 -50 A

5 30 -40 A


6 23 -32 A

7 17 -25 A

8 12 -18 A

9 9 -13 A


Maximum thermal limit on short-circuit

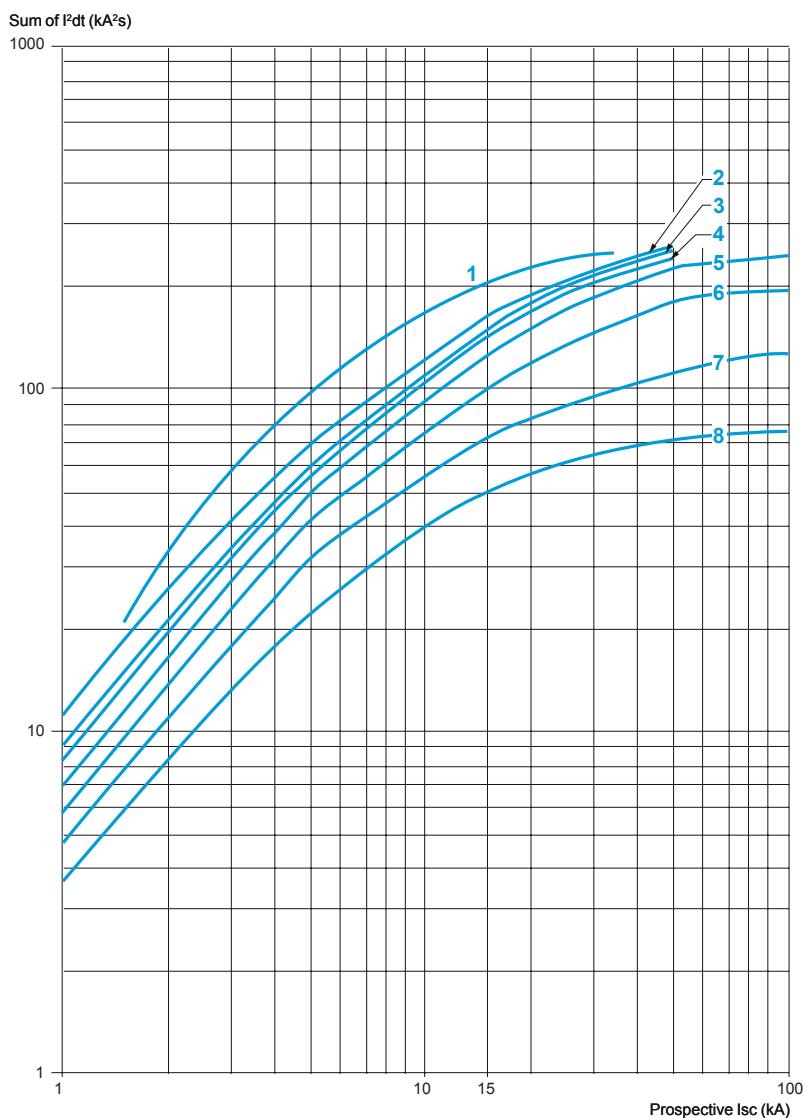Thermal limit in kA²s in the magnetic operating zoneSum of I²dt = f (prospective Isc) at 1.05 Ue = 435 V

- 1 56-80 A (GV3 ME80)
- 2 48-65 A (GV3 P65)
- 3 37-50 A (GV3 P50)
- 4 30-40 A (GV3 P40)
- 5 23-32 A (GV3 P32)
- 6 17-25 A (GV3 P25)
- 7 12-18 A (GV3 P18)
- 8 9-13 A (GV3 P13)

Thermal-magnetic tripping curves for GV7 R

Average operating times at 20 °C related to multiples of the setting current

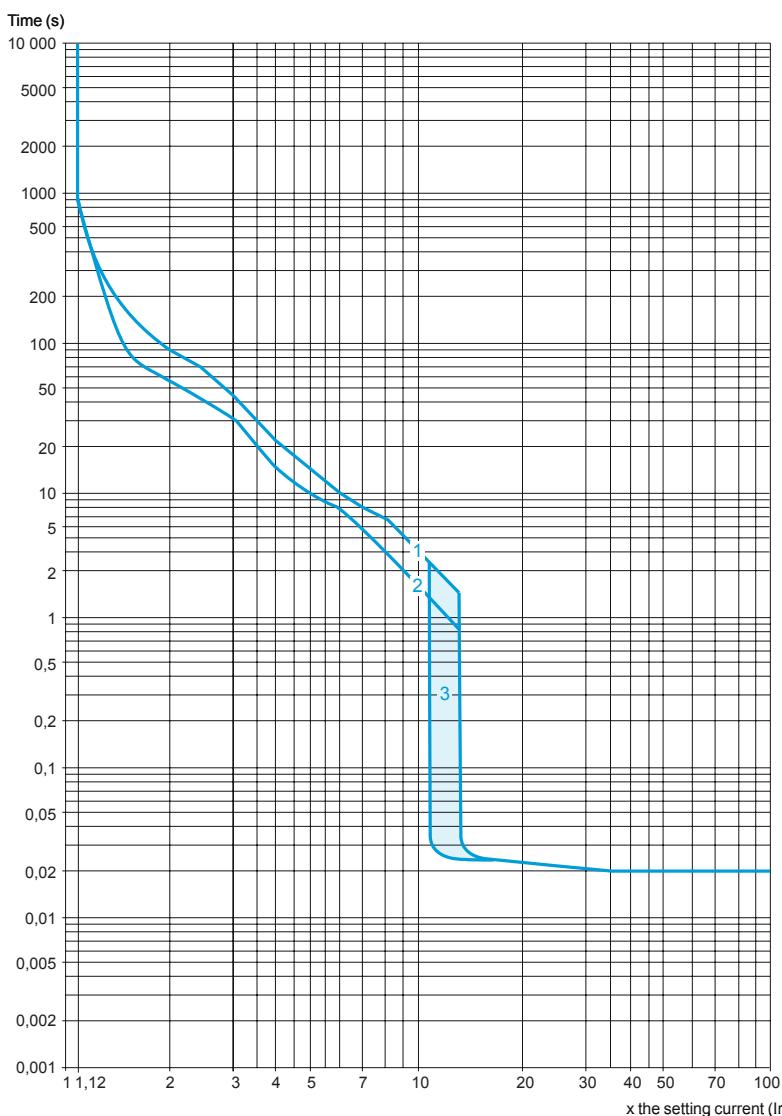

1 Cold state curve

2 Cold state curve

3 12...14 I_r

In the event of total phase failure, tripping occurs after 4 s ± 20 %


Current limitation on short-circuit (3-phase 400/415 V)

Dynamic stress

$I_{peak} = f(I_{prospective\ Isc})$


For GV7 RE only

Limited peak current (kA)

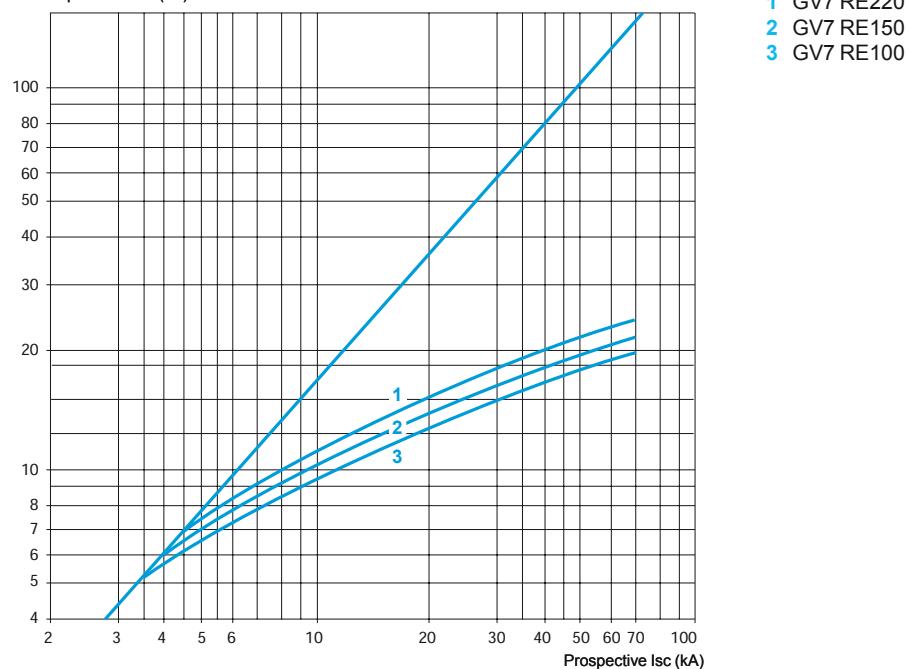

For GV7 RS only

Limited peak current (kA)

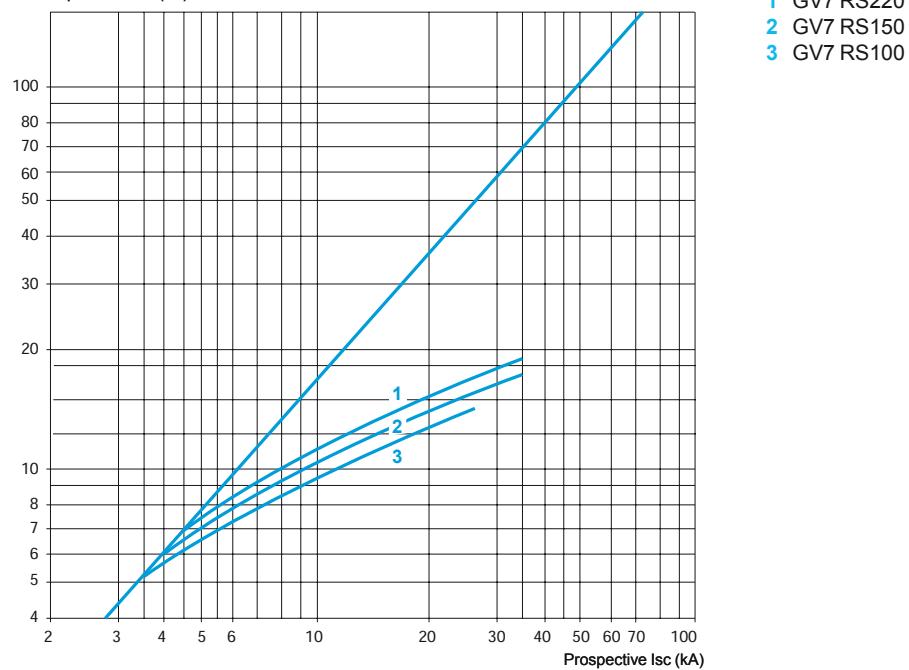


Thermal limit (3-phase 400/415 V)

Thermal limit


Sum of $I^2dt = f$ (prospective I_{sc})

For GV7 RE only

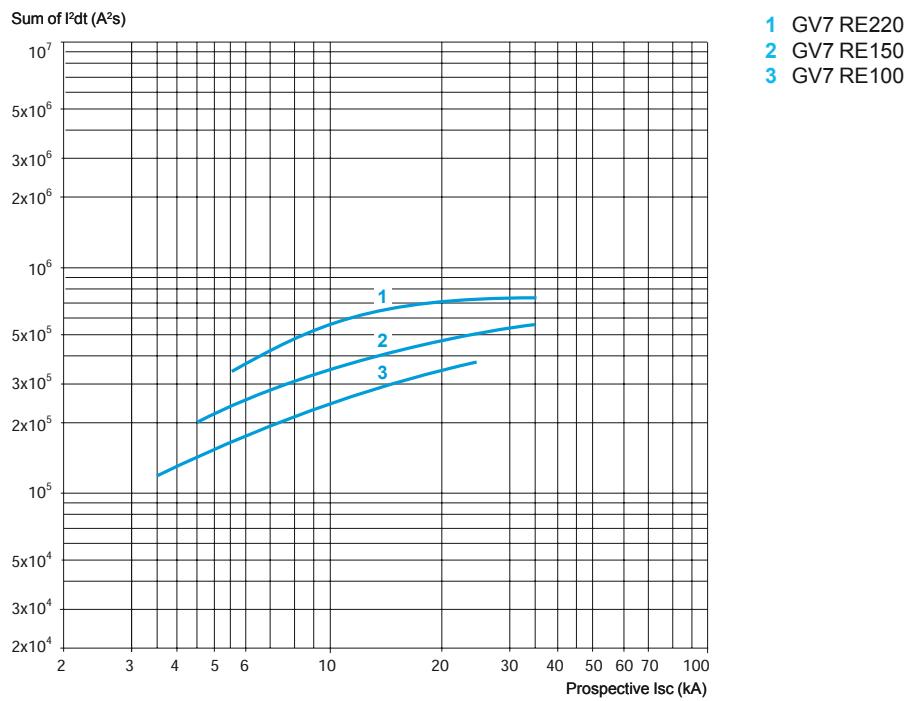

3

For GV7 RS only

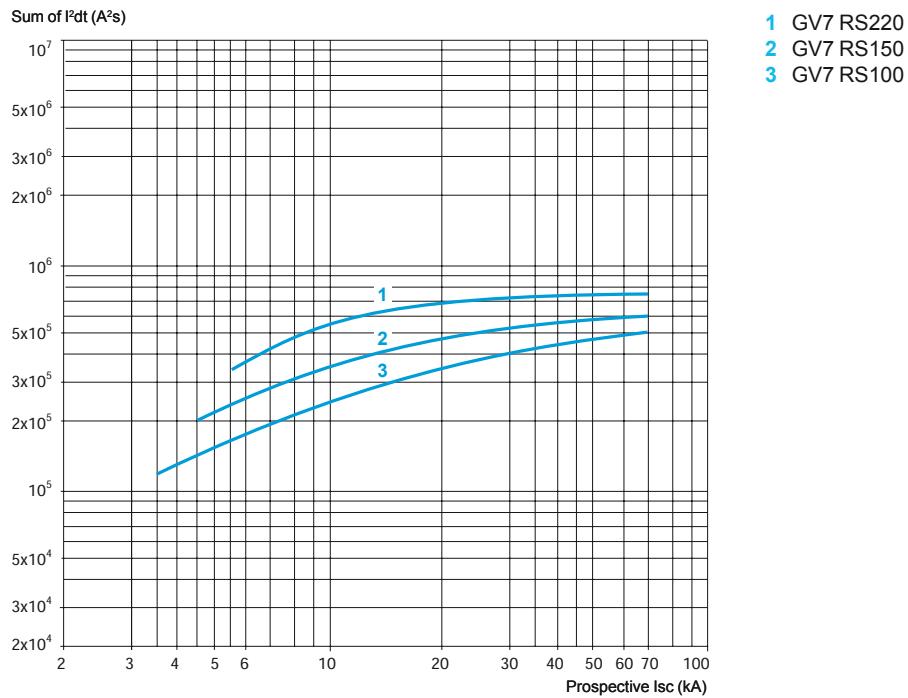


Current limitation on short-circuit (3-phase 690 V)


Dynamic stress

$I_{peak} = f(I_{prospective\ Isc})$

For GV7 RE only

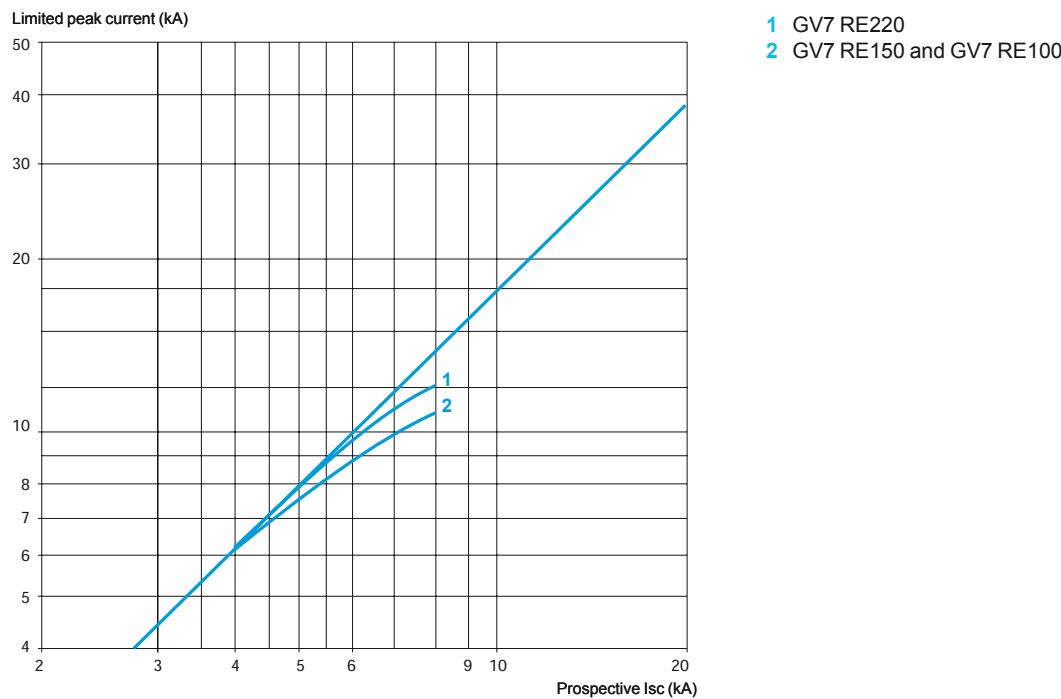

For GV7 RS only

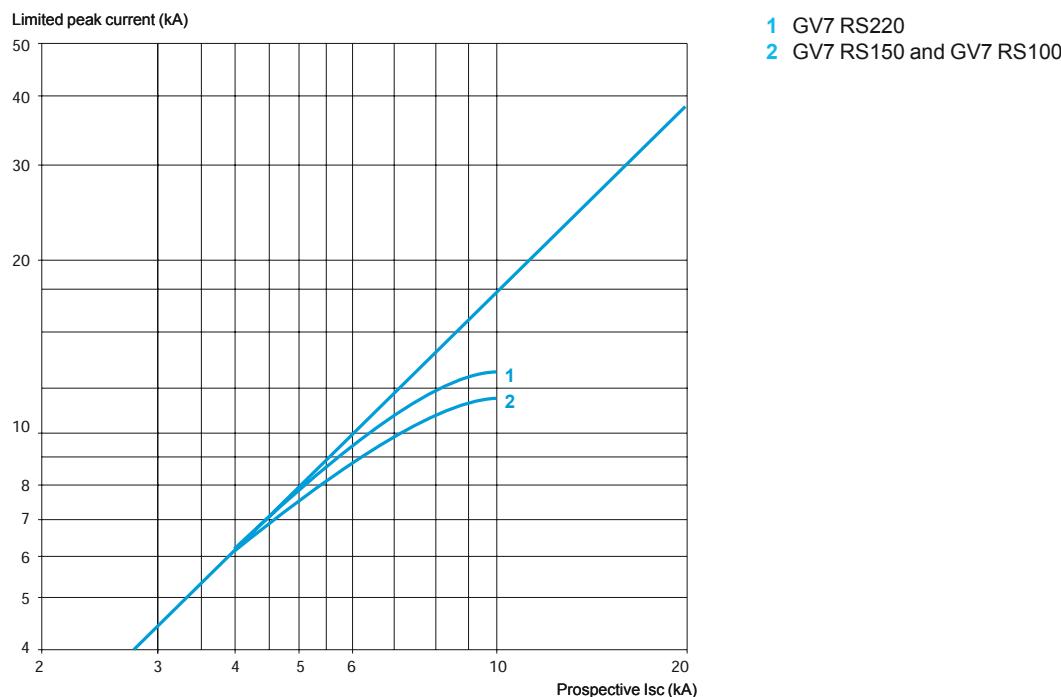


Thermal limit on short-circuit (3-phase 690 V)

Thermal limit


Sum of $I^2dt = f$ (prospective Isc)

For GV7 RE only

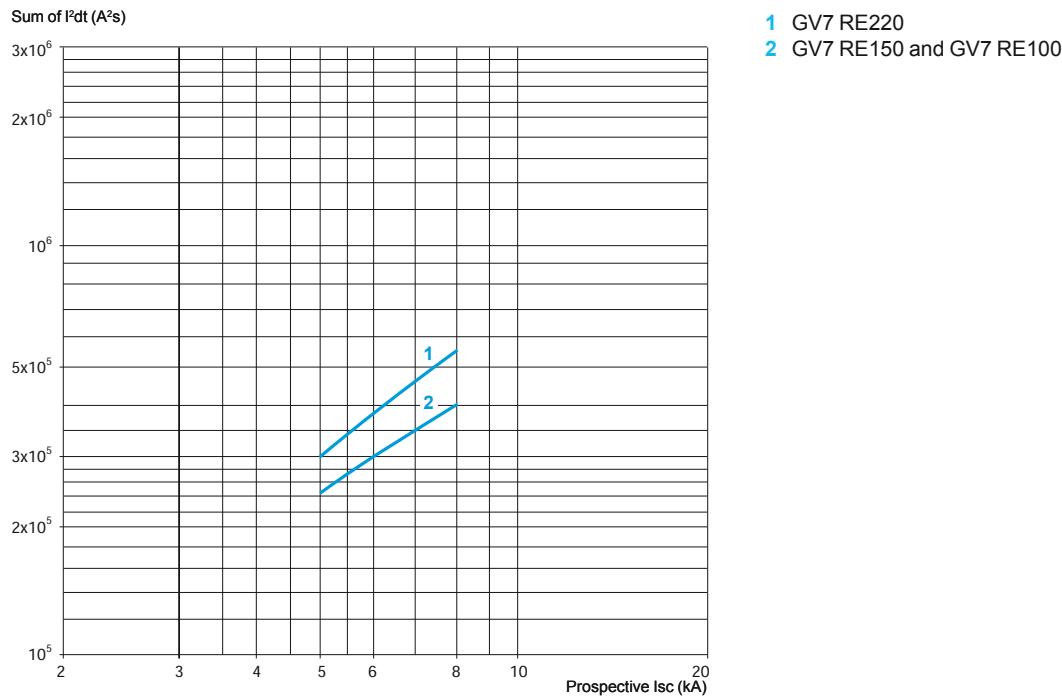


3

For GV7 RS only

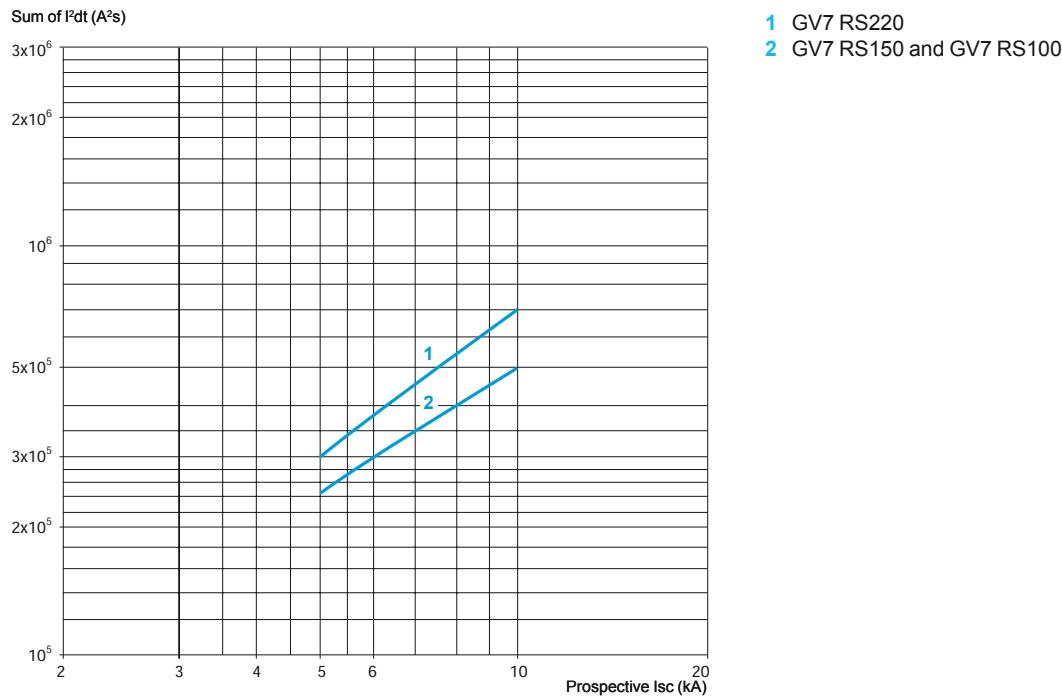


Thermal-magnetic tripping curves for GV2 RT

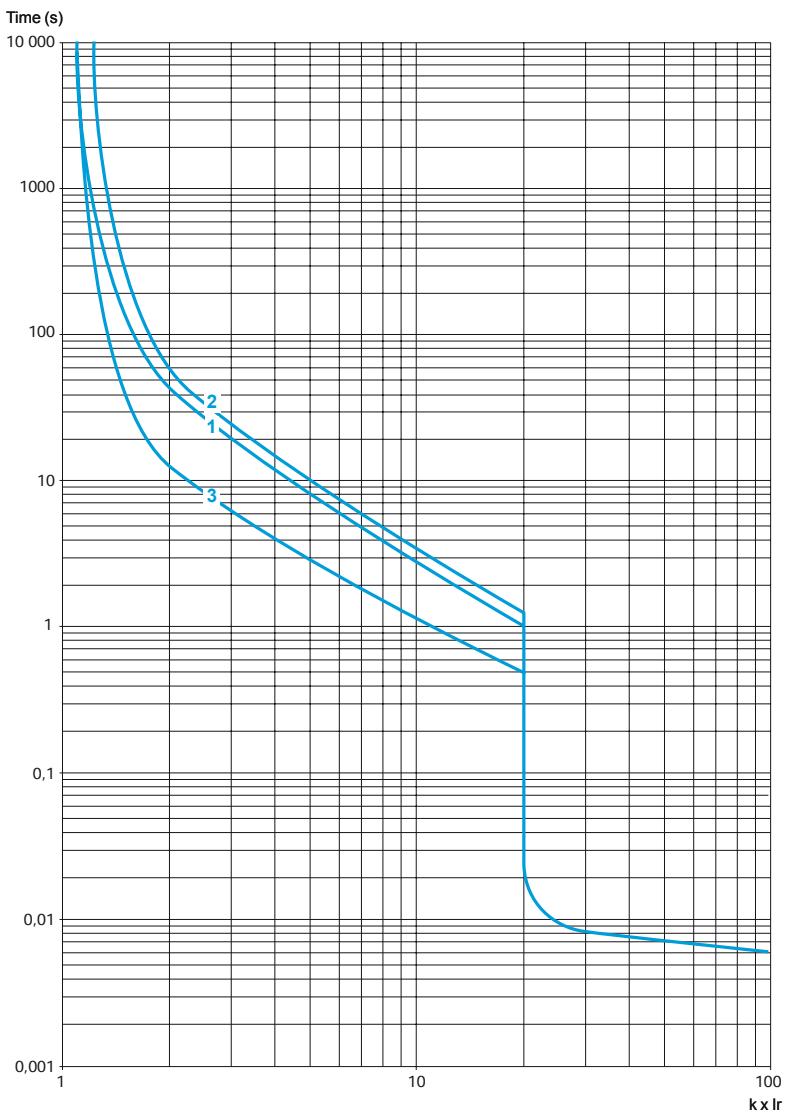

- 1 3 poles from cold state
- 2 2 poles from cold state
- 3 3 poles from hot state

Tripping curves for GV2 L or LE combined with thermal overload relay LRD or LR2 K

Average operating times at 20 °C related to multiples of the setting current

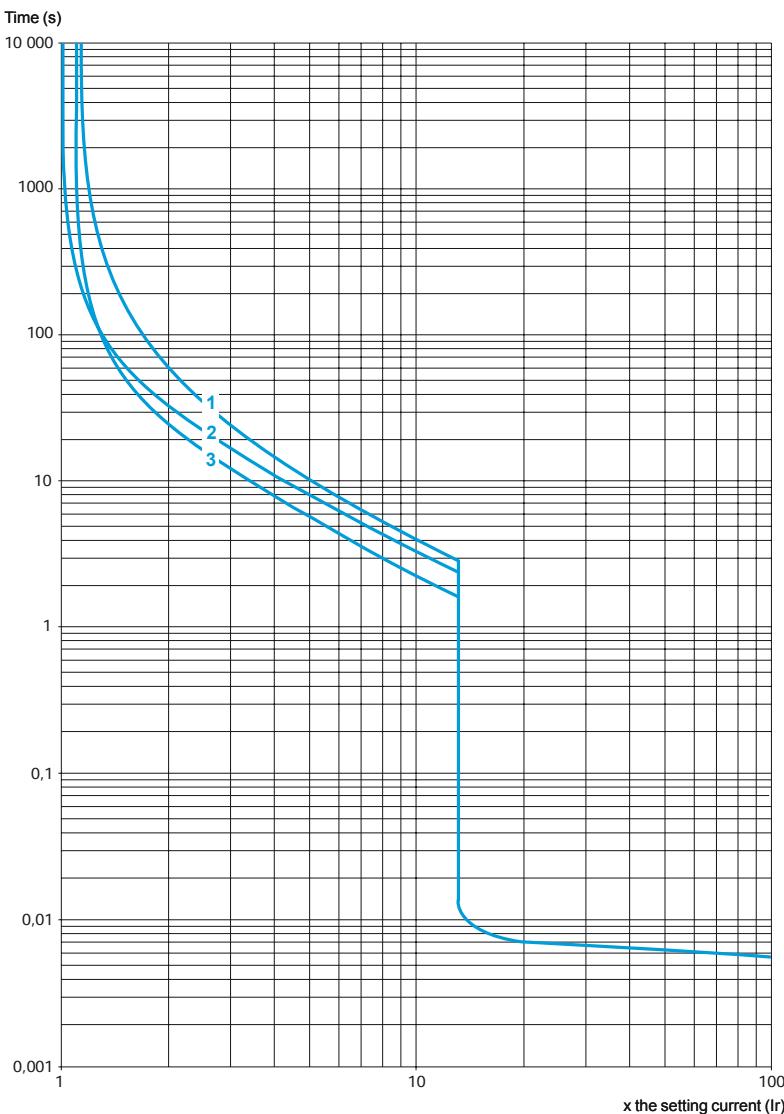
**1** 3 poles from cold state**2** 2 poles from cold state**3** 3 poles from hot state

Current limitation on short-circuit for GV2 L and GV2 LE only (3-phase 400/415 V)

Dynamic stress

I peak = f (prospective Isc) at 1.05 Ue = 435 V

Limited peak current (kA)

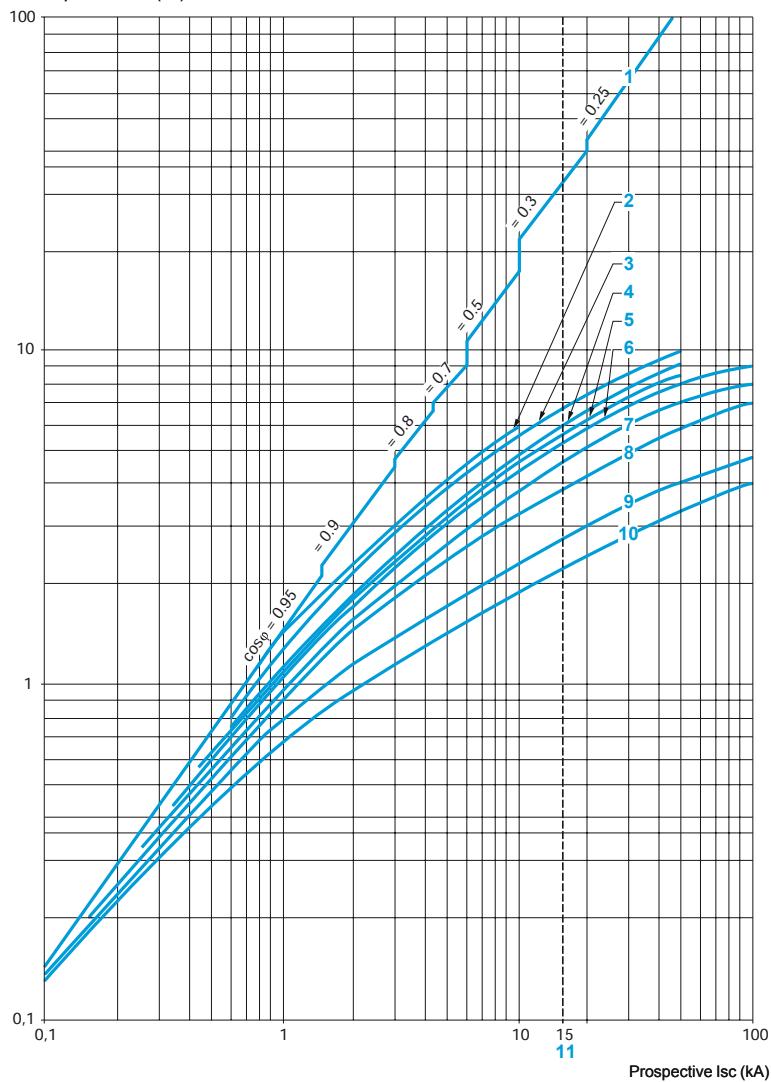

1 Maximum peak current

2 32 A

3 25 A

4 18 A

5 14 A

6 10 A

7 6.3 A

8 4 A

9 2.5 A

10 1.6 A


11 Limit of rated ultimate breaking capacity on short-circuit of GV2 LE (14, 18, 23 and 25 A ratings).

Current limitation on short-circuit for GV2 L and GV2 LE + thermal overload relay LRD or LR2 K (3-phase 400/415 V)

Dynamic stress

I peak = f (prospective Isc) at 1.05 Ue = 435 V

Limited peak current (kA)

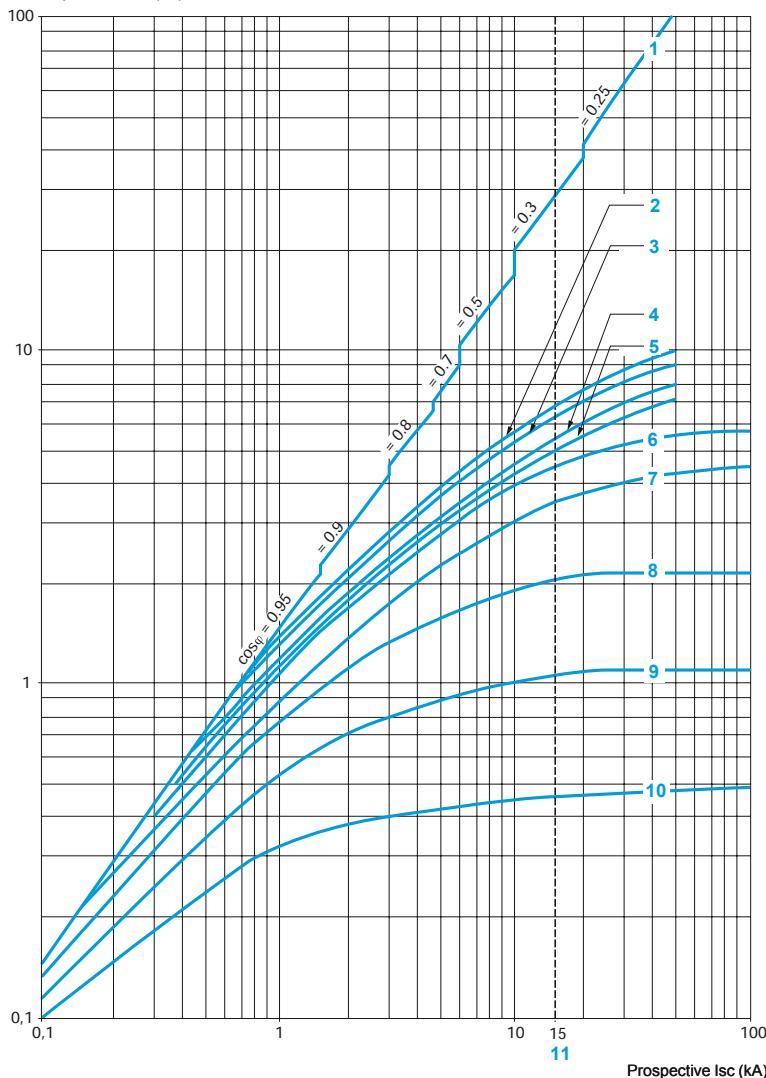

1 Maximum peak current

2 32 A

3 25 A

4 18 A

5 14 A

6 10 A

7 6.3 A

8 4 A

9 2.5 A


10 1.6 A

11 Limit of rated ultimate breaking capacity on short-circuit of GV2 LE (14, 18, 23 and 25 A ratings).

Thermal limit on short-circuit for GV2 LE only

Thermal limit in kA²s in the magnetic operating zone

Sum of $I^2dt = f$ (prospective Isc) at 1.05 Ue = 435 V

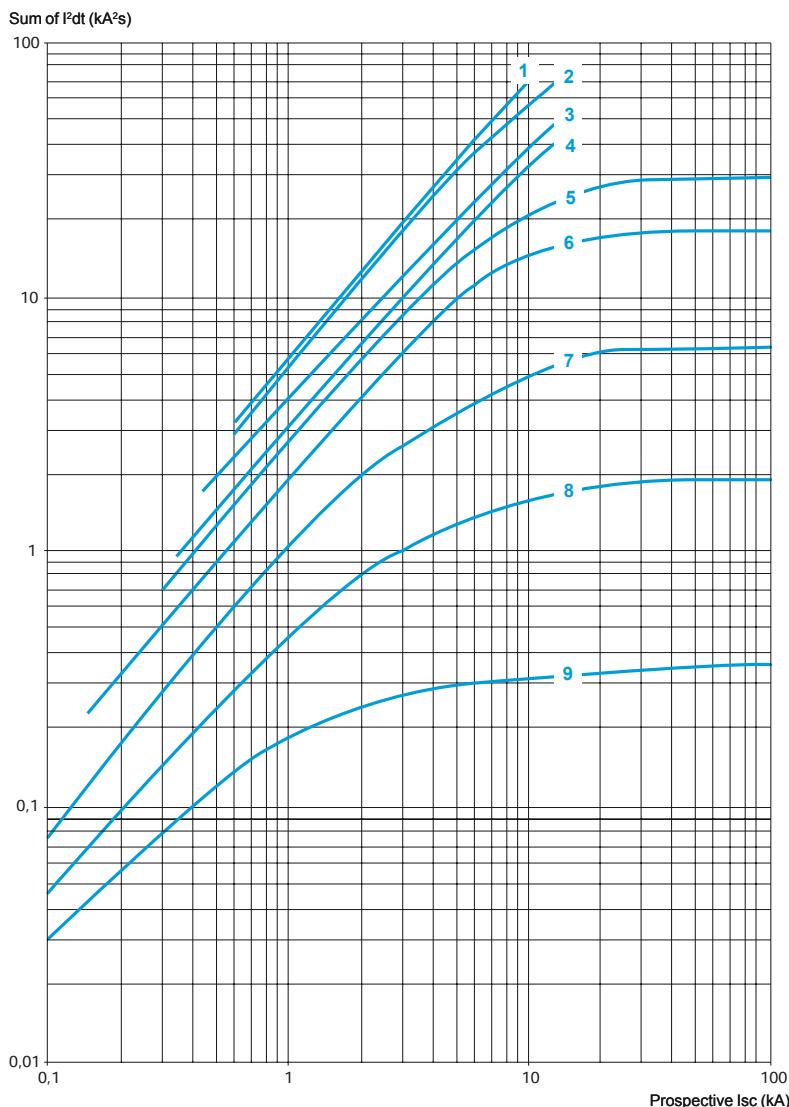


- 1 32 A
- 2 25 A
- 3 18 A
- 4 14 A
- 5 10 A
- 6 6.3 A
- 7 4 A
- 8 2.5 A
- 9 1.6 A

Thermal limit on short-circuit for GV2 L only

Thermal limit in kA²s in the magnetic operating zone

Sum of $I^2dt = f$ (prospective Isc) at 1.05 Ue = 435 V

Sum of I^2dt (kA²s)

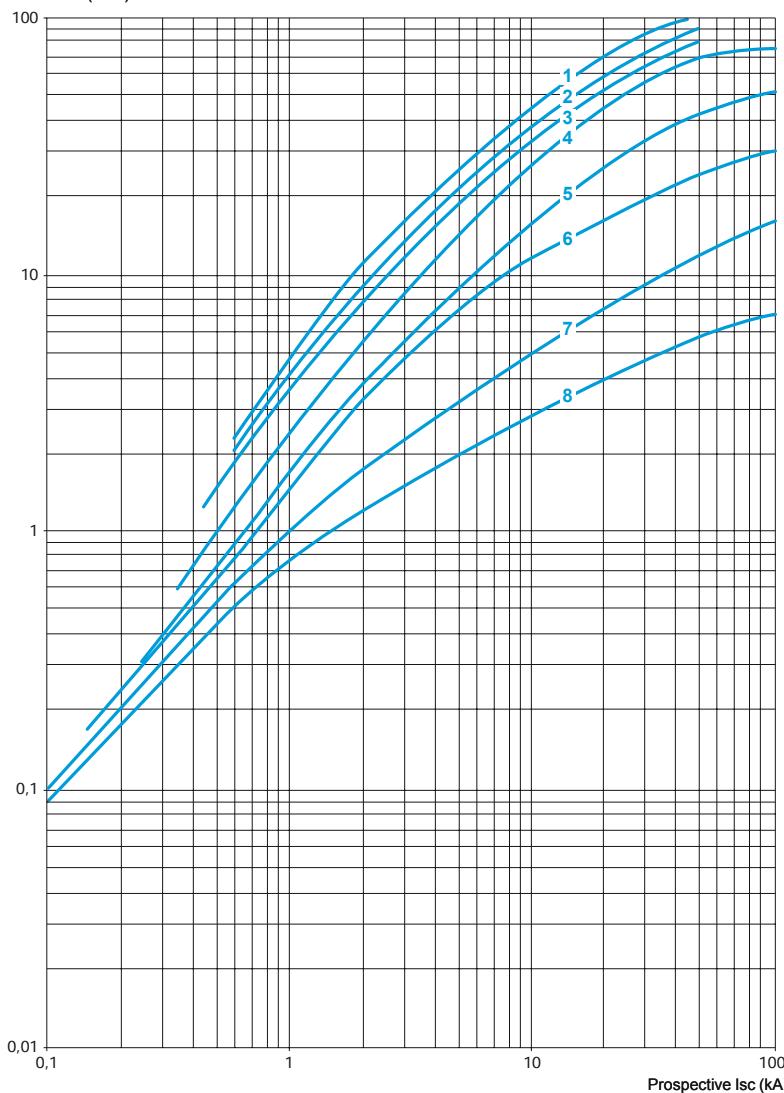

1 25 A and 32 A

2 18 A

3 14 A

4 10 A

5 6.3 A

6 4 A


7 2.5 A

8 1.6 A

Thermal limit on short-circuit for GV2 L and GV2 LE + thermal overload relay LRD or LR2 K

Thermal limit in kA²s in the magnetic operating zone


Sum of $I^2dt = f$ (prospective Isc) at 1.05 Ue = 435 V

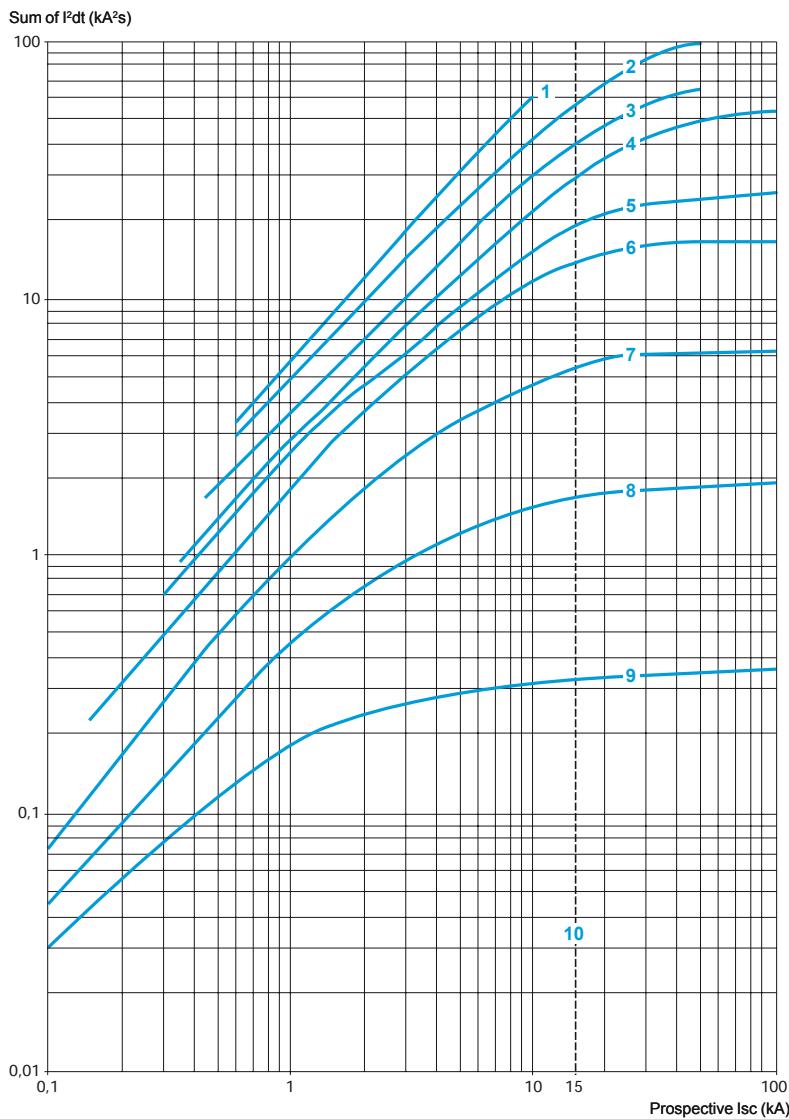

- 1 32 A (GV2 LE32)
- 2 25 A and 32 A (GV2 L32)
- 3 18 A
- 4 14 A
- 5 10 A
- 6 6.3 A
- 7 4 A
- 8 2.5 A
- 9 1.6 A
- 10 Limit of rated ultimate breaking capacity on short-circuit of GV2 LE (14, 18, 23 and 25 A ratings).

Tripping curves for GV3 L and GK3 EF80 combined with thermal overload relay LRD 33

Average operating time at 20 °C without prior current flow

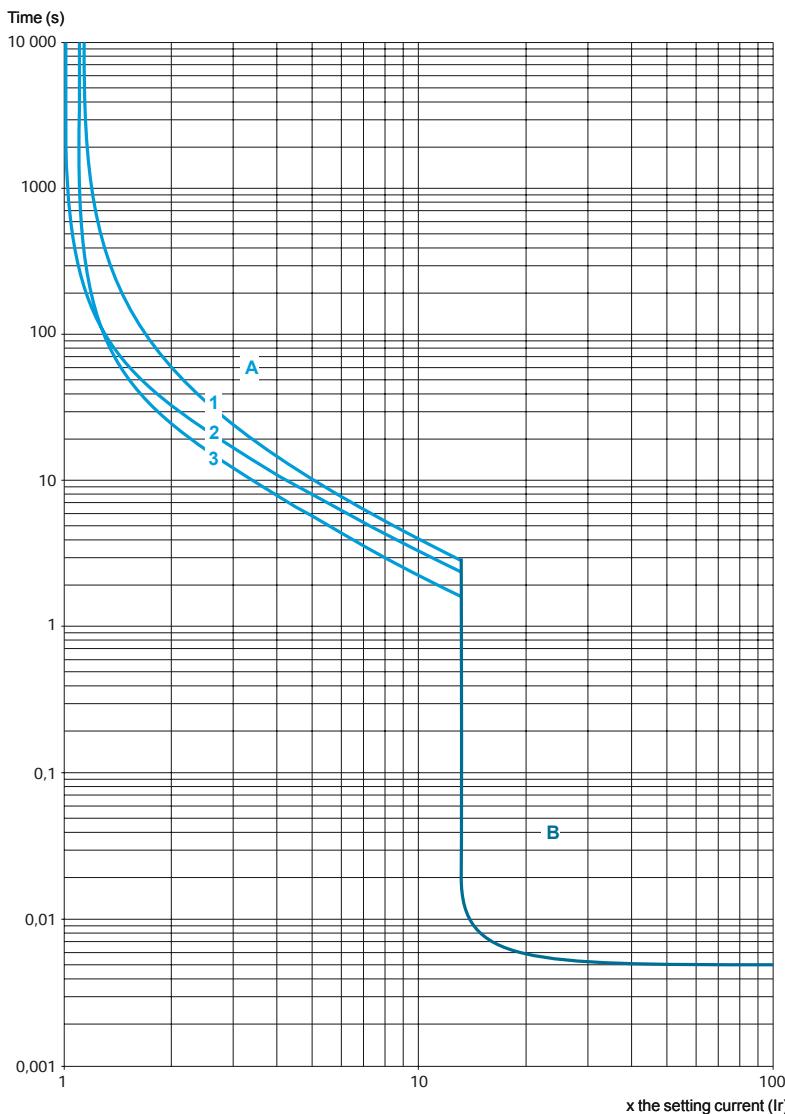

1 3 poles from cold state

2 2 poles from cold state

3 3 poles from hot state

A Thermal overload relay protection zone


B GK3 EF80 and GV3 L protection zone

Current limitation on short-circuit for GV3 L and GK3 EF80 (3-phase 400/415 V)

Dynamic stress

$I_{peak} = f(I_{sc})$ at 1.05 $U_e = 435$ V

Limited peak current (kA)

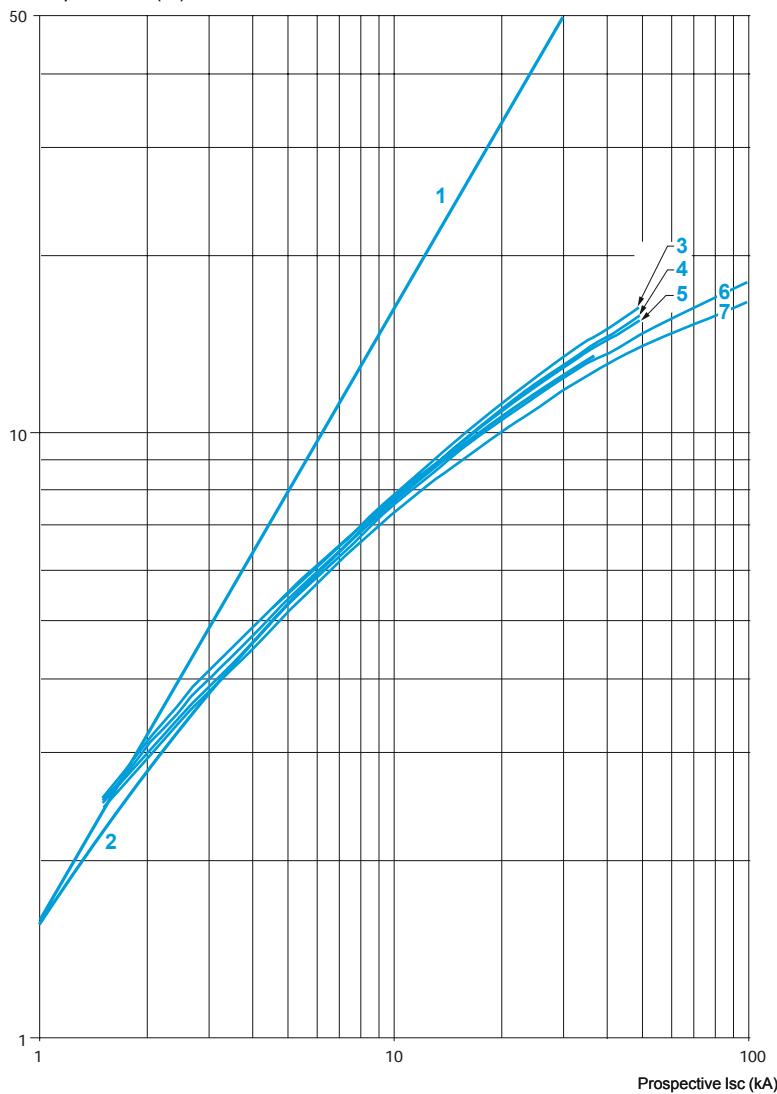


- 1 Maximum peak current
- 2 GK3 EF80
- 3 GV3 L65
- 4 GV3 L50
- 5 GV3 L40
- 6 GV3 L32
- 7 GV3 L25

Thermal limit on short-circuit for GV3 L and GK3 EF80

Thermal limit in A²s

Sum of $I^2dt = f$ (prospective Isc) at 1.05 Ue = 435 V

Sum of I^2dt (A²s)

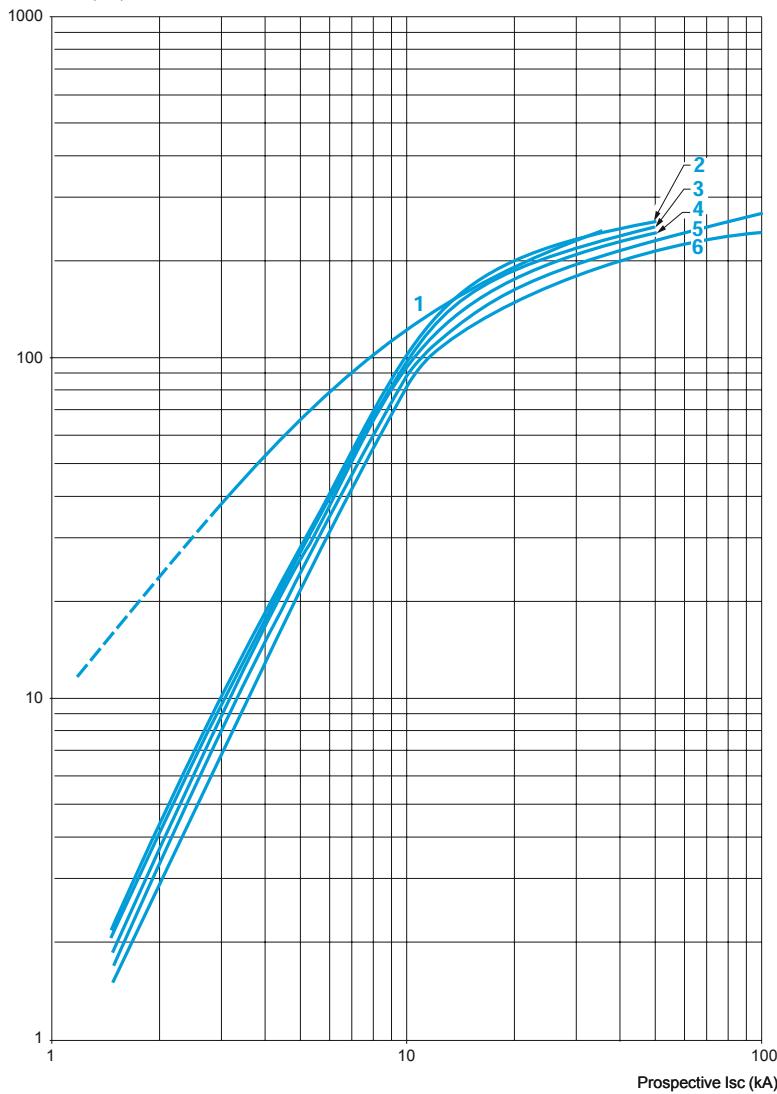

- 1 GK3 EF80
- 2 GV3 L65
- 3 GV3 L50
- 4 GV3 L40
- 5 GV3 L32
- 6 GV3 L25



GV2 ME10

Motor circuit-breakers from 0.06 to 15 kW / 400 V, with screw clamp terminals

GV2 ME with pushbutton control

Standard power ratings of 3-phase motors 50/60 Hz in category AC-3									Setting range of thermal trips	Magnetic tripping current $I_d \pm 20\%$	Reference	Weight
400/415 V			500 V			690 V						
P	Icu	Ics (1)	P	Icu	Ics (1)	P	Icu	Ics (1)	(2)	A	A	kg
kW	kA	%	kW	kA	%	kW	kA	%	A	A		
—	—	—	—	—	—	—	—	—	0.1...0.16	1.5	GV2 ME01	0.260
0.06	★	★	—	—	—	—	—	—	0.16...0.25	2.4	GV2 ME02	0.260
0.09	★	★	—	—	—	—	—	—	0.25...0.40	5	GV2 ME03	0.260
0.12	★	★	—	—	—	0.37	★	★	0.40...0.63	8	GV2 ME04	0.260
0.18	★	★	—	—	—	—	—	—	—	—	GV2 ME05	0.260
0.25	★	★	—	—	—	0.55	★	★	0.63...1	13	GV2 ME06	0.260
0.37	★	★	0.37	★	★	—	—	—	1...16	22.5	GV2 ME07	0.260
0.55	★	★	0.55	★	★	0.75	★	★	—	—	GV2 ME08	0.260
—	—	—	0.75	★	★	1.1	★	★	—	—	GV2 ME09	0.260
0.75	★	★	1.1	★	★	1.5	3	75	1.6...2.5	33.5	GV2 ME10	0.260
1.1	★	★	1.5	★	★	2.2	3	75	2.5...4	51	GV2 ME11	0.260
1.5	★	★	2.2	★	★	3	3	75	—	—	GV2 ME12	0.260
2.2	★	★	3	50	100	4	3	75	4...6.3	78	GV2 ME13	0.260
3	★	★	4	10	100	5.5	3	75	6...10	138	GV2 ME14	0.260
4	★	★	5.5	10	100	7.5	3	75	—	—	GV2 ME15	0.260
5.5	15	50	7.5	6	75	9	3	75	9...14	170	GV2 ME16	0.260
—	—	—	—	—	—	11	3	75	—	—	GV2 ME17	0.260
7.5	15	50	9	6	75	15	3	75	13...18	223	GV2 ME18	0.260
9	15	40	11	4	75	18.5	3	75	17...23	327	GV2 ME19	0.260
11	15	40	15	4	75	—	—	—	20...25	327	GV2 ME20	0.260
15	10	50	18.5	4	75	22	3	75	24...32	416	GV2 ME21	0.260

Motor circuit-breakers from 0.06 to 15 kW / 400 V, with lugs

To order thermal magnetic circuit-breakers with connection by lugs, add the digit **6** to the end of reference selected above.

Example: **GV2 ME08** becomes **GV2 ME086**.

Thermal magnetic circuit-breakers GV2 ME with built-in auxiliary contact block

With instantaneous auxiliary contact block (composition, see page 3/55):

- GV AE1, add suffix **AE1TQ** to the motor circuit-breaker reference selected above.

Example: **GV2 ME01AE1TQ**.

- GV AE11, add suffix **AE11TQ** to the motor circuit-breaker reference selected above.

Example: **GV2 ME01AE11TQ**.

- GV AN11, add suffix **AN11TQ** to the motor circuit-breaker reference selected above.

Example: **GV2 ME01AN11TQ**.

These circuit-breakers with built-in contact block are sold in lots of 20 units in a single pack.

(1) As % of Icu.

(2) The thermal trip setting must be within the range marked on the graduated knob.

(3) Maximum rating which can be mounted in enclosures **GV2 MC** or **MP**, please consult your Regional Sales Office.

* > 100 kA.

Motor circuit-breakers from 0.06 to 11 kW, with spring terminal connections

GV2 ME (1) with pushbutton control

Standard power ratings of 3-phase motors 50/60 Hz in category AC-3


400/415 V						500 V			Setting range of thermal trips (3)	Magnetic tripping current Id ± 20 %	Reference	Weight
P	Icu	Ics (2)	P	Icu	Ics (2)	A	A					
kW	kA	%	kW	kA	%			kg				
-	-	-	-	-	-	0.1...0.16	1.5	GV2 ME013	0.280			
0.06	★	★	-	-	-	0.16...0.25	2.4	GV2 ME023	0.280			
0.09	★	★	-	-	-	0.25...0.40	5	GV2 ME033	0.280			
0.12	★	★	-	-	-	0.40...0.63	8	GV2 ME043	0.280			
0.18	★	★										
0.25	★	★	0.37	★	★	0.63...1	13	GV2 ME053	0.280			
0.37	★	★	0.37	★	★	1...1.6	22.5	GV2 ME063	0.280			
0.55	★	★	0.55	★	★							
			0.75	★	★	1.6...2.5	33.5	GV2 ME073	0.280			
0.75	★	★	1.1	★	★							
1.1	★	★	1.5	★	★	2.5...4	51	GV2 ME083	0.280			
1.5	★	★	2.2	★	★							
2.2	★	★	3	50	100	4...6.3	78	GV2 ME103	0.280			
3	★	★	4	10	100	6...10	138	GV2 ME143	0.280			
4	★	★	5.5	10	100							
5.5	15	50	7.5	6	75	9...14	170	GV2 ME163	0.280			
7.5	15	50	9	6	75	13...18	223	GV2 ME203	0.280			
9	15	40	11	4	75	17...23	327	GV2 ME213	0.260			
11	15	40	15	4	75	20...25	327	GV2 ME223	0.260			
Contact blocks												
Description			Mounting			Maximum number	Type of contacts	Sold in lots of	Unit reference	Weight kg		
Instantaneous auxiliary contacts			Front			1	N/O + N/C	10	GV AE113	0.030		
			LH side			2	N/O + N/O	10	GV AE203	0.030		
Accessory			Application							Weight kg		
			Cable end reducer			For connection of conductors from 1 to 1.5 mm ²		20	LA9 D99	-		

(1) For connection of conductors from 1 to 1.5 mm², the use of an LA9 D99 cable end reducer is recommended.

(2) Maximum rating which can be mounted in enclosures GV2 MC or MP, please consult your Regional Sales Office

(3) The thermal trip setting must be within the range marked on the graduated knob.

★ > 100 kA.

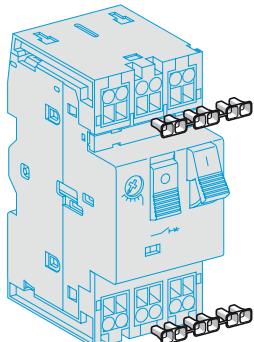

526137



GV2 P10

3

526140



GV3 P65

526140



GV3 P651

Motor circuit-breakers from 0.06 to 30 kW / 400 V												Reference	Weight			
Standard power ratings of 3-phase motors 50/60 Hz in category AC-3						Setting range of thermal trips			Magnetic tripping current Id ± 20 %							
400/415 V			500 V			P	Icu	Ics (1)	P	Icu	Ics (1)	P	Icu	Ics (1)	(2)	kg
kW	kA	%	kW	kA	%	kW	kA	%	A	A	A	A	A	A		kg
GV2 P: control by rotary knob																
Screw clamp terminals																
—	—	—	—	—	—	—	—	—	0.1...	0.16	1.5	GV2 P01	0.350			
0.06	★	★	—	—	—	—	—	—	0.16...	0.25	2.4	GV2 P02	0.350			
0.09	★	★	—	—	—	—	—	—	0.25...	0.40	5	GV2 P03	0.350			
0.12	★	★	—	—	—	0.37	★	★	0.40...	0.63	8	GV2 P04	0.350			
0.18	★	★	—	—	—	—	—	—				GV2 P05	0.350			
0.25	★	★	—	—	—	0.55	★	★	0.63...	1	13	GV2 P06	0.350			
0.37	★	★	0.37	★	★	—	—	—	1...	1.6	22.5	GV2 P07	0.350			
0.55	★	★	0.55	★	★	0.75	★	★				GV2 P08	0.350			
0.75	★	★	1.1	★	★	1.5	8	100	1.6...	2.5	33.5	GV2 P10	0.350			
1.1	★	★	1.5	★	★	2.2	8	100	2.5...	4	51	GV2 P14	0.350			
2.2	★	★	3	★	★	4	6	100	4...	6.3	78	GV2 P16	0.350			
3	★	★	5	50	100	5.5	6	100	6...	10	138	GV2 P20	0.350			
5.5	★	★	7.5	42	75	9	6	100	9...	14	170	GV2 P21	0.350			
7.5	50	50	9	10	75	15	4	100	13...	18	223	GV2 P22	0.350			
9	50	50	11	10	75	18.5	4	100	17...	23	327	GV2 P32	0.350			
11	50	50	15	10	75	—	—	—	20...	25	416	GV2 P33	0.350			
15	35	50	18.5	10	75	22	4	100	24...	32		GV3 P13	0.960			
5.5	100	100	7.5	12	50	11	6	50	9...	13	182	GV3 P18	0.960			
7.5	100	100	9	12	50	15	6	50	12...	18	252	GV3 P25	0.960			
11	100	100	15	12	50	18.5	6	50	17...	25	350	GV3 P32	0.960			
15	100	100	18.5	12	50	22	6	50	23...	32	448	GV3 P40	0.960			
18.5	50	100	22	12	50	37	6	50	30...	40	560	GV3 P50	0.960			
22	50	100	30	12	50	45	6	50	37...	50	700	GV3 P65	0.960			
30	50	100	45	12	50	55	6	50	48...	65	910					
GV3 P: control by rotary knob																
Connection by EverLink® BTR screw connectors (3)																
5.5	100	100	7.5	12	50	11	6	50	9...	13	182	GV3 P13	0.960			
7.5	100	100	9	12	50	15	6	50	12...	18	252	GV3 P18	0.960			
11	100	100	15	12	50	18.5	6	50	17...	25	350	GV3 P25	0.960			
15	100	100	18.5	12	50	22	6	50	23...	32	448	GV3 P32	0.960			
18.5	50	100	22	12	50	37	6	50	30...	40	560	GV3 P40	0.960			
22	50	100	30	12	50	45	6	50	37...	50	700	GV3 P50	0.960			
30	50	100	45	12	50	55	6	50	48...	65	910	GV3 P65	0.960			
Connection by EverLink® BTR screw connectors, for assembly with a contactor																
To assemble a GV3 P13 to P65 circuit-breaker with an LC1 D40A to D65A contactor, it is possible to use the circuit-breaker supplied without downstream EverLink® power terminal block. To order this product, add the digit 1 to the end of the references selected above. Example: GV3 P65 becomes GV3 P651.																
Connection by lugs																
To order thermal magnetic circuit-breakers with connection by lugs, add the digit 6 to the end of reference selected above. Example: GV3 P18 becomes GV3 P186.																
GV3 ME80: pushbutton control, screw clamp terminals												GV3 ME80 (4)	0.700			
Motor circuit-breakers up to 50 hp / 600 V, UL 508 type E																
GV2 (5)																
To obtain a GV2 P motor circuit-breaker, UL 508 type E, combine:																
■ a circuit-breaker GV2 P•H7 (except 32 A),																
■ and a "Large Spacing" adapter GV2 GH7 .																
GV3 (6)																
To obtain a motor-circuit-breaker GV3 P, UL 508 type E, use the following with the circuit-breaker:																
■ a "Large Spacing" cover GV3 G66 ,																
■ a short-circuit signalling contact GV AM11 .																
GV3 with connection by lugs (6)																
To obtain a motor-circuit-breaker GV3 P, UL 508 type E, with connection by lugs, add the digit 6 to the end of reference selected above and use the following with the circuit-breaker:																
■ two IP 20 covers LAD 96570 ,																
■ a short-circuit signalling contact GV AM11 .																
(1) As % of Icu.																
(2) The thermal trip setting must be within the range marked on the graduated knob.																
(3) BTR screws: hexagon socket head. Require use of an insulated Allen key, in compliance with local wiring regulations.																
(4) Recommended for use in association with a contactor.																
(5) Accessory: see page 3/67.																
(6) Accessories: see page 3/57.																
★ > 100 kA.																

526138



GV7 RE40

526141



GV7 RS220

3

Thermal-magnetic circuit-breakers GV7 R with screw clamp terminals

Control by rocker lever

Standard power ratings of 3-phase motors 50/60 Hz in category AC-3										Setting range of thermal trips	Reference	Weight
400/415 V			500 V			660/690 V						
P	Icu	Ics (1)	P	Icu	Ics (1)	P	Icu	Ics (1)	A			kg
7.5	36	100	9	18	100	11	8	100	12...20	GV7 RE20	2.010	
9	36	100	11	18	100	15	8	100	12...20	GV7 RS20	2.010	
7.5	70	100	9	50	100	11	10	100	12...20	GV7 RE25	2.010	
9	70	100	11	50	100	15	8	100	15...25	GV7 RS25	2.010	
9	36	100	11	18	100	15	10	100	15...25	GV7 RE40	2.010	
11	36	100	15	18	100	18.5	8	100	18.5	GV7 RS40	2.010	
18.5	36	100	18.5	18	100	22	8	100	25...40	GV7 RE50	2.015	
18.5	70	100	18.5	50	100	22	10	100	25...40	GV7 RS50	2.015	
22	36	100	30	18	100	30	8	100	30...50	GV7 RE80	2.040	
22	70	100	30	50	100	30	10	100	30...50	GV7 RS80	2.040	
37	36	100	45	18	100	55	8	100	48...80	GV7 RE100	2.040	
37	70	100	45	50	100	55	10	100	48...80	GV7 RS100	2.040	
45	36	100	—	18	100	75	8	100	60...100	GV7 RE150	2.020	
45	70	100	—	50	100	75	10	100	60...100	GV7 RS150	2.020	
55	35	100	75	30	100	90	8	100	90...150	GV7 RE220	2.350	
75	35	100	90	30	100	110	8	100	90...150	GV7 RS220	2.350	
90	35	100	110	30	100	160	8	100	132...220	GV7 RE220	2.350	
110	35	100	132	30	100	200	8	100	132...220	GV7 RS220	2.350	
90	70	100	110	50	100	160	10	100	132...220	GV7 RE220	2.350	
110	70	100	132	50	100	200	10	100	132...220	GV7 RS220	2.350	
90	70	100	160	50	100	160	10	100	132...220	GV7 RE220	2.350	

(1) As % of Icu

520142



GV2 RT

3

For motors with high current peak on starting								
Control by rocker lever								
Standard power ratings of 3-phase motors 50/60 Hz in category AC-3					Setting range of thermal trips (1)	Magnetic tripping current Id ± 20 %	Reference	Weight
220/ 230 V	400/ 415 V	440 V	500 V	690 V	A	A		kg
kW	kW	kW	kW	kW	A	A		kg
0.06	0.09	0.09 0.12	—	—	0.25...0.40	8	GV2 RT03	0.350
—	0.12 0.18	0.18	—	0.37	0.40...0.63	13	GV2 RT04	0.350
0.09 0.12	0.25 0.37	0.25 0.37	0.37	0.55	0.63...1	22	GV2 RT05	0.350
0.18 0.25	0.37 0.55	0.37 0.55	0.37 0.55 0.75	0.75 1.1	1...1.6	33	GV2 RT06	0.350
0.37	0.75	0.75 1.1	1.1	1.5	1.6...2.5	51	GV2 RT07	0.350
0.55 0.75	1.1 1.5	1.5 2.2	1.5 3	2.2 3	2.5...4	78	GV2 RT08	0.350
1.1	2.2	2.2 3	3	4	4...6.3	138	GV2 RT10	0.350
1.5 2.2	3 4	4	4 5.5	5.5 7.5	6...10	200	GV2 RT14	0.350
2.2 3	5.5	5.5 7.5	7.5	9 11	9...14	280	GV2 RT16	0.350
4	7.5	7.5 9	9	15	13...18	400	GV2 RT20	0.350
5.5	9 11	11	11	18.5	17...23	400	GV2 RT21	0.350

(1) The thermal trip setting must be within the range marked on the graduated knob.

528142



GV2 RT

For primaries of 3-phase transformers								
Control by rocker lever						Magnetic tripping current $I_d \pm 20\%$	Reference	Weight kg
Standard power ratings				Setting range of thermal trips (1)				
230/240 V	400/415 V	440 V	500 V	690 V	A	A		
kW	kW	kW	kW	kW	A	A		kg
—	—	—	—	—	0.25...0.40	8	GV2 RT03	0.350
—	—	—	—	—	0.40...0.63	13	GV2 RT04	0.350
—	—	0.63	0.63	1	0.63...1	22	GV2 RT05	0.350
0.4	0.63	1	1	—	1...1.6	33	GV2 RT06	0.350
0.63	1	—	1.6	1.6 2	1.6...2.5	51	GV2 RT07	0.350
1	1.6 2	1.6 2	2 2.5	2.5	2.5...4	78	GV2 RT08	0.350
1.6 2	2.5 4	2.5 4	4	4 5 6.3	4...6.3	138	GV2 RT10	0.350
2.5	4 5	5	5 6.3	—	6...10	200	GV2 RT14	0.350
4	6.3	6.3	—	10 12.5	9...14	280	GV2 RT16	0.350
5 6.3	10	10	10 12.5	10	13...18	400	GV2 RT20	0.350

Accessory (2)		
Description	Reference	Weight kg
Padlockable external operator (IP 54) black handle, blue legend plate	GV2 AP03	0.280

(1) The thermal trip setting must be within the range marked on the graduated knob.

(2) Other accessories such as mounting, cabling and marking accessories are identical to those used for GV2 ME motor circuit-breakers, see page 3/57.



GV2 LE10

3

Magnetic motor circuit-breakers from 0.06 to 15 kW													
GV2 L: control by rocker lever, connection by screw clamp terminals													
Standard power ratings of 3-phase motors 50/60 Hz in category AC-3								Magnetic protection rating	Tripping current Id ± 20 %	Use in association with thermal overload relay	Reference	Weight	
400/415 V	500 V	690 V	P	Icu	Ics (1)	P	Icu	Ics (1)	P	Icu	Ics (1)		
kW	kA	kW	kW	kA	kW	kW	kA	A	A	A	kg		
0.06	*	*	-	-	-	-	-	-	0.4	5	LR2 K0302	GV2 LE03	0.330
0.09	*	*	-	-	-	-	-	-	0.4	5	LR2 K0304	GV2 LE03	0.330
0.12	*	*	-	-	-	0.37	*	*	0.63	8	LR2 K0304	GV2 LE04	0.330
0.18	*	*	-	-	-	-	-	-	0.63	8	LR2 K0305	GV2 LE04	0.330
-	-	-	-	-	-	0.55	*	*	1	13	LR2 K0305	GV2 LE05	0.330
0.25	*	*	-	-	-	-	-	-	1	13	LR2 K0306	GV2 LE05	0.330
-	-	-	-	-	-	0.75	*	*	1	13	LR2 K0306	GV2 LE05	0.330
0.37	*	*	0.37	*	*	-	-	-	1	13	LR2 K0306	GV2 LE05	0.330
0.55	*	*	0.55	*	*	1.1	*	*	1.6	22.5	LR2 K0307	GV2 LE06	0.330
-	-	-	0.75	*	*	-	-	-	1.6	22.5	LR2 K0307	GV2 LE06	0.330
0.75	*	*	1.1	*	*	1.5	3	75	2.5	33.5	LR2 K0308	GV2 LE07	0.330
1.1	*	*	-	-	-	-	-	-	2.5	33.5	LR2 K0308	GV2 LE07	0.330
1.5	*	*	1.5	*	*	3	3	75	4	51	LR2 K0310	GV2 LE08	0.330
-	-	-	2.2	*	*	-	-	-	4	51	LR2 K0312	GV2 LE08	0.330
2.2	*	*	3	50	100	4	3	75	6.3	78	LR2 K0312	GV2 LE10	0.330
3	*	*	4	10	100	5.5	3	75	10	138	LR2 K0314	GV2 LE14	0.330
4	*	*	5.5	10	100	-	-	-	10	138	LR2 K0316	GV2 LE14	0.330
-	-	-	-	-	-	7.5	3	75	10	138	LRD 14	GV2 LE14	0.330
-	-	-	-	-	-	9	3	75	14	170	LRD 16	GV2 LE16	0.330
5.5	15	50	7.5	6	75	11	3	75	14	170	LR2 K0321	GV2 LE16	0.330
7.5	15	50	9	6	75	15	3	75	18	223	LRD 21	GV2 LE20	0.330
9	15	40	11	4	75	18.5	3	75	25	327	LRD 22	GV2 LE22	0.330
11	15	40	15	4	75	-	-	-	25	327	LRD 22	GV2 LE22	0.330
15	10	50	18.5	4	75	22	3	75	32	416	LRD 32	GV2 LE32	0.330

(1) As % of Icu.
★ > 100 kA.

TeSys protection components


Magnetic motor circuit-breakers GV2 L, GV3 L and GK3 EF80



GV2 L10



GV3 L65

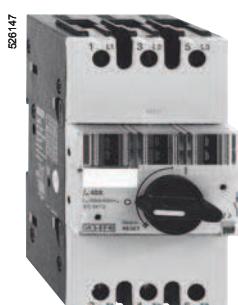

GK3 EF80

Motor circuit-breakers from 0.09 to 30 kW

GV2 L: Control by rotary knob, connection by screw clamp terminals

Standard power ratings of 3-phase motors 50/60 Hz in category AC-3								Magnetic protection rating	Tripping current Id ± 20 %	Use in association with thermal overload relay (class 10 A)	Reference	Weight							
400/415 V			500 V			690 V		P	Icu	Ics (1)	P	Icu	Ics (1)	P	Icu	Ics (1)	A	A	kg
0.09	★	★	—	—	—	—	—	—	—	—	0.4	5	LRD 03	GV2 L03	0.330				
0.12	★	★	—	—	—	0.37	★	★	—	—	0.63	8	LRD 04	GV2 L04	0.330				
0.18	★	★	—	—	—	—	—	—	—	—	0.63	8	LRD 04	GV2 L04	0.330				
—	—	—	—	—	—	0.55	★	★	—	—	1	13	LRD 05	GV2 L05	0.330				
0.25	★	★	—	—	—	—	—	—	—	—	1	13	LRD 05	GV2 L05	0.330				
—	—	—	—	—	—	0.75	★	★	—	—	1	13	LRD 06	GV2 L05	0.330				
0.37	★	★	0.37	★	★	—	—	—	—	—	1	13	LRD 05	GV2 L05	0.330				
0.55	★	★	0.55	★	★	1.1	★	★	—	—	1.6	22.5	LRD 06	GV2 L06	0.330				
—	—	—	0.75	★	★	—	—	—	—	—	1.6	22.5	LRD 06	GV2 L06	0.330				
0.75	★	★	1.1	★	★	1.5	4	100	2.5	—	—	33.5	LRD 07	GV2 L07	0.330				
1.1	—	—	—	—	—	—	—	—	—	—	—	—	LRD 08	GV2 L08	0.330				
1.5	★	★	1.5	★	★	3	4	100	4	—	—	51	LRD 08	GV2 L08	0.330				
—	—	—	—	—	—	—	—	—	—	—	—	—	LRD 08	GV2 L08	0.330				
2.2	★	★	3	★	★	4	4	100	6.3	—	—	78	LRD 10	GV2 L10	0.330				
3	★	★	4	10	100	5.5	4	100	10	—	—	138	LRD 12	GV2 L14	0.330				
4	—	—	—	—	—	—	—	—	—	—	—	—	LRD 14	GV2 L14	0.330				
—	—	—	—	—	—	7.5	4	100	10	—	—	138	LRD 14	GV2 L14	0.330				
—	—	—	—	—	—	9	4	100	14	—	—	170	LRD 16	GV2 L16	0.330				
5.5	50	50	7.5	10	75	11	4	100	14	—	—	170	LRD 16	GV2 L16	0.330				
7.5	50	50	9	10	75	15	4	100	18	—	—	223	LRD 21	GV2 L20	0.330				
9	50	50	11	10	75	18.5	4	100	25	—	—	327	LRD 22	GV2 L22	0.330				
11	50	50	15	10	75	—	—	—	25	—	—	327	LRD 22	GV2 L22	0.330				
15	35	50	18.5	10	75	22	4	100	32	—	—	416	LRD 32	GV2 L32	0.330				

GV3 L: control by rotary knob, connection by EverLink® BTR screw connectors

Standard power ratings of 3-phase motors 50/60 Hz in category AC-3								Magnetic protection rating	Tripping current Id ± 20 %	Use in association with thermal overload relay (class 10 A)	Reference	Weight							
400/415 V			500 V			690 V		P	Icu	Ics (1)	P	Icu	Ics (1)	P	Icu	Ics (1)	A	A	kg
11	100	100	15	12	50	18.5	6	50	25	—	—	350	LRD 325	GV3 L25	0.960				
15	100	100	18.5	12	50	22	6	50	32	—	—	448	LRD 332	GV3 L32	0.960				
18.5	50	100	22	12	50	37	6	50	40	—	—	560	LRD 340	GV3 L40	0.960				
22	50	100	30	12	50	45	6	50	50	—	—	700	LRD 350	GV3 L50	0.960				
30	50	100	37	12	50	55	6	50	65	—	—	910	LRD 365	GV3 L65	0.960				

Connection by EverLink® BTR screw connectors, for assembly with a contactor

To assemble a GV3 L25 to L65 circuit-breaker with an LC1 D40A to D65A contactor, it is possible to use the circuit-breaker supplied without downstream EverLink® power terminal block. To order this product, add the digit 1 to the end of the references selected above. Example: GV3 L65 becomes GV3 L651.

Connection by lugs

To order these circuit-breakers with connection by lugs, add the digit 6 to the end of reference selected above. Example: GV3 L32 becomes GV3 L326.


GK3: control by rotary knob, connection by screw clamp terminals

37	35	25	55	15	30	—	—	—	80	—	—	1040	LRD 3363	GK3 EF80	0.795
----	----	----	----	----	----	---	---	---	----	---	---	------	----------	----------	-------

(1) As % of Icu. Associated current limiter or fuses, where required. See characteristics page 3/17.

* > 100 kA.

3

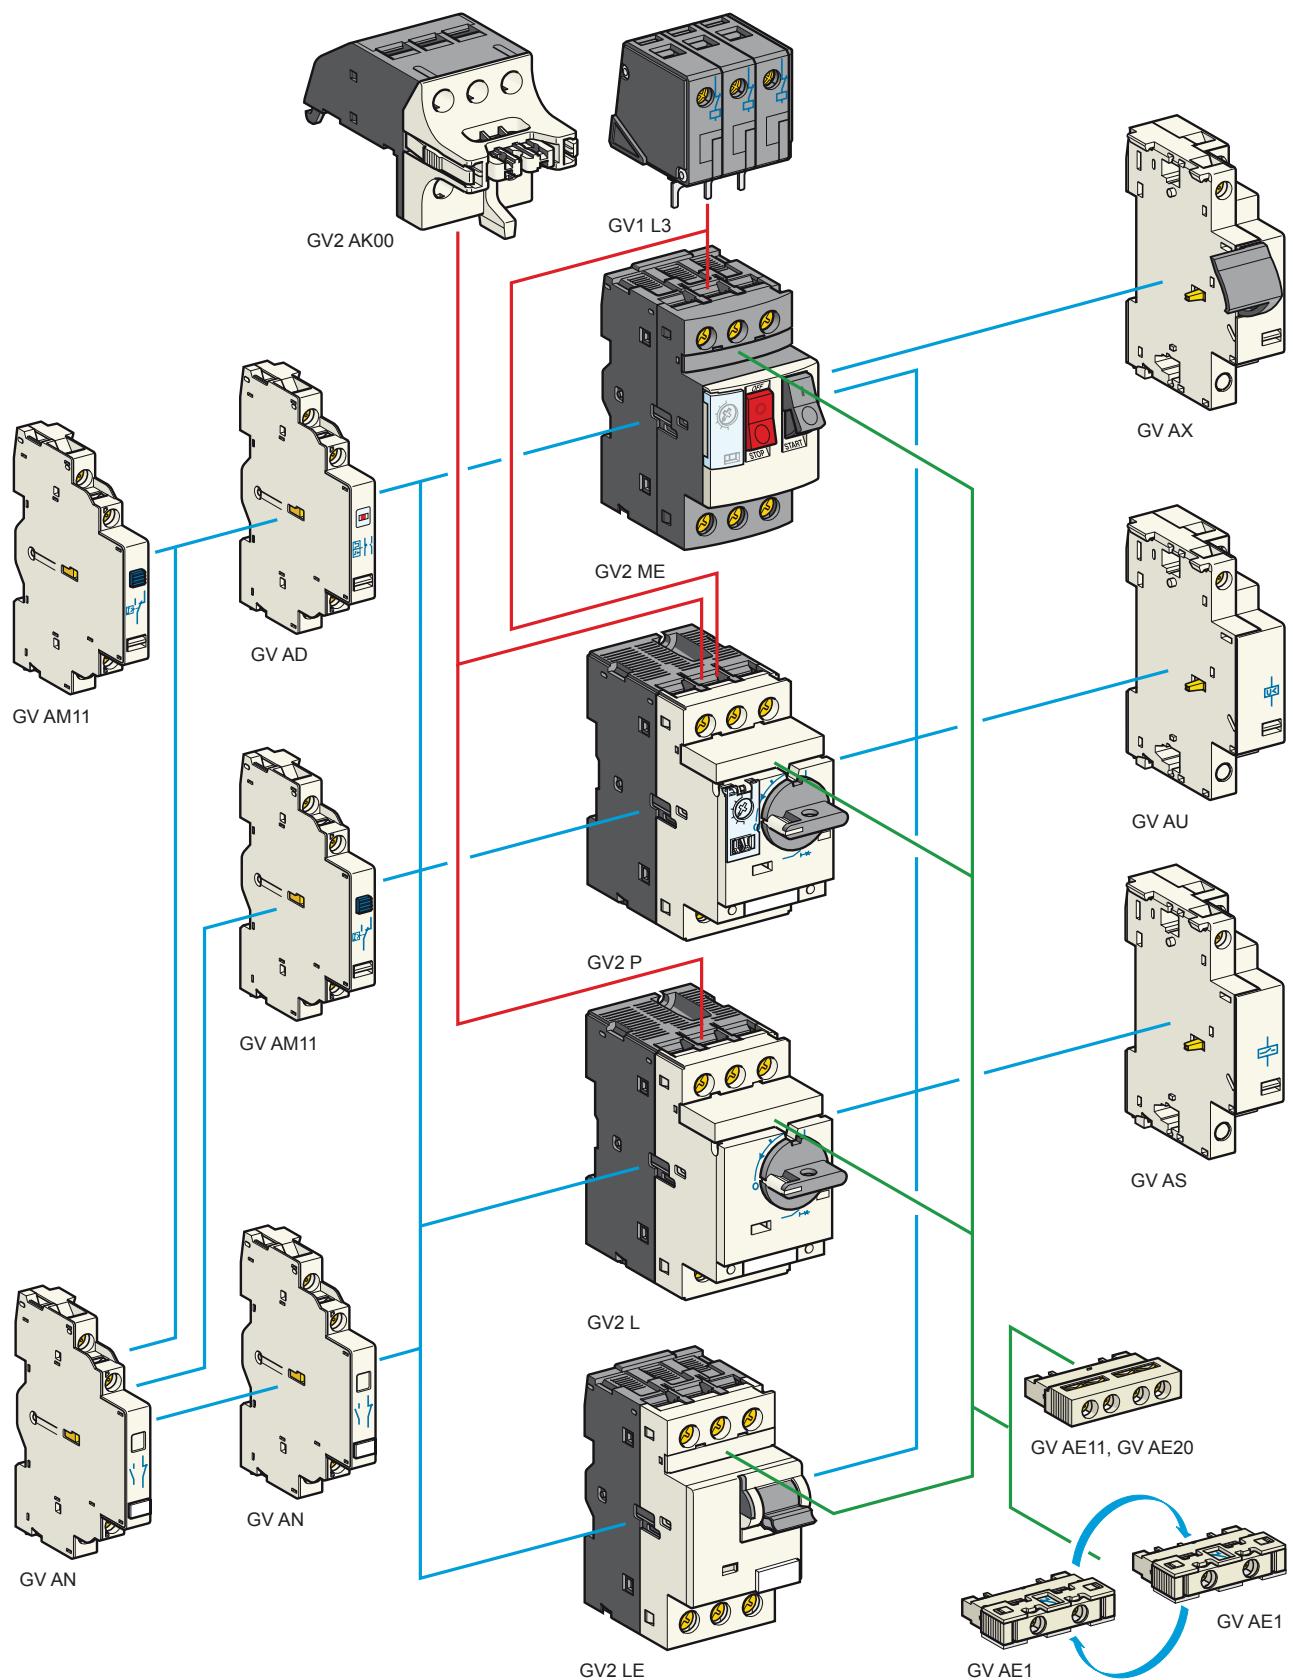

TeSys protection components

Thermal-magnetic and magnetic motor circuit-breakers GV2 with screw clamp connections
Add-on blocks and accessories

3

Contact blocks						
Description	Mounting	Maximum number	Type of contacts	Sold in lots of	Unit reference	Weight kg
Instantaneous auxiliary contacts	Front (1)	1	N/O or N/C (2)	10	GV AE1	0.015
			N/O + N/C	10	GV AE11	0.020
			N/O + N/O	10	GV AE20	0.020
	Side (LH)	2	N/O + N/C	1	GV AN11	0.050
			N/O + N/O	1	GV AN20	0.050
Fault signalling contact + instantaneous auxiliary contact	Side (3) (LH)	1	N/O (fault)	+ N/O 1	GV AD1010	0.055
				+ N/C 1	GV AD1001	0.055
			N/C (fault)	+ N/O 1	GV AD0110	0.055
				+ N/C 1	GV AD0101	0.055
Short-circuit signalling contact	Side (LH)	1	C/O common point	1	GV AM11	0.045

Electric trips				
Mounting	Voltage		Reference	Weight kg
Undervoltage or shunt trips (4)				
Side (1 block on RH side of circuit-breaker)	24 V	50 Hz	GV A•025	0.105
		60 Hz	GV A•026	0.105
	48 V	50 Hz	GV A•055	0.105
		60 Hz	GV A•056	0.105
	100 V	50 Hz	GV A•107	0.105
	100...110 V	60 Hz	GV A•107	0.105
	110...115 V	50 Hz	GV A•115	0.105
		60 Hz	GV A•116	0.105
	120...127 V	50 Hz	GV A•125	0.105
	127 V	60 Hz	GV A•115	0.105
	200 V	50 Hz	GV A•207	0.105
	200...220 V	60 Hz	GV A•207	0.105
	220...240 V	50 Hz	GV A•225	0.105
		60 Hz	GV A•226	0.105
	380...400 V	50 Hz	GV A•385	0.105
		60 Hz	GV A•386	0.105
	415...440 V	50 Hz	GV A•415	0.105
	415 V	60 Hz	GV A•416	0.105
	440 V	60 Hz	GV A•385	0.105
	480 V	60 Hz	GV A•415	0.105
	500 V	50 Hz	GV A•505	0.105
	600 V	60 Hz	GV A•505	0.105

Undervoltage trip, INRS (can only be mounted on GV2 ME)

Safety device for dangerous machines conforming to INRS and VDE 0113

Side (1 block on RH side of circuit-breaker GV2 ME)	110...115 V	50 Hz	GV AX115	0.110
		60 Hz	GV AX116	0.110
	127 V	60 Hz	GV AX115	0.110
	220...240 V	50 Hz	GV AX225	0.110
		60 Hz	GV AX226	0.110
	380...400 V	50 Hz	GV AX385	0.110
		60 Hz	GV AX386	0.110
	415...440 V	50 Hz	GV AX415	0.110
		60 Hz	GV AX385	0.110

Add-on contact blocks

Description	Mounting	Maximum number	Reference	Weight kg
Visible isolation block (5)	Front (1)	1	GV2 AK00 (6)	0.150
Limiters	At top (GV2 ME and GV2 P)	1	GV1 L3	0.130
	Independent	1	LA9 LB920	0.320

(1) Mounting of a GV AE contact block or a GV2 AK00 visible isolation block on GV2 P and GV2 L.

(2) Choice of N/C or N/O contact operation, depending on which way round the reversible block is mounted.

(3) The GV AD is always mounted next to the circuit-breaker.


(4) To order an undervoltage trip: replace the dot (•) in the reference with a U, example: GV AU025.

To order a shunt trip: replace the dot (•) in the reference with an S, example: GV AS025.

(5) Visible isolation of the 3 poles upstream of circuit-breaker GV2 P and GV2 L.


Visible isolation block GV2 AK00 cannot be used with motor circuit-breakers GV2 P32 and GV2 L32 (Ith max = 25 A).

(6) Ie Max = 32 A.



LA9 LB920

Characteristics:
pages 3/18 to 3/23Dimensions, schemes:
pages 3/70 to 3/89

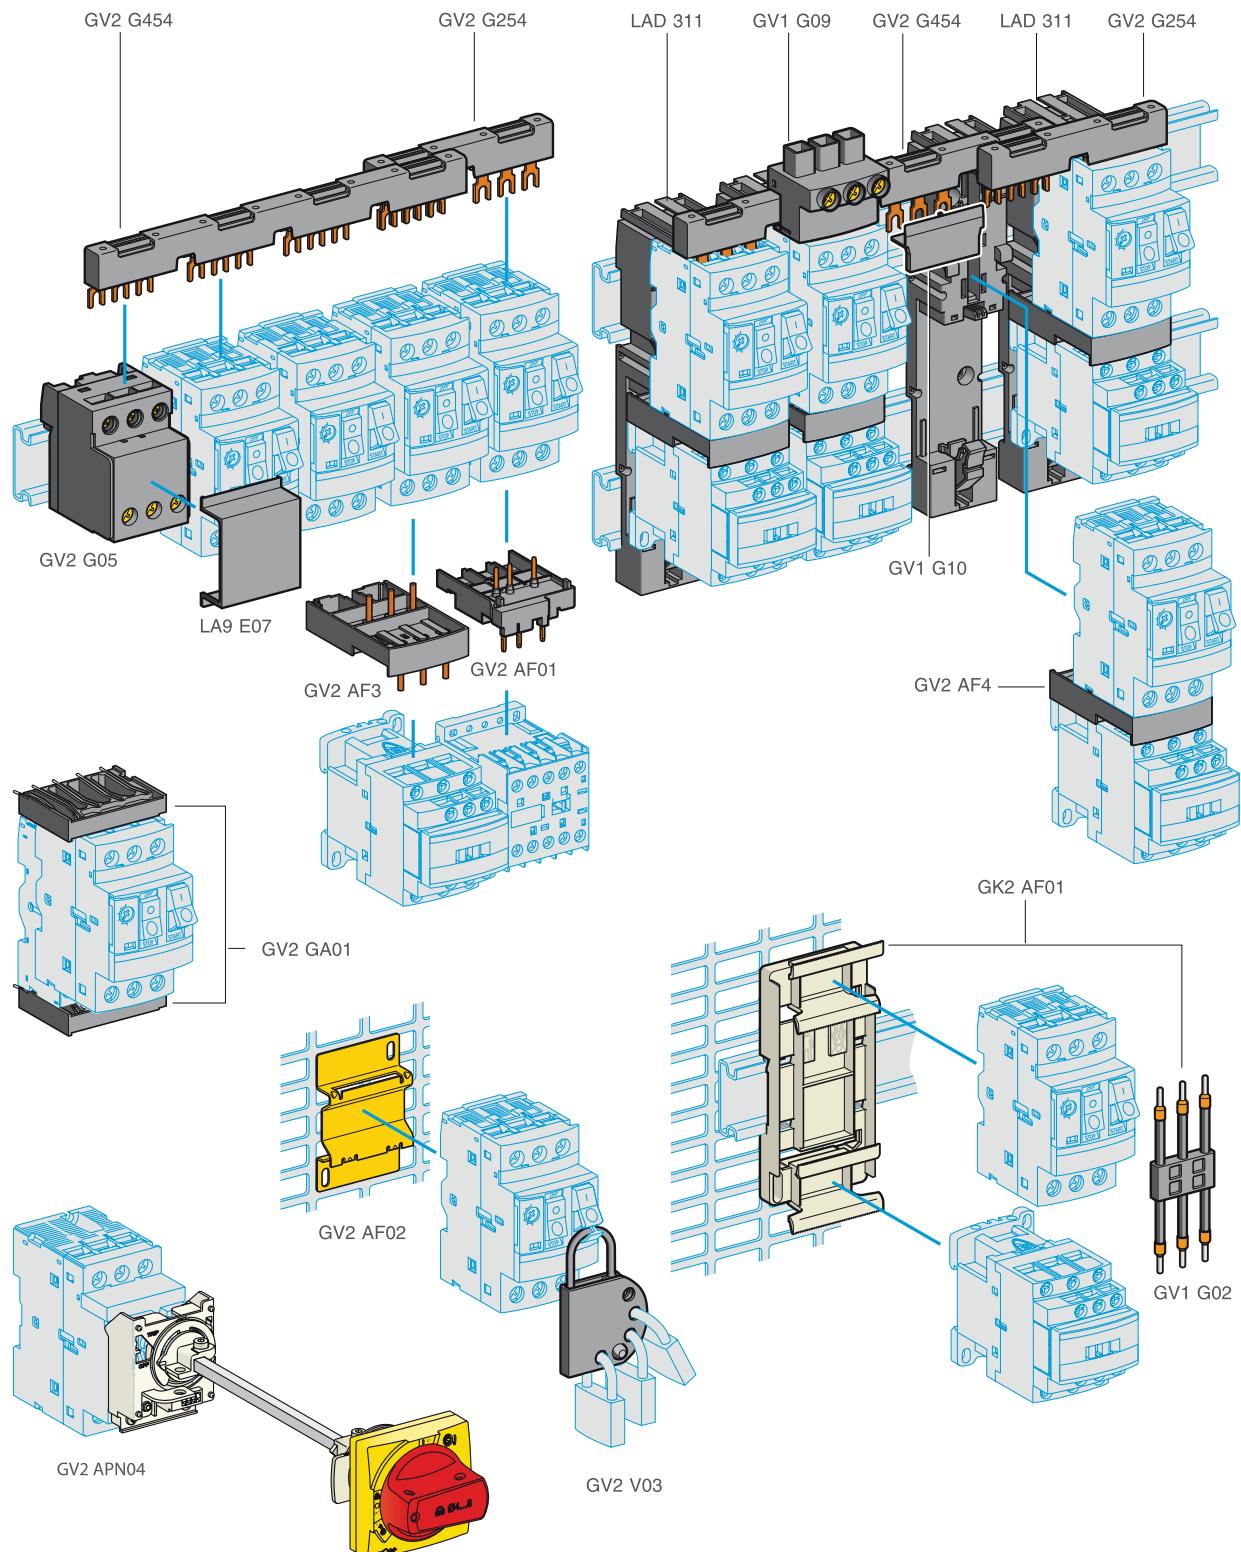


TeSys protection components

Thermal-magnetic and magnetic motor circuit-breakers GV2 with screw clamp connections

Accessories

Accessories				
Description	Application	Sold in lots of	Unit reference	Weight kg
Adapter plates	For mounting a GV2 ME or GV2 LE by screw fixing	10	GV2 AF02	0.021
	For mounting a GV2 ME or GV2 P and contactor LC1 D09...D38 with front faces aligned	1	LAD 311	0.040
Height compensation plate	7.5 mm	10	GV1 F03	0.003
Combination blocks	Between GV2 and contactor LC1 K or LP1 K	10	GV2 AF01	0.020
	Between GV2 and contactor LC1 D09...D38	10	GV2 AF3	0.016
	Between GV2 mounted on LAD 311 and contactor LC1 D09...D38	10	GV2 AF4	0.016
Motor starter adapter plate	With 3-pole connection for mounting a GV2 and a contactor LC1 D09...D25	1	GK2 AF01	0.120
Description	Application	Pitch mm	Reference	Weight kg
Sets of 3-pole 63 A busbars	2 tap-offs	45	GV2 G245	0.036
		54	GV2 G254	0.038
		72	GV2 G272	0.042
	3 tap-offs	45	GV2 G345	0.058
		54	GV2 G354	0.060
	4 tap-offs	45	GV2 G445	0.077
		54	GV2 G454	0.085
		72	GV2 G472	0.094
	5 tap-offs	54	GV2 G554	0.100
Description	Application	Sold in lots of	Unit reference	Weight kg
Protective end cover	For unused busbar outlets	5	GV1 G10	0.005
Terminal block for supply to one or more GV2 G busbar sets	Connection from the top	1	GV1 G09	0.040
	Can be fitted with current limiter GV1 L3 (GV2 ME and GV2 P)	1	GV2 G05	0.115
Cover for terminal block	For mounting in modular panels	10	LA9 E07	0.005
Flexible 3-pole connection for connecting a GV2 to a contactor LC1-D09...D25	Centre distance between mounting rails: 100...120 mm	10	GV1 G02	0.013
Set of connections upstream/downstream	For connecting GV2 ME to a printed circuit board	10	GV2 GA01	0.045
"Large Spacing" adapter UL 508 type E	For GV2 P●●H7 (except 32 A)	1	GV2 GH7	0.040
Clip-in marker holders (supplied with each circuit-breaker)	For GV2 P, GV2 L, GV2 LE and GV2 RT (8 x 22 mm)	100	LA9 D92	0.001

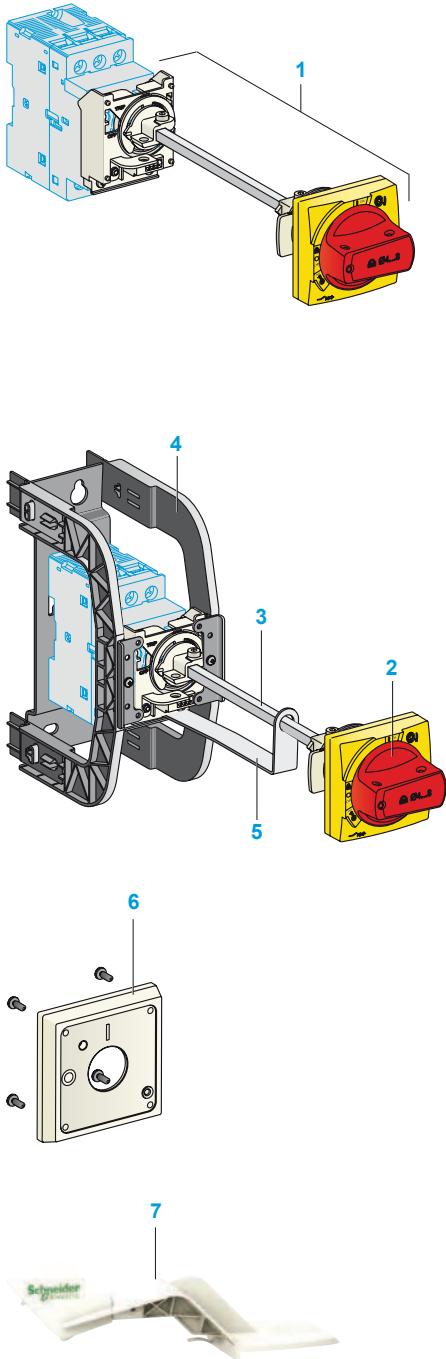

Extended Rotary Handle

Allows a circuit-breaker or a starter-controller installed in back of an enclosure to be operated from the front of the enclosure.

A rotary handle can be black or red/yellow, IP54 or IP65. It includes a function for locking the circuit breaker or the starter in the O (Off) or I (On) position (depending of the type of rotary handle) by means of up to 3 padlocks with a shank diameter of 4 to 8 mm. The extended shaft must be adjusted to use in different size enclosures. The IP54 rotary handle is fixed with a nut (\varnothing 22) to make easier the assembling. The new Laser Square tool brings the accuracy to align the circuit breaker and the rotary handle.

Padlockable external operators for GV2P and GV2L

Description

- 1 Kit handle + mounting system
- 2 Universal handle
- 3 Shaft
- 4 Bracket
- 5 Shaft support plate for deep enclosure
- 6 Retrofit accessory
- 7 Laser Square accessory

Kit handle + mounting system

Description		Item Reference	Weight kg
For GV2 P/L	Black handle, front plate, with trip status, IP 54	1 GV2 APN01	0.300
	Red handle, front plate, with trip status, IP 54	1 GV2 APN02	0.300
	Red handle, front plate, without trip status, IP 65	1 GV2 APN04	0.300
For GV2 LE		- GV2 AP03	0.280
Black handle, blue front plate, IP 54			

Universal handle

For GV2 P/L	Black handle, IP 54	2 GV APB54	0.140
	Red handle, IP 54	2 GV APR54	0.140
	Red handle, IP 65	2 GV APR65	0.140

Shaft

For GV2 P/L	L = 315 mm	3 GV APA1	0.110
-------------	------------	-----------	-------

Bracket

For GV2 P/L		4 GV APH02	0.300
-------------	--	------------	-------

Shaft support plate for deep enclosure

For GV2 P/L	Depth \geq 250 mm	5 GV APK11	0.030
-------------	---------------------	------------	-------

Retrofit accessory

For GV2 P/L		6 GV APP1	0.100
-------------	--	-----------	-------

Laser Square accessory


For GV2 P/L		7 GV APL01	0.160
-------------	--	------------	-------


Sticker

		Sold in lots of	
Warning label	For French	10	- GV APSFR
	For English	10	- GV APSEN
	For German	10	- GV APSDE
	For Spanish	10	- GV APSES
	For Chinese	10	- GV APSCN
	For Portuguese	10	- GV APSPT
	For Russian	10	- GV APSRU
	For Italian	10	- GV APSIT

Padlocking device


Description		Reference	Weight kg
For all GV2 device	For use with up to 4 padlocks, \varnothing 6 mm shank max. (padlocks not included)	GV2 V03	0.092

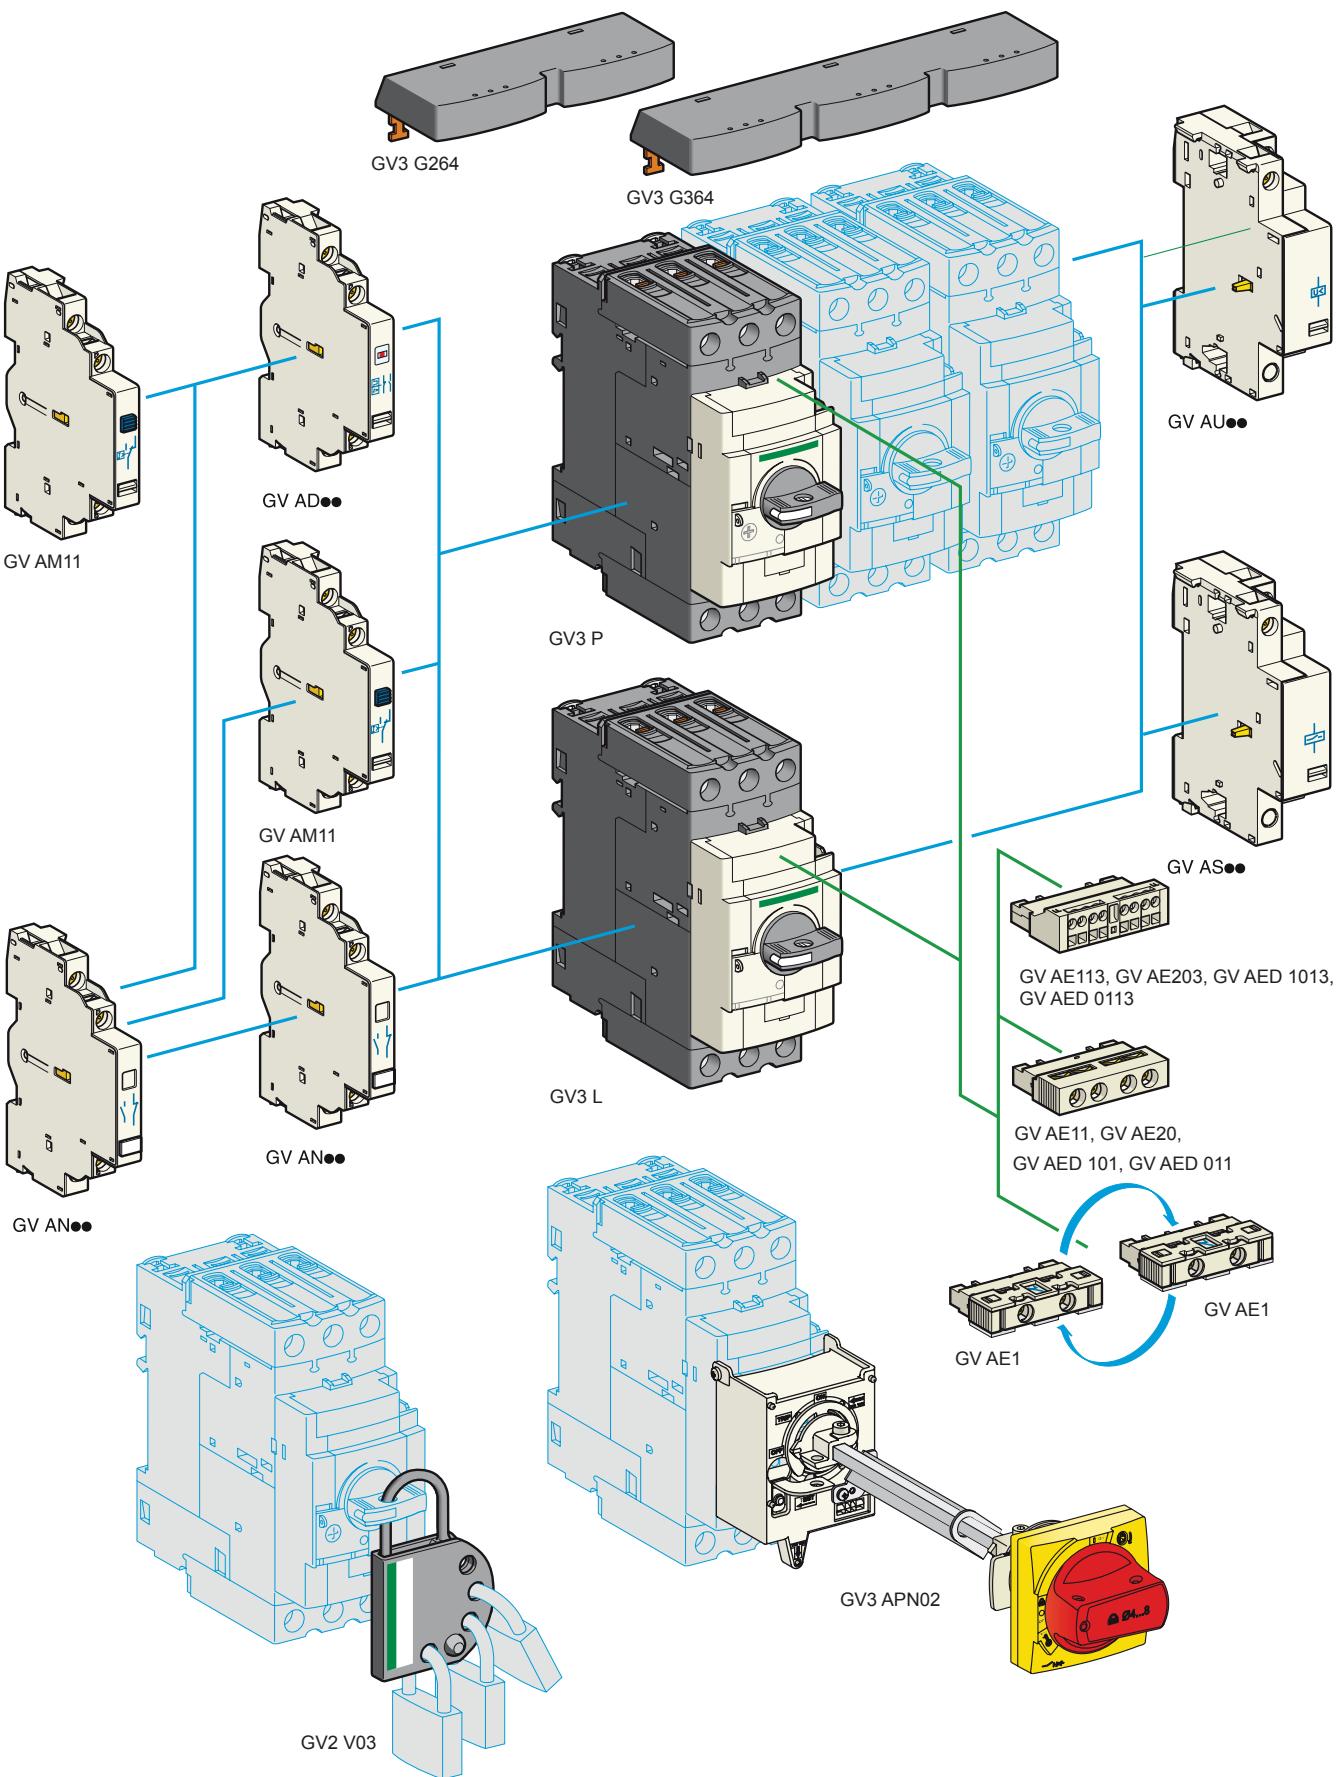


Contact blocks

GV3 G66

Description	Mounting	Maximum number	Type of contacts	Sold in lots of	Unit reference	Weight kg
Instantaneous auxiliary contacts	Front	1	N/O or N/C (1)	10	GV AE1	0.015
			N/O + N/C	10	GV AE11 (2)	0.020
	Side (LH)		N/O + N/O	10	GV AE20 (2)	0.020
	2	N/O + N/C	1	GV AN11 (2)	0.050	
Fault signalling contact + instantaneous auxiliary contact	Front	1	N/O (fault)	+ N/O	1 GV AED101 (2)	0.020
			N/O (fault)	+ N/C	1 GV AED011 (2)	0.020
	(LH)	1	N/O (fault)	+ N/O	1 GV AD1010	0.055
				+ N/C	1 GV AD1001	0.055
Short-circuit signalling contact	Side (LH)	1	N/C (fault)	+ N/O	1 GV AD0110	0.055
				+ N/C	1 GV AD0101	0.055
				C/O common point	1 GV AM11	0.045



LAD 96570



LAD 96575



LAD 7X3

Electric trips - undervoltage or shunt (4)

Mounting	Voltage	Reference	Weight kg	
Side (1 block on RH side of circuit-breaker)	24 V	50 Hz	GV A•025	0.105
		60 Hz	GV A•026	0.105
48 V	50 Hz	GV A•055	0.105	
	60 Hz	GV A•056	0.105	
100	50 Hz	GV A•107	0.105	
	60 Hz	GV A•107	0.105	
100...110 V	50 Hz	GV A•115	0.105	
	60 Hz	GV A•116	0.105	
110...115 V	50 Hz	GV A•125	0.105	
	60 Hz	GV A•115	0.105	
120...127 V	50 Hz	GV A•107	0.105	
	60 Hz	GV A•107	0.105	
200 V	50 Hz	GV A•207	0.105	
	60 Hz	GV A•207	0.105	
200...220 V	50 Hz	GV A•225	0.105	
	60 Hz	GV A•226	0.105	
220...240 V	50 Hz	GV A•385	0.105	
	60 Hz	GV A•386	0.105	
380...400 V	50 Hz	GV A•415	0.105	
	60 Hz	GV A•416	0.105	
415...440 V	50 Hz	GV A•385	0.105	
	60 Hz	GV A•415	0.105	
440 V	50 Hz	GV A•416	0.105	
	60 Hz	GV A•385	0.105	
480 V	50 Hz	GV A•415	0.105	
	60 Hz	GV A•505	0.105	
500 V	50 Hz	GV A•505	0.105	
	60 Hz	GV A•505	0.105	
600 V	50 Hz	GV A•505	0.105	
	60 Hz	GV A•505	0.105	

Accessories

Description		Reference	Weight kg	
Sets of 3-pole 115 A busbars Pitch: 64 mm	2 tap-off	GV3 P•• and GV3 L••	GV3 G264	0.150
	3 tap-off	GV3 P•• and GV3 L••	GV3 G364	0.250
Cover "Large Spacing" UL 508 type E (Only one cover required on supply side)	GV3 P••	GV3 G66	0.020	
IP 20 cover (Two covers required per breaker)	GV3 P••6 and GV3 L••6	LAD 96570	0.021	
IP 20 cover for use when mounted with circuit-breakers	GV3 P••6 and GV3 L••6	LAD 96575	0.010	
Size 4 Allen key, insulated, 1000 V	GV3 P•• and GV3 L••	LAD ALLEN4 (5)	0.026	
Padlocking device for use with up to 4 padlocks (not supplied) Ø 6 mm shank max.	GV3 P•• and GV3 L•• GV3 P••6 and GV3 L••6	GV2 V03	0.092	
Retrofit plate for screw fixing	Replacement of GV3 ME with GV3 P•• or GV2 P••	LAD 7X3	0.150	

(1) Choice of N/C or N/O contact operation, depending on which way round the reversible block is mounted.

(2) Contact blocks available in version with spring terminal connections. Add a figure 3 at the end of the references selected above.
Example: GV AED101 becomes GV AED1013.

(3) The GV AD•• is always mounted next to the circuit-breaker.

(4) To order an undervoltage trip: replace the dot (•) in the reference with a U, example: GV AU025.


To order a shunt trip: replace the dot (•) in the reference with an S, example: GV AS025.

(5) Sold in lots of 5.

TeSys protection components

Thermal-magnetic motor circuit-breakers GV3 P and GV3 L

Add-on blocks and accessories

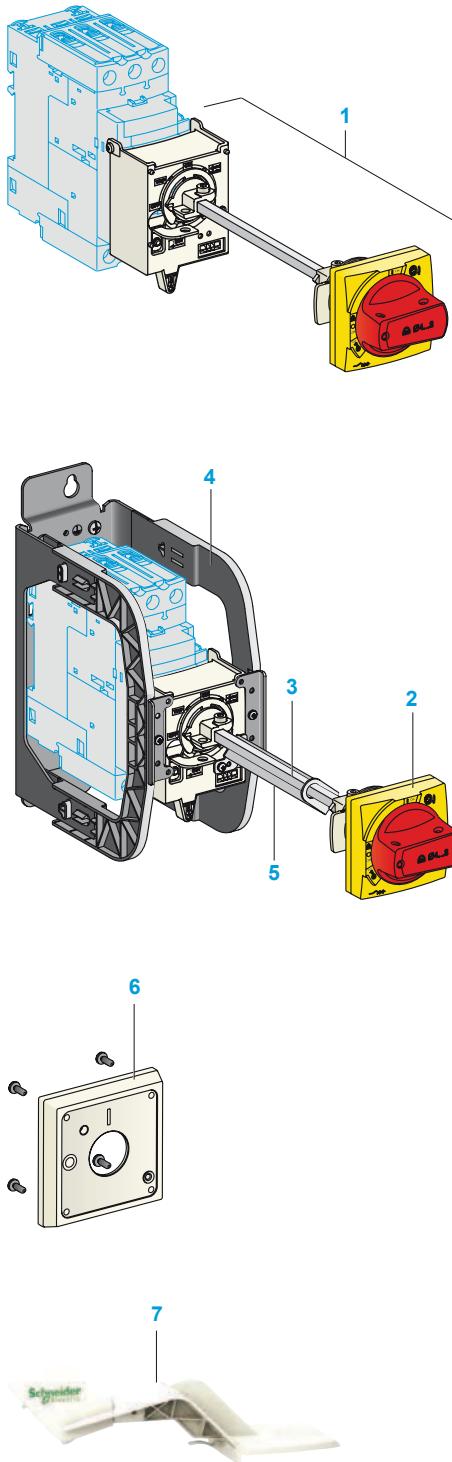

3

Extended Rotary Handle

Allows a circuit-breaker or a starter-controller installed in back of an enclosure to be operated from the front of the enclosure.

A rotary handle can be black or red/yellow, IP54 or IP65. It includes a function for locking the circuit breaker or the starter in the O (Off) or I (On) position (depending of the type of rotary handle) by means of up to 3 padlocks with a shank diameter of 4 to 8 mm. The extended shaft must be adjusted to use in different size enclosures. The IP54 rotary handle is fixed with a nut (\varnothing 22) to make easier the assembling. The new Laser Square tool brings the accuracy to align the circuit breaker and the rotary handle.

Padlockable external operators for GV3 and GV3L



Description

- 1 Kit handle + mounting system
- 2 Universal handle
- 3 Shaft
- 4 Bracket
- 5 Shaft support plate for deep enclosure
- 6 Retrofit accessory
- 7 Laser Square accessory

Kit handle + mounting system

Description	Item Reference	Weight kg
For GV3 P/L		
Black handle, front plate, with trip status, IP 54	1 GV3 APN01	0.300
Red handle, front plate, with trip status, IP 54	1 GV3 APN02	0.300
Red handle, front plate, without trip status, IP 65	1 GV3 APN04	0.300
Universal handle		
For GV3 P/L		
Black handle, IP 54	2 GV APB54	0.140
Red handle, IP 54	2 GV APR54	0.140
Red handle, IP 65	2 GV APR65	0.140
Shaft		
For GV3 P/L		
L = 315 mm	3 GV APA1	0.110
Bracket		
For GV3 P/L		
	4 GV APH03	0.300
Shaft support plate for deep enclosure		
For GV3 P/L		
Depth \geq 300 mm	5 GV APK12	0.030
Retrofit accessory		
For GV3 P/L		
	6 GV APP1	0.100
Laser Square accessory		
For GV3 P/L		
	7 GV APL01	0.160
Sticker	Sold in lots of	
Warning label		
For French	10	- GV APSFR
For English	10	- GV APSEN
For German	10	- GV APSDE
For Spanish	10	- GV APSES
For Chinese	10	- GV APSCN
For Portuguese	10	- GV APSPT
For Russian	10	- GV APSRU
For Italian	10	- GV APSIT

3

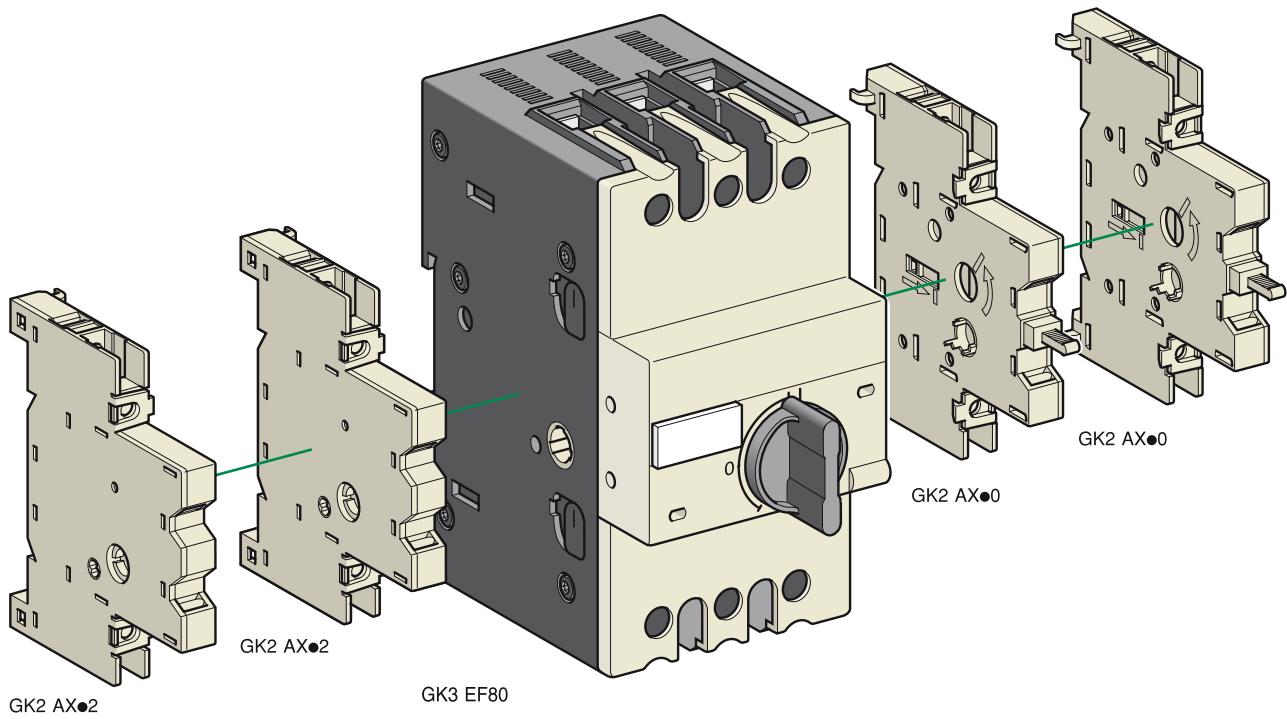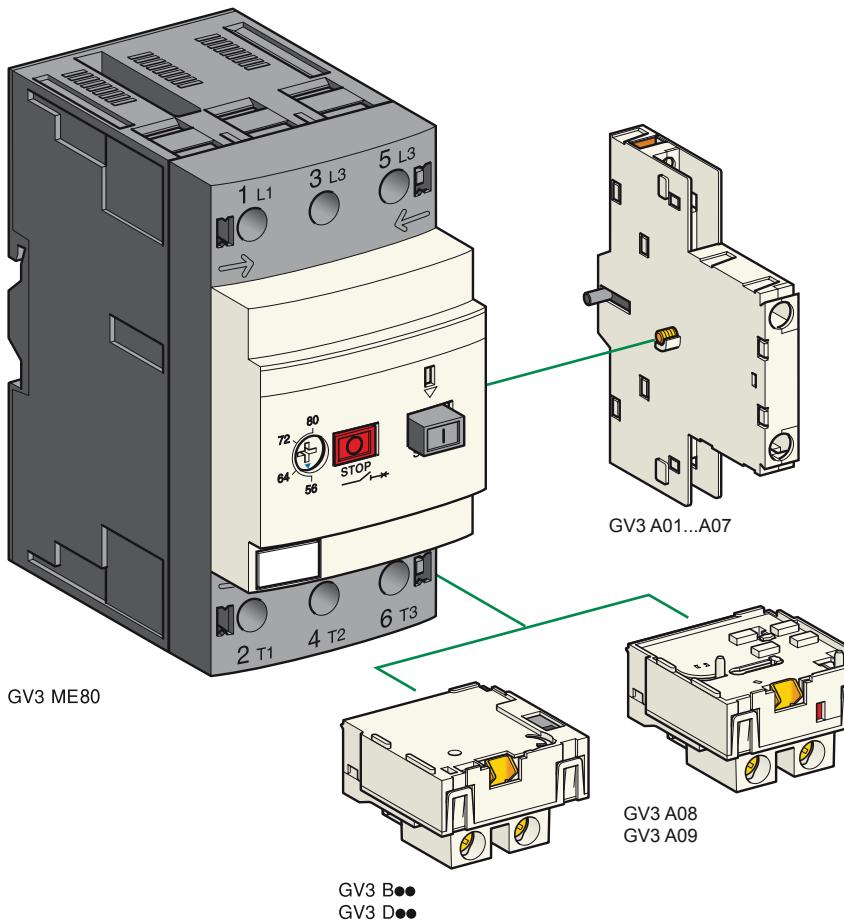

TeSys protection components

Motor circuit-breakers GV3 ME80 and GK3 EF80

Add-on blocks and accessories

For thermal-magnetic motor circuit-breakers GV3 ME80

Contact blocks

Description	Type of standard early break contacts	Reference	Weight kg
Instantaneous auxiliary contact blocks (1 per circuit-breaker)	N/C + N/O	GV3 A01	0,060
	N/O + N/O	GV3 A02	0,060
	N/C + N/O + N/O	GV3 A03	0,070
	N/O + N/O + N/O	GV3 A05	0,070
	N/O + N/O + 2 volt-free terminals	GV3 A06	0,070
	N/C + N/O + 2 volt-free terminals	GV3 A07	0,070
Fault signalling contacts (1)	N/C	GV3 A08	0,030
	N/O	GV3 A09	0,030

Electric trips

Description	Voltages	Reference	Weight kg
Undervoltage trips (1)	50 Hz	50 Hz	
	110, 120, 127 V	120, 127 V	GV3 B11
	220, 240 V	277 V	GV3 B22
Shunt trips (1)	380, 415 V	440 V, 480 V	GV3 B38
	110, 120, 127 V	120, 127 V	GV3 D11
	220, 240 V	277 V	GV3 D22
	380, 415 V	440 V, 480 V	GV3 D38

Accessory

Description	Sold in lots of	Unit reference	Weight kg
Padlocking device, for locking the Start button (on open-mounted product)	5	GV1 V02	0.010

For magnetic circuit-breaker GK3 EF80

Contact blocks

Description	Number of poles	Reference	Weight kg
Auxiliary contact blocks for On-Off signalling and "control circuit test" function (1 or 2 blocks per device) mounted on RH side of GK3 EF80	N/O	GK2 AX10	0,025
	N/O + N/O	GK2 AX20	0,031
	N/C + N/O	GK2 AX50	0,031
Instantaneous fault signalling contact blocks (1 or 2 blocks per device) mounted on LH side of GK3 EF80	N/O	GK2 AX12	0,025
	N/O + N/O	GK2 AX22	0,031
	N/C + N/O	GK2 AX52	0,031

Accessories


Description	Reference	Weight kg
Padlocking device for padlocking the operator, using up to 3 padlocks (padlocks to be ordered separately)	GK3 AV01	0,020
External operator for mounting on enclosure door. Red Ø 40 knob on yellow plate, padlockable in position O (with up to 3 padlocks). Door locked when knob in position I, and when knob padlocked in position O.	GK3 AP03	0,300

(1) 1 voltage trip OR 1 fault signalling contact to be fitted inside the motor circuit-breaker.

Other versions

24 to 690 V, 50 or 60 Hz voltage trips for circuit-breakers **GV3 ME80**. Please consult your Regional Sales Office.

3

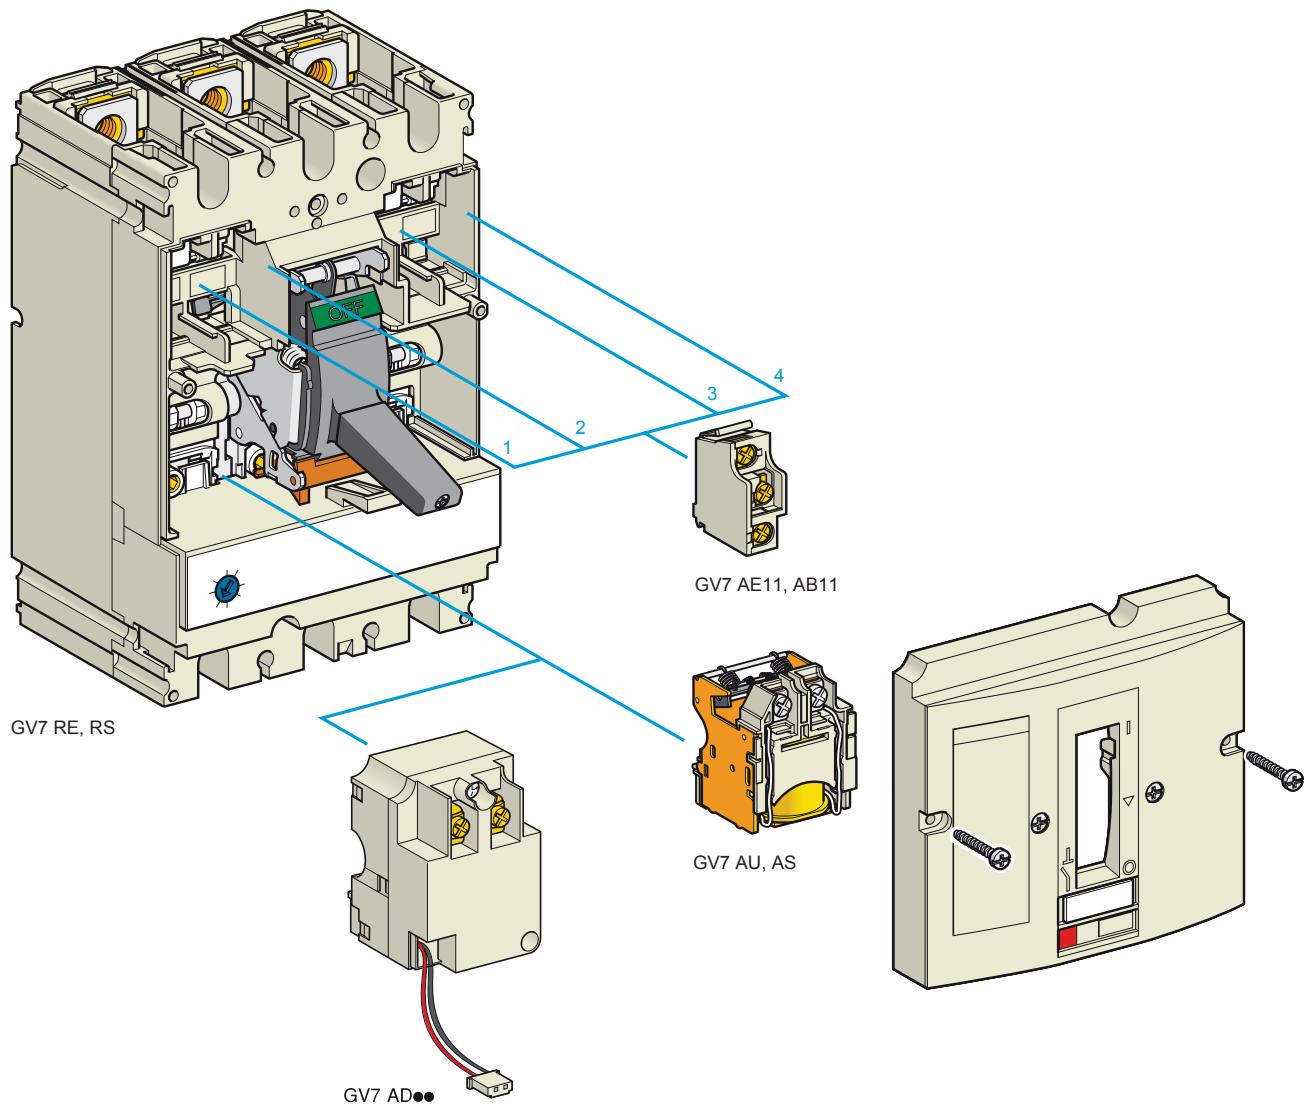

Add-on auxiliary contacts

These allow remote indication of the circuit-breaker contact states. They can be used for signalling, electrical locking, relaying, etc. They are available in two versions: standard and low level. They include a terminal block and the auxiliary circuits leave the circuit-breaker through a hole provided for this purpose.

They perform the following functions, depending on where they are located in the circuit-breaker:

Location	Function	Application
1 and/or 4	C/O contact	Indicates the position of the circuit-breaker poles
2	Trip indication	Indicates that the circuit-breaker has tripped due to an overload, a short-circuit, a differential fault or the operation of a voltage trip (undervoltage or shunt trip), or of the "push to trip" test button. It resets when the circuit-breaker is reset.
3	Electrical fault indication	Indicates that the circuit-breaker has tripped due to an overload, a short-circuit or a differential fault. It resets when the circuit-breaker is reset.
Type	Reference	Weight kg
Standard	GV7 AE11	0.015
Low level	GV7 AB11	0.015

Fault discrimination devices

These make it possible to:

- either differentiate a thermal fault from a magnetic fault,
- or open the contactor only in the event of a thermal fault.

Voltage	Reference	Weight kg
~ 24...48 and - 24...72 V	GV7 AD111 (1)	0.100
~ 110...240 V	GV7 AD112 (1)	0.100

Electric trips



These allow the circuit-breaker to be tripped via an electrical control signal.


- Undervoltage trip GV7 AU
 - Trips the circuit-breaker when the control voltage drops below the tripping threshold, which is between 0.35 and 0.7 times the rated voltage.
 - Circuit-breaker closing is only possible if the voltage exceeds 0.85 times the rated voltage.
 - Circuit-breaker tripping by a GV7 AU trip meets the requirements of IEC 60947-2.
- Shunt trip GV7 AS
 - Trips the circuit-breaker when the control voltage rises above 0.7 times the rated voltage.
- Operation (GV7 AU or GV7 AS)
 - When the circuit-breaker has been tripped by a GV7 AU or AS, it must be reset either locally or by remote control. (For remote control, please consult your Regional Sales Office).
 - Tripping has priority over manual closing: if a tripping instruction is present, manual action does not result in closing, even temporarily, of the contacts.
 - Durability: 50 % of the mechanical durability of the circuit-breaker.

Type	Voltage	Reference	Weight kg
Undervoltage trip	48 V, 50/60 Hz	GV7 AU055 (1)	0.105
	110...130 V, 50/60 Hz	GV7 AU107 (1)	0.110
	200...240 V, 50/60 Hz	GV7 AU207 (1)	0.110
	380...440 V, 50/60 Hz	GV7 AU387 (1)	0.105
	525 V, 50 Hz	GV7 AU525 (1)	0.100
Shunt trip	48 V, 50/60 Hz	GV7 AS055 (1)	0.105
	110...130 V, 50/60 Hz	GV7 AS107 (1)	0.110
	200...240 V, 50/60 Hz	GV7 AS207 (1)	0.110
	380...440 V, 50/60 Hz	GV7 AS387 (1)	0.105
	525 V, 50 Hz	GV7 AS525 (1)	0.100


(1) For mounting of a GV7 AD or a GV7 AU or AS.

3

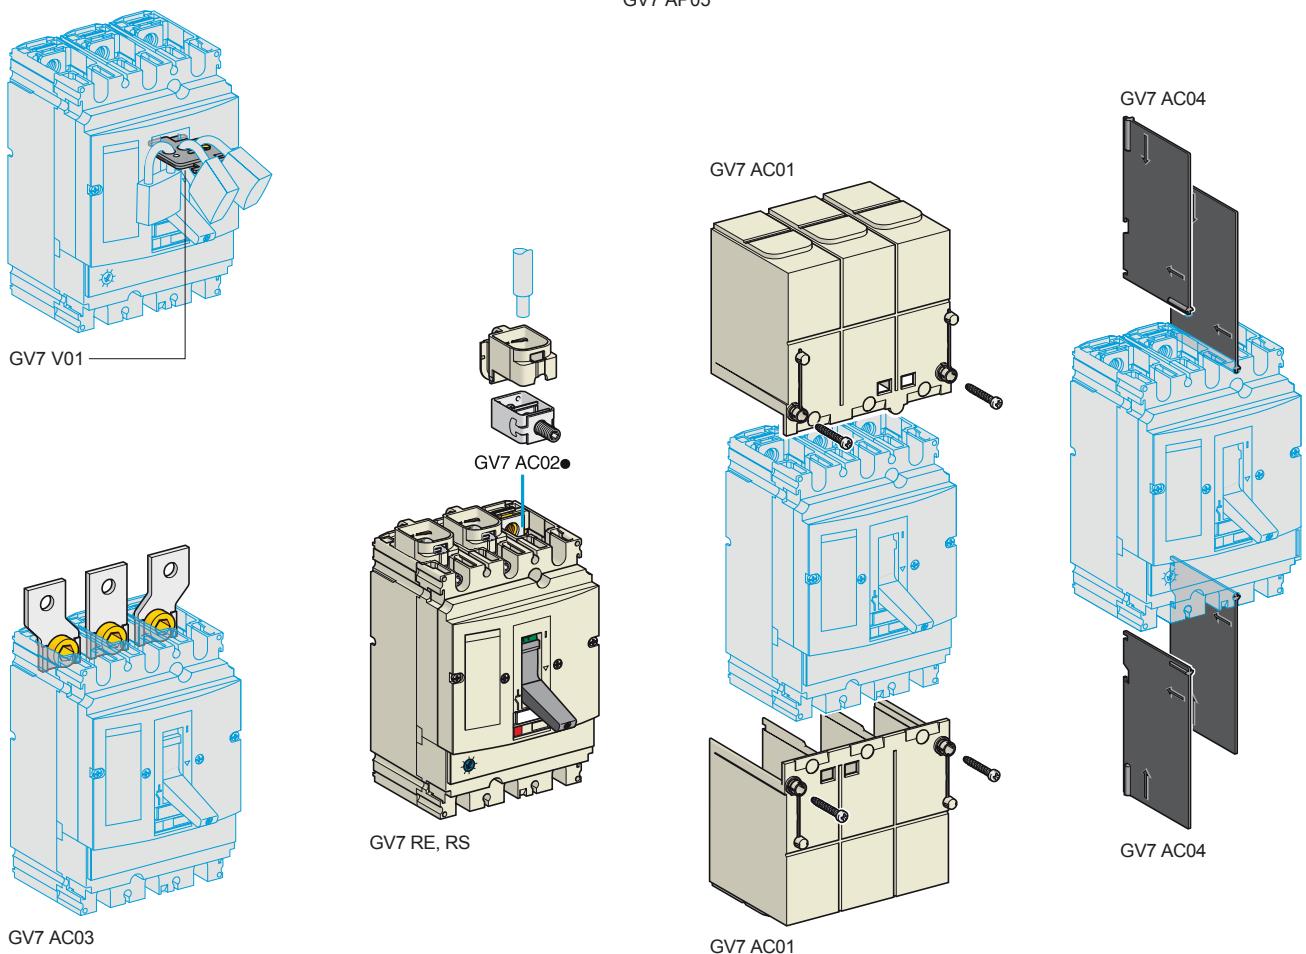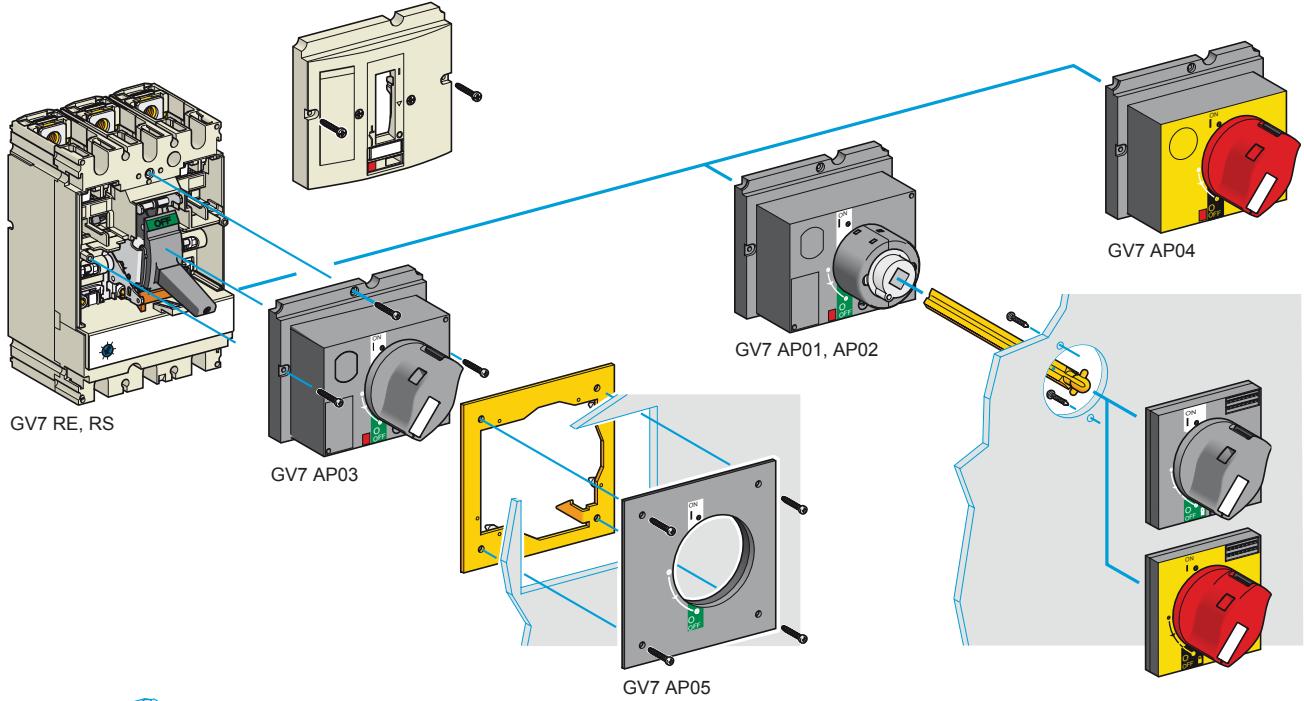

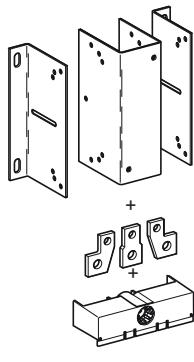

GV7 AC07



GV7 AC08

Cabling accessories

Description	Application	For use on contactors	Sold in lots of	Unit reference	Weight kg
Clip-on connectors for GV7 R	Up to 150 A, 1.5...95 mm ²	—	3	GV7 AC021	0.300
	Up to 220 A, 1.5...185 mm ²	—	3	GV7 AC022	0.350
Spreader 3-pole (1)	To increase the pitch to 45 mm	—	1	GV7 AC03	0.180
Terminal shields IP 405 (1)	Supplied with sealing accessory	—	1	GV7 AC01	0.125
Phase barriers	Safety accessories used when fitting of shields is impossible	—	2	GV7 AC04	0.075
Insulating screens	Ensure insulation between the connections and the backplate	—	2	GV7 AC05	0.075
Kits for combination with contactor(2)	Allowing link between the circuit-breaker and the contactor. The cover provides protection against direct finger contact	LC1 F115...F185 LC1 F225 and F265 LC1 D115 and D150	1 1 1	GV7 AC06 GV7 AC07 GV7 AC08	0.550 0.550 0.550

3

Direct rotary handle

Replaces the circuit-breaker front cover; secured by screws. It includes a device for locking the circuit-breaker in the O (Off) position by means of up to 3 padlocks with a shank diameter of 5 to 8 mm (padlocks not included). A conversion accessory allows the direct rotary handle to be mounted on the enclosure door. In this case, the door cannot be opened if the circuit-breaker is in the "ON" position. Circuit-breaker closing is inhibited if the enclosure door is open.

Description	Type	Degree of protection	Reference	Weight kg
Direct rotary handle	Black handle, black legend plate	IP 40	GV7 AP03	0.205
	Red handle, yellow legend plate	IP 40	GV7 AP04	0.205
Adapter plate (3)	Four mounting direct rotary handle on enclosure door	IP 43	GV7 AP05	0.100

Extended rotary handle

Allows a circuit-breaker installed in the back of an enclosure to be operated from the front of the enclosure. It comprises:

- a unit which screws onto the front cover of the circuit-breaker,
- an assembly (handle and front plate) to be fitted on the enclosure door,
- an extension shaft which must be adjusted (distance between the mounting surface and the door: 185 mm minimum, 600 mm maximum). It includes a device for locking the circuit-breaker in the O (Off) position by means of up to 3 padlocks with a shank diameter of 5 to 8 mm (padlocks not included). This prevents the enclosure door from being opened.

Description	Type	Degree of protection	Reference	Weight kg
Extended rotary handle	Black handle, black legend plate	IP 55	GV7 AP01	0.775
	Red handle, yellow legend plate	IP 55	GV7 AP02	0.775

Locking device

Allows circuit-breakers not fitted with a rotary handle to be locked in the O (Off) position by means of up to 3 padlocks with a shank diameter of 5 to 8 mm (padlocks not included).

Description	Application	Reference	Weight kg
Locking device	For circuit-breaker not fitted with a rotary handle	GV7 V01	0.100


(1) Terminal shields cannot be used together with spreaders.

(2) The kit comprises links, a protective shield and a depth adjustable metal bracket for the breaker.



(3) This conversion accessory makes it impossible to open the door if the device is closed and prevents the device from being closed if the door is open.

Dimensions


GV2 ME

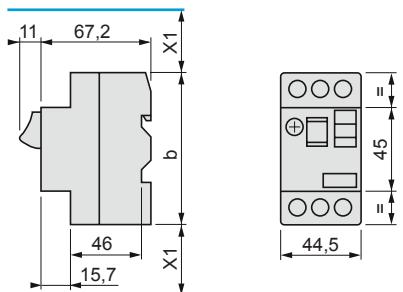

GV AX

GV AD, AM, AN, AU,
AS, AX

GV AE

**b**




GV2 ME••

89

GV2 ME••3

101


(1) Maximum

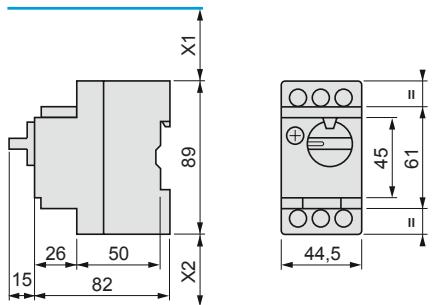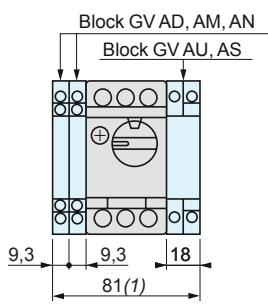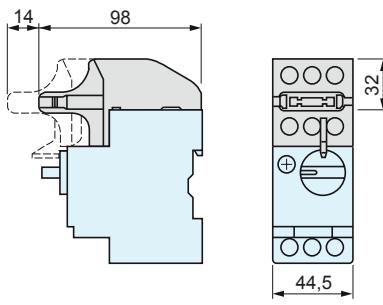X1 Electrical clearance = 40 mm for $U_e \leq 690$ V**GV2 P****GV AD, AM, AN, AU, AS****GV2 AK00**

(1) Maximum

X1 Electrical clearance = 40 mm for $U_e \leq 415$ V, or 80 mm for $U_e = 440$ V,
or 120 mm for $U_e = 500$ and 690 V


X2 = 40 mm

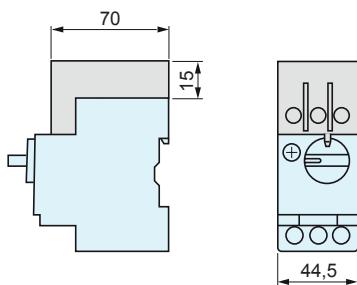GV2 GH7


Mounting

GV2 ME


On 35 mm L-rail




On panel with adapter plate GV2 AF02



On pre-slotted plate AM1 PA



On rails DZ5 MB201

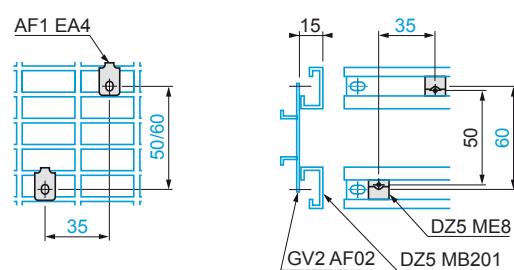


c = 78.5 on AM1 DP200 (35 x 7.5)
c = 86 on AM1 DE200, ED200 (35 x 15)


3

GV2 P


On rail AM1 DE200, ED200 (35 x 15)




Panel mounted



On pre-slotted plate AM1 PA





Adapter plate GK2 AF01

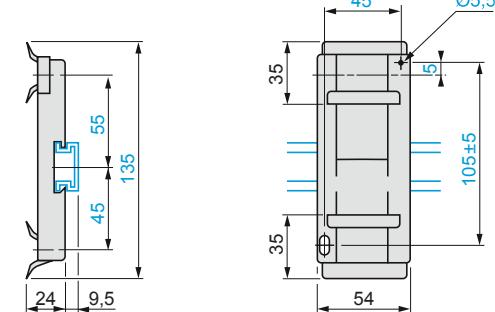

Dimensions



GV2 AF01

Combination GV2 ME + TeSys k contactor

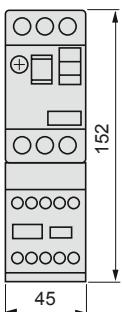
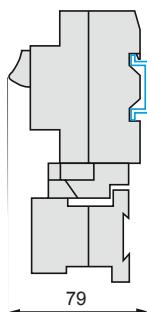


GV2 AF3

Combination GV2 ME + TeSys d contactor

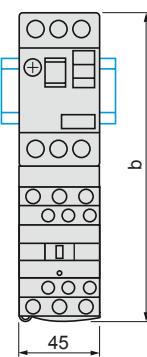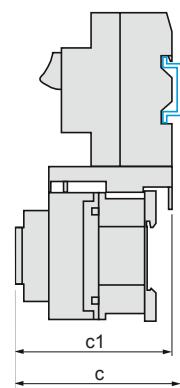

Combination GV2 P + TeSys d contactor

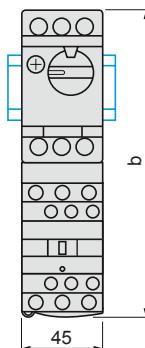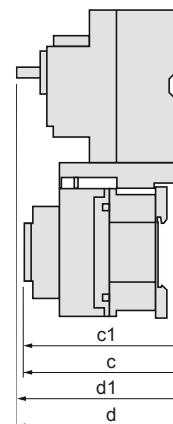

GV2 ME +	LC1 D09 ...D18	LC1 D25 and D32
b	176.4	186.8
c1	94.1	100.4
c	99.6	105.9



GV2 P +	LC1 D09 ...D18	LC1 D25 and D32
b	176.4	186.8
c1	100.1	106.4
c	105.6	111.9
d1	95	95
d	100.5	100.5

Dimensions (continued)

GV2 AF4 + LAD 311

Combination GV2 ME + TeSys d contactor


Combination GV2 P + TeSys d contactor

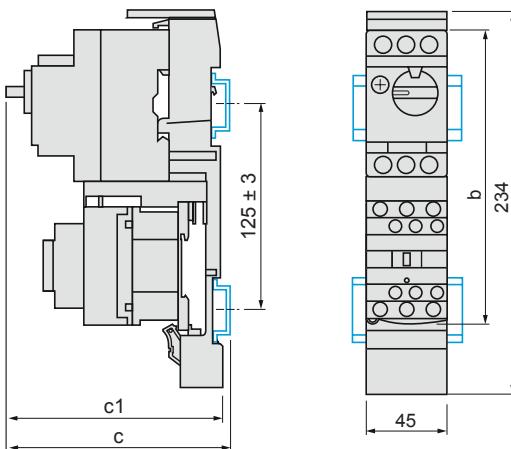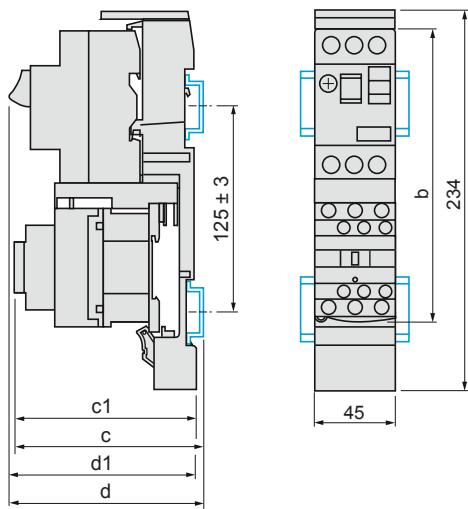

GV2 ME +	LC1 D09...D18	LC1 D25 and D32
b	176.4	186.8
c1	103.1	136.4
c	135.6	141.9
d1	107	107
d	112.5	112.5

GV2 P +	LC1 D09...D18	LC1 D25 and D32
b	176.4	186.8
c1	136.5	142.4
c	141.6	147.9

GV2 ME + GV1 L3 (current limiter)

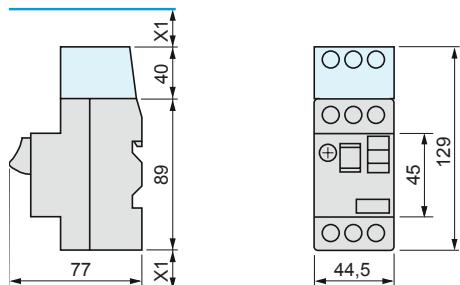

X1 = 10 mm for Ue = 230 V
or 30 mm for 230 V < Ue ≤ 690 V



7.5 mm height compensation plate GV1 F03



Mounting

Mounting of external operator GV2 APN01, GV2 APN02 or GV2 APN04 for motor circuit-breakers GV2 P



Door cut-out

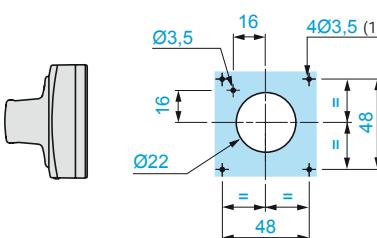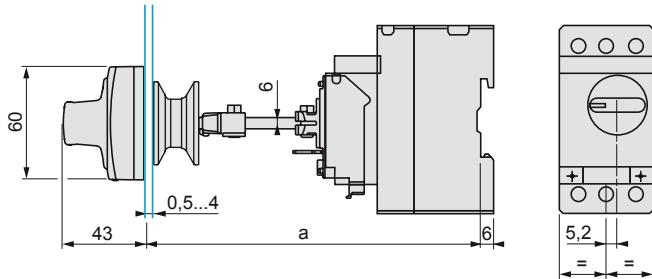

(1) For IP65 only.

Mounting of external operator GV APH02 for motor circuit-breakers GV2 P

Door cut-out

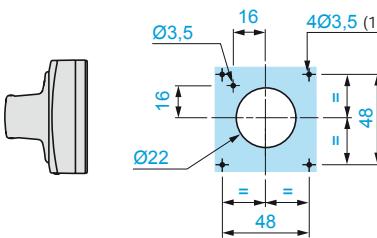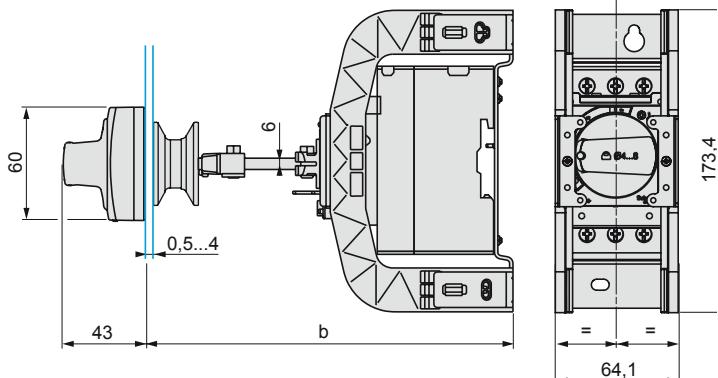


(1) For IP65 only.

	a Mini	a Maxi	b Mini	b Maxi
GV2 APN**	140	250		
GV2 APN** + GV APH02			151	250
GV2 APN** + GV APK11	250	434	-	-
GV2 APN** + GV APH02 + GV APK11	-	-	250	445

GV2 ME, GV2 P


Sets of busbars GV2 G445, GV2 G454, GV2 G472, with terminal block GV2 G05

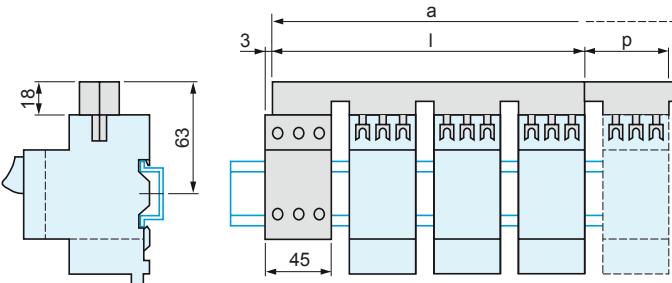


	<i>l</i>	<i>p</i>
GV2 G445 (4 x 45 mm)	179	45
GV2 G454 (4 x 54 mm)	206	54
GV2 G472 (4 x 72 mm)	260	72

Number of tap-offs	<i>a</i>			
	5	6	7	8
GV2 G445	224	269	314	359
GV2 G454	260	314	368	422
GV2 G472	332	404	476	548

Sets of busbars GV2 G*** with terminal block GV1 G09

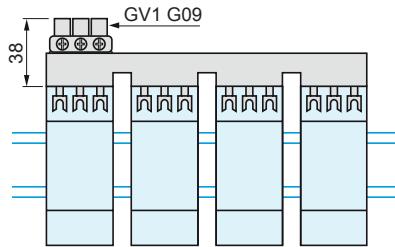


Sets of busbars GV2 G245, GV2 G254, GV2 G272




	<i>l</i>
GV2 G245 (2 x 45 mm)	89
GV2 G254 (2 x 54 mm)	98
GV2 G272 (2 x 72 mm)	116

Sets of busbars GV2 G554

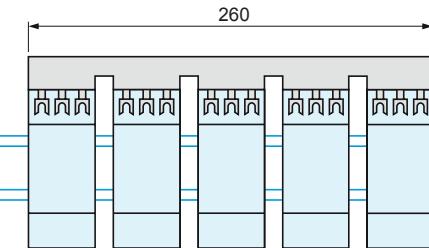


Sets of busbars GV2 G345 and GV2 G354



	<i>l</i>
GV2 G345 (3 x 45 mm)	134
GV2 G354 (3 x 54 mm)	152

GV2 RT

Dimensions

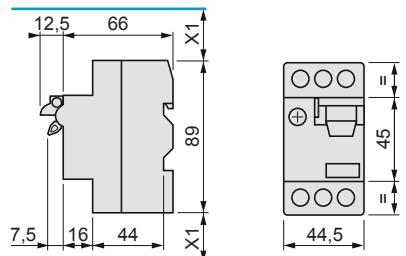


X1: Electrical clearance = 40 mm for Ue < 690 V


3

Mounting

Mounting of external operator GV2 AP03


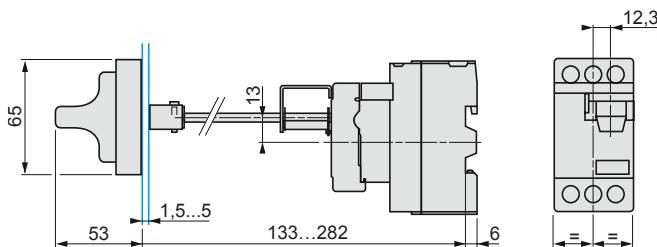


On 35 mm rail




c = 80 on AM1 DP200 (35 x 7.5)
c = 88 on AM1 DE200, ED200 (35 x 15)


On panel with adapter plate GV2 AF02



On pre-slotted plate AM1 PA




On rails DZ5 MB



GV3 P

Dimensions

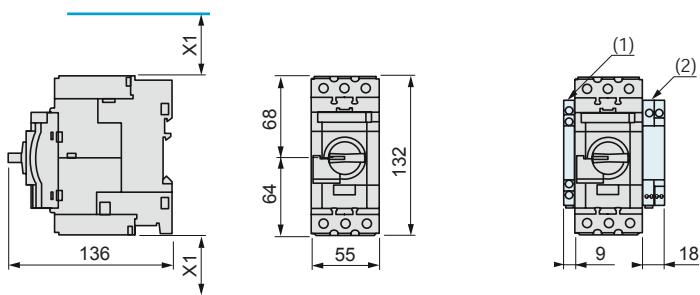

X1 = Electrical clearance (ISC max)
40 mm for $U_e \leq 500$ V, 50 mm for $U_e \leq 690$ V


(1) Blocks GV AN●●, GV AD●● and GV AM11
(2) Blocks GV3 AU●● and GV3 AS●●

Note: Leave a gap of 9 mm between 2 circuit-breakers: either an empty space or side-mounting add-on contact blocks.
Horizontal mounting is possible up to 40 °C


3

Mounting


Mounting with TeSys contactor LC1 D40A...D65A

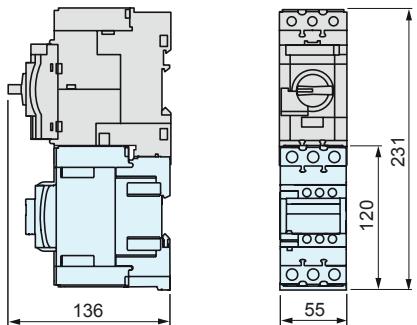


Side by side mounting with TeSys contactor LC1 D40A...D65A (S-shape busbar system GV3 S)

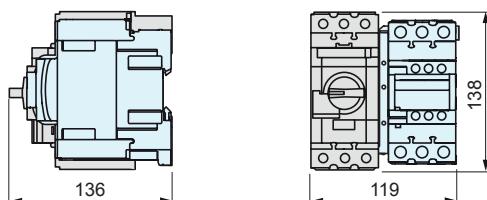


Mounting on rail AM1 DE200 or AM1 ED201



Panel mounting, using M4 screws

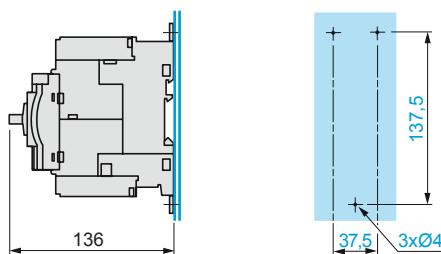


Mounting on pre-slotted plate AM1 PA

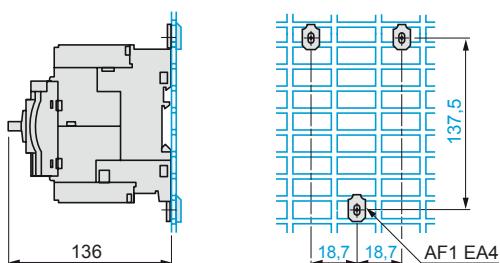


GV3 P (continued)

Busbar systems

Set of busbars GV3 G264



Set of busbars GV3 G364







Note: Leave a space of 9 mm between 2 circuit-breakers: either an empty space or side-mounting add-on contact blocks.
Horizontal mounting is possible up to 40 °C.

Mounting

Mounting of external operator GV3 APN01, GV3 APN02 or GV3 APN04 for motor circuit-breakers GV3 P

3





Door cut-out

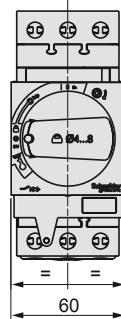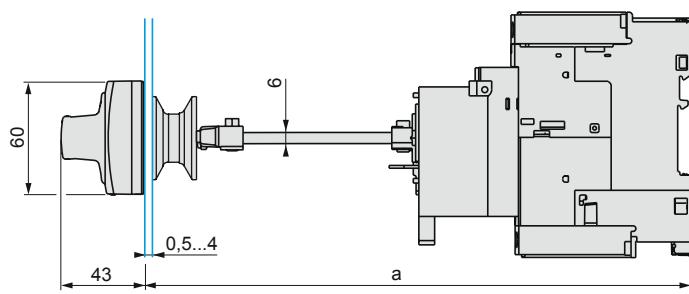

(1) For IP65 only.

Mounting of external operator GV APH03 for motor circuit-breakers GV3 P

Door cut-out

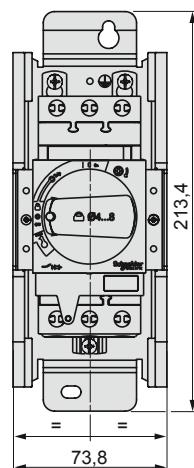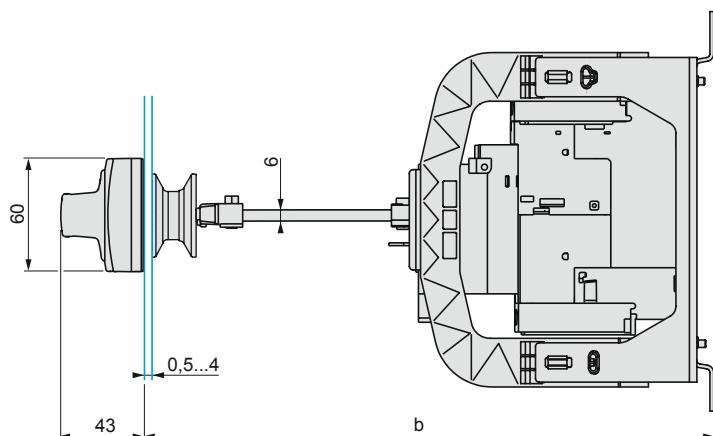


(1) For IP65 only.

	a Mini	a Maxi	b Mini	b Maxi
GV3 APNee	189	300	-	-
GV3 APNee + GV APK12	300	481		
GV3 APNee + GV APH03	-	-	200	300
GV3 APNee + GV APH03 + GV APK12	-	-	300	492

GV3 ME80

Dimensions

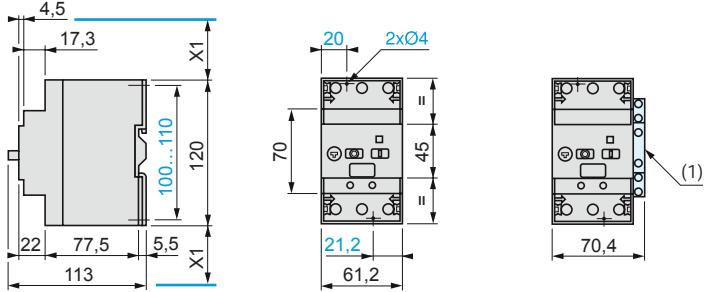

X1 = Electrical clearance (ISC max)
40 mm for $U_e \leq 500$ V, 50 mm for $U_e \leq 690$ V

(1) Blocks GV3 A01...A07.




3

Mounting

Mounting on rail AM1 DE200 or AM1 ED201


Panel mounting, using M4 screws

Mounting on pre-slotted plate AM1 PA

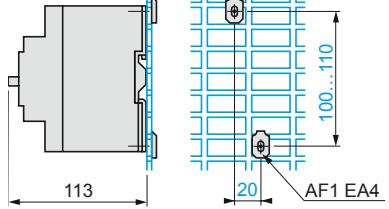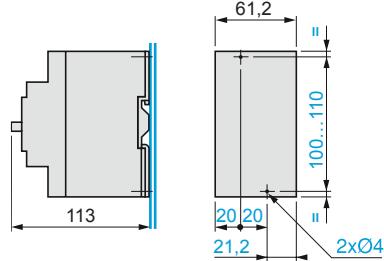


GV7 R

Dimensions

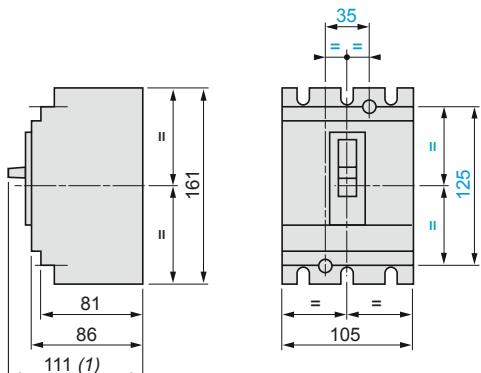

(1) 126 for GV7 R•220.


Motor circuit-breakers with terminal shields or phase barriers
GV7 R + GV7 AC01 or AC04

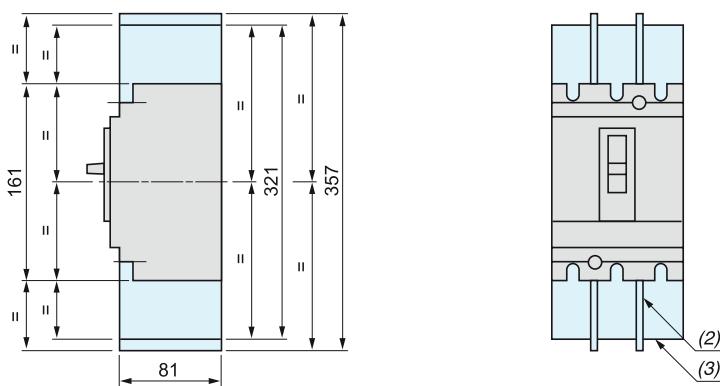

(2) Phase barriers: **GV7 AC04**

(3) Terminal shields: **GV7 AC01**

Combination of GV7 R and TeSys contactor LC1 F with kit GV7 AC0•

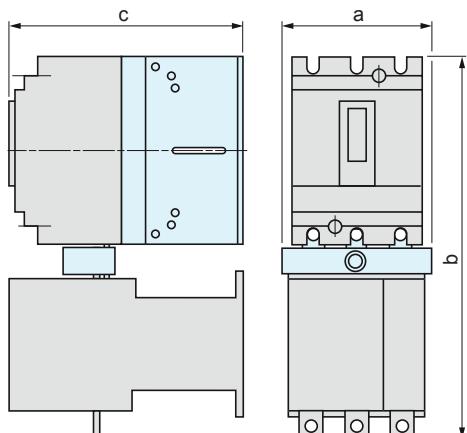

	a	b	c
GV7 R + LC1 F115 or F150 + GV7 AC06	119	334	181
GV7 R + LC1 F185 + GV7 AC06	119	338	188
GV7 R + LC1 F225 + GV7 AC07	131	358	188
GV7 R + LC1 F265 + GV7 AC07	131	364	215


Minimum distance between 2 circuit-breakers
mounted side by side = 0

Minimum electrical clearance


	x1	x2									
Painted or insulated metal plate, insulation or insulated bar	0	30									
Bare metal plate	<table border="1"> <tr> <td>U ≤ 440 V</td> <td>5</td> <td>35</td> </tr> <tr> <td>440 V < U < 600 V</td> <td>10</td> <td>35</td> </tr> <tr> <td>U ≥ 600 V</td> <td>20</td> <td>35</td> </tr> </table>	U ≤ 440 V	5	35	440 V < U < 600 V	10	35	U ≥ 600 V	20	35	
U ≤ 440 V	5	35									
440 V < U < 600 V	10	35									
U ≥ 600 V	20	35									

GV7 R

Panel mounting

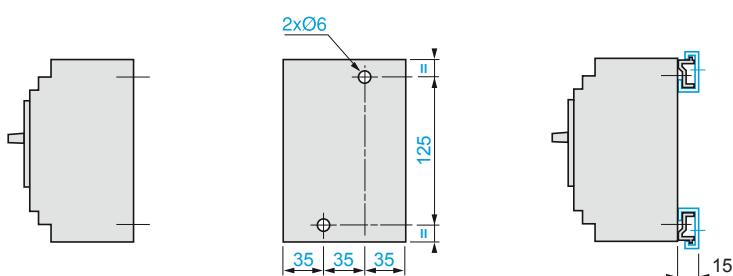


Mounting on 2 mounting rails DZ5 MB201




3

Flush-mounting

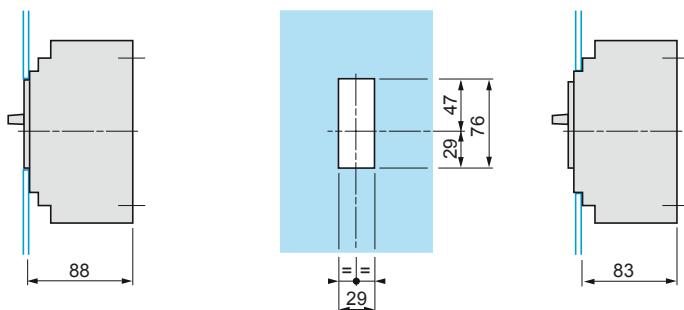


1 circuit-breaker GV7 R

n circuit-breakers GV7 R
side by side

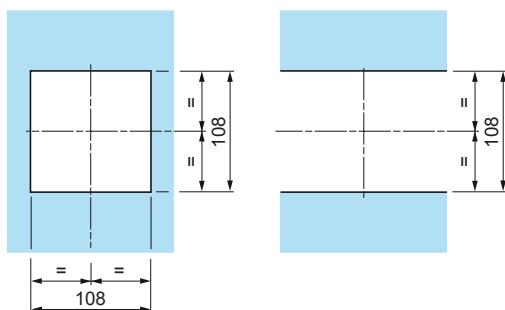


Combination of GV7 R and TeSys contactor LC1 F with kit GV7 AC0•

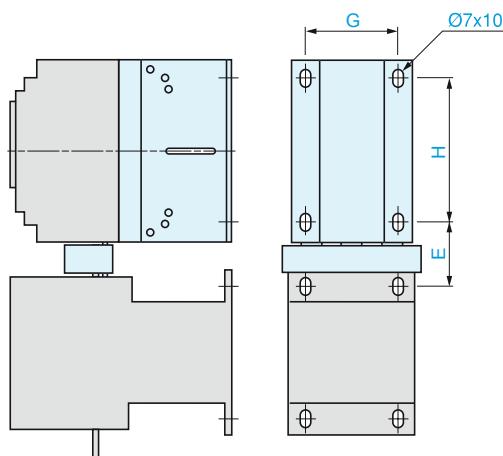


	E	G	H
GV7 R + LC1 F115 + GV7 AC06	44	85	120
GV7 R + LC1 F150 + GV7 AC06	46	85	120
GV7 R + LC1 F185 + GV7 AC06	48	85	120
GV7 R + LC1 F225 + GV7 AC07	57	85	120
GV7 R + LC1 F265 + GV7 AC07	60	85	120

GV7 R


Spreaders GV7 AC03

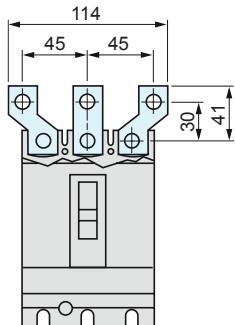


Connection



Smooth terminals



Connectors







a
GV7 R•40...R•150
GV7 R•220

19.5
21.5




Direct rotary handle GV7 AP03, GV7 AP04

Flush-mounting



Direct rotary handle GV7 AP03 or GV7 AP04 with conversion accessory GV7 AP05

Front face cut-out

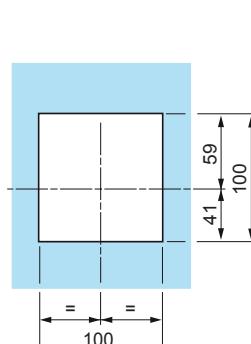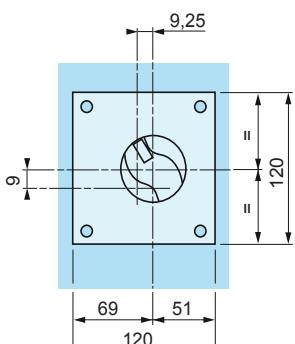
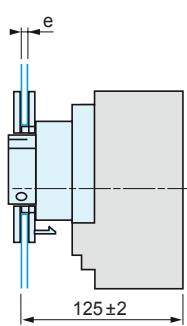


Enclosure viewed from top

Door cut-outs require a minimum distance between the centre of the circuit-breaker and the door hinge point $\Delta \geq 100 + (h \times 5)$

e = 1 to 3 max

Extended rotary handle GV7 AP01, GV7 AP02

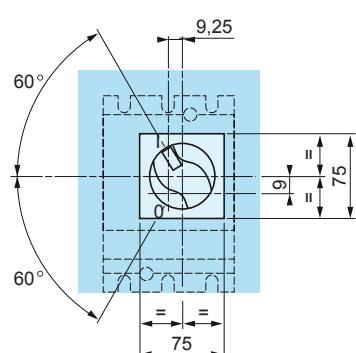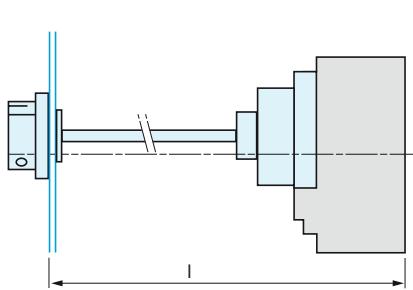


I : 185 min, 600 max

The shaft of the extended rotary handle GV7 AP01 or GV7 AP02 must be cut to length: I – 126 mm.

Schemes

GV2 ME●● and GV2 RT




Front mounting add-on contact blocks
Instantaneous auxiliary contacts

GV AE1


GV AE11

GV AE20



GV2 P●●

GV3 P●●



Front mounting add-on contact blocks
Instantaneous auxiliary contacts and fault signalling contacts

GV AED101

GV AED011



Side mounting add-on contact blocks





Instantaneous auxiliary contacts and fault signalling contacts

GV AD0110

GV AD0101

GV AD1010



GV AD1001



Instantaneous auxiliary contacts


GV AN11

GV AN20



Short-circuit signalling contacts

GV AM11






Voltage trips

GV AU●●●


GV AS●●●

GV AX●●●




Current limiter


GV1 L3



Use of fault signalling contact and short-circuit signalling contact

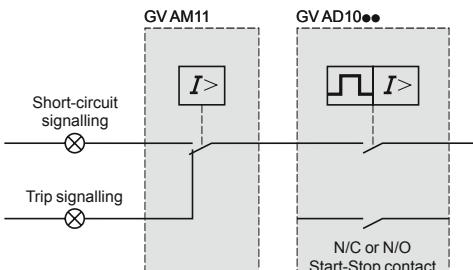


Connection of undervoltage trip for dangerous machines (conforming to INRS) on GV2 ME only

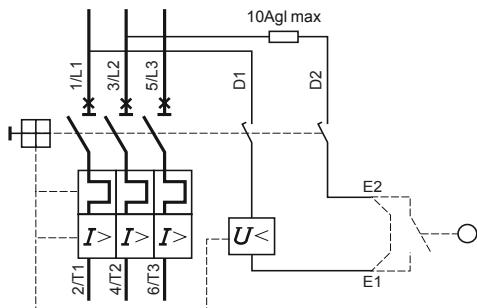

Schemes


Motor circuit-breakers

GV3 ME80



Fault signalling contacts

GV3 A08




GV3 A09




Motor circuit-breakers

GV7 R






Electric trips

GV7 AU***



Add-on auxiliary contacts according to their location (1)

GV7 AE11, GV7 AB11


Location 1
C/O contactLocation 2
Trip indicationLocation 3
Electrical fault
indicationLocation 4
C/O contact

A self-adhesive label, supplied with the contact, can be affixed to the front face of the circuit-breaker to allow personalised marking according to the function of the contact or contacts.


(1) See pages 3/20 and 3/61.

Recommended application schemes GV7 AD111, AD112

Fault indication

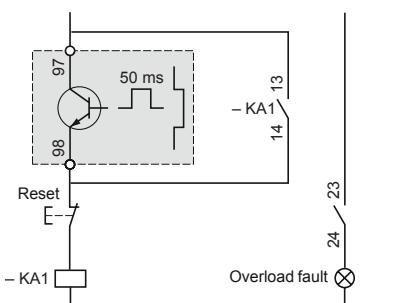

Contactor opening on overload

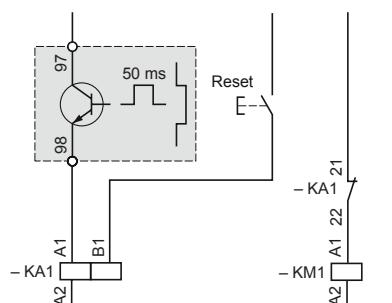

Associated components


KA1: CA2 KN or CAD N

Associated components

KA1: CAD + LAD 6K10 or RHK
KM1: LC1 D or LC1 F

GV2 L


Dimensions

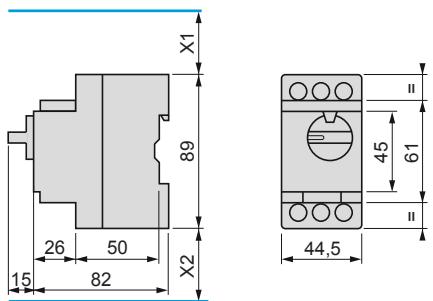

X1 Electrical clearance = 40 mm for $U_e \leq 415$ V, or 80 mm for $U_e = 440$ V, or 120 mm for $U_e = 500$ and 690 V.
 $X_2 = 40$ mm.


3

GV AD, AM, AN, AU, AS



(1) Maximum

GV2 AK00




Mounting

On rail AM1 DE200,
AM1 ED200 (35 x 15)

Panel mounted

On pre-slotted mounting
plate AM1 PA

Adapter plate GK2 AF01




7.5 mm height compensation plate GV1 F03




GV2 LE

Dimensions

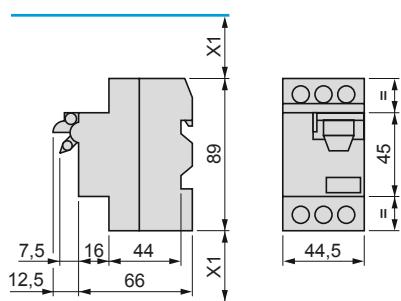


X1 Electrical clearance = 40 mm for $U_e \leq 690$ V.

GV AD, AM, AN, AU, AS



GV AE




Mounting

On 35 mm → rail




On panel with adapter plate GV2 AF02

On pre-slotted plate AM1 PA

On rails DZ5 MB201






c = 80 on AM1 DP200
(35 x 7.5) and 88 on
AM1 DE200, ED200 (35 x 15)



Mounting

Mounting of external operator GV2 APN01, GV2 APN02 or GV2 APN04 for motor circuit-breakers GV2 L




Door cut-out

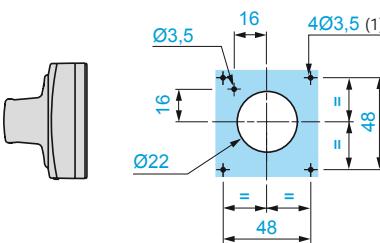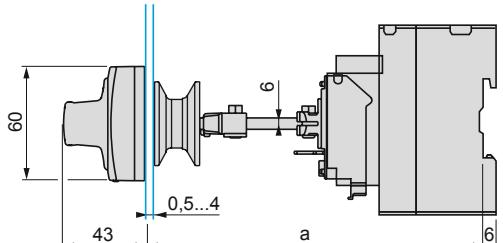

(1) For IP65 only.

Mounting of external operator GV APH02 for motor circuit-breakers GV2 L

Door cut-out

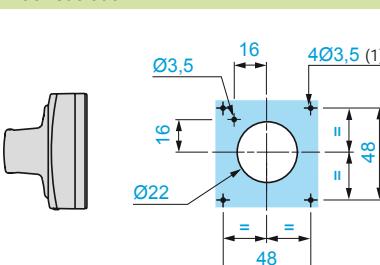
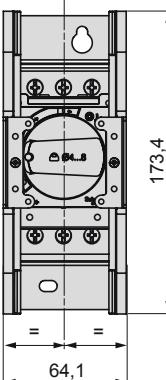
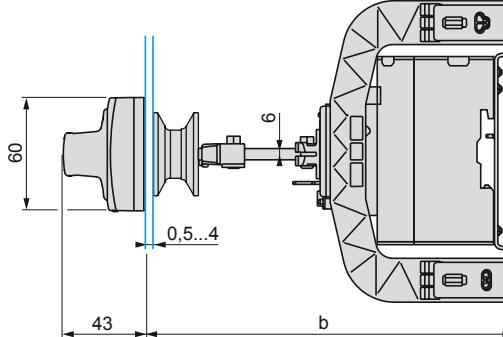


(1) For IP65 only.

	a Mini	a Maxi	b Mini	b Maxi
GV2 APNee	140	250		
GV2 APNee + GV APH02			151	250
GV2 APNee + GV APK11	250	434	-	-
GV2 APNee + GV APH02 + GV APK11	-	-	250	445


Mounting of external operator GV2 AP03 for GV2 LE

Door cut-out

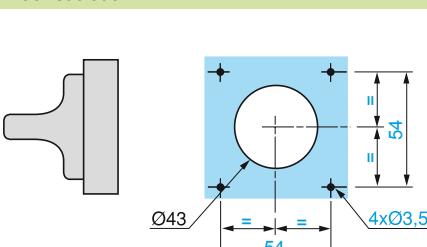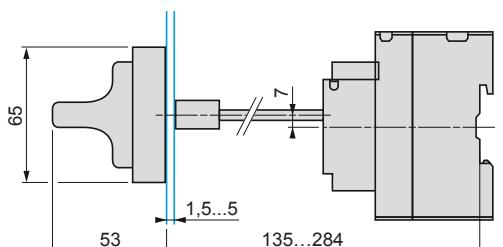

GV2 L and GV2 LE

Sets of busbars GV2 G445, GV2 G454, GV2 G472, with terminal block GV1 G09

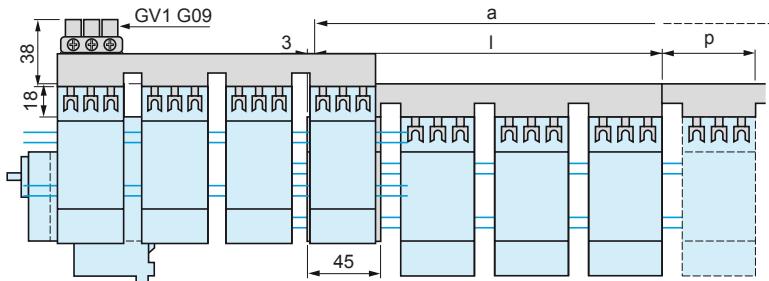

3


	l	p
GV2 G445 (4 x 45 mm)	179	45
GV2 G454 (4 x 54 mm)	206	54
GV2 G472 (4 x 72 mm)	260	72

Number of tap-offs	a	5	6	7	8
GV2 G445	224	269	314	359	
GV2 G454	260	314	368	422	
GV2 G472	332	404	476	548	

Sets of busbars for GV2 L and GV2 LE


Sets of busbars GV2 G●● with term. block GV1 G09

Sets of busbars GV2 G245, GV2 G254, GV2 GR272

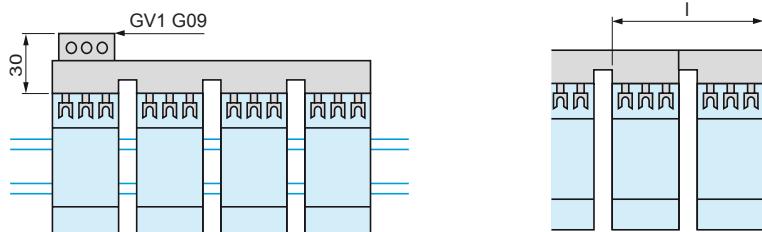


	l
GV2 G245 (2 x 45 mm)	89
GV2 G254 (2 x 54 mm)	98
GV2 G272 (2 x 72 mm)	116

Set of busbars GV2 G554

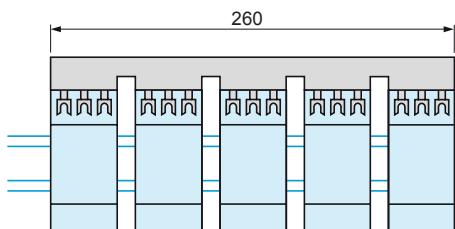


Sets of busbars GV2 G345 and GV2 G354



	l
GV2 G345 (3 x 45 mm)	134
GV2 G354 (3 x 54 mm)	152

GV3 L

Dimensions

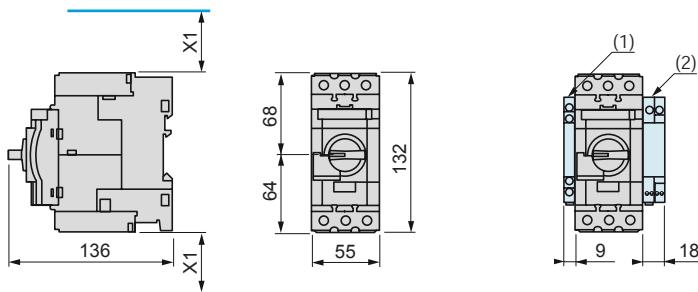

X1 = Electrical clearance (ISC max)

40 mm for Ue ≤ 500 V, 50 mm for Ue ≤ 690 V


(1) Blocks GV AN●●, GV AD●● and GV AM11

(2) Blocks GV3 AU●● and GV3 AS●●


Note: Leave a space of 9 mm between 2 circuit-breakers: either an empty space or side-mounting add-on contact blocks.
Side by side mounting is possible up to 40 °C.

Mounting


Mounting with Tesys contactor LC1 D40A...D65A and relay LR3 D313...365

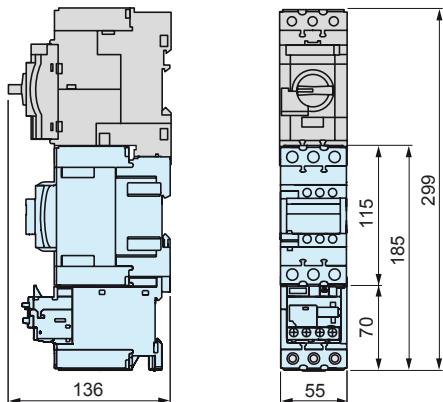


Side by side mounting with Tesys contactor LC1 D40A...D65A (S-shape busbar system GV3 S)

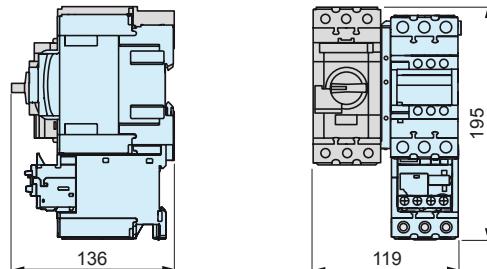


Mounting on rail AM1 DE200 or AM1 ED201




Panel mounting, using M4 screws

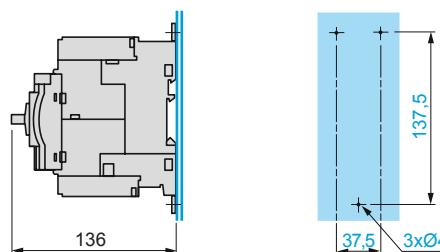


Mounting on pre-slotted plate AM1 PA

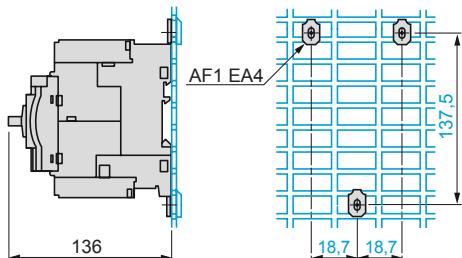

Set of busbars GV3 G264




Set of busbars GV3 G364



Mounting


Mounting of external operator GV3 APN01, GV3 APN02 or GV3 APN04 for motor circuit-breakers GV3 L

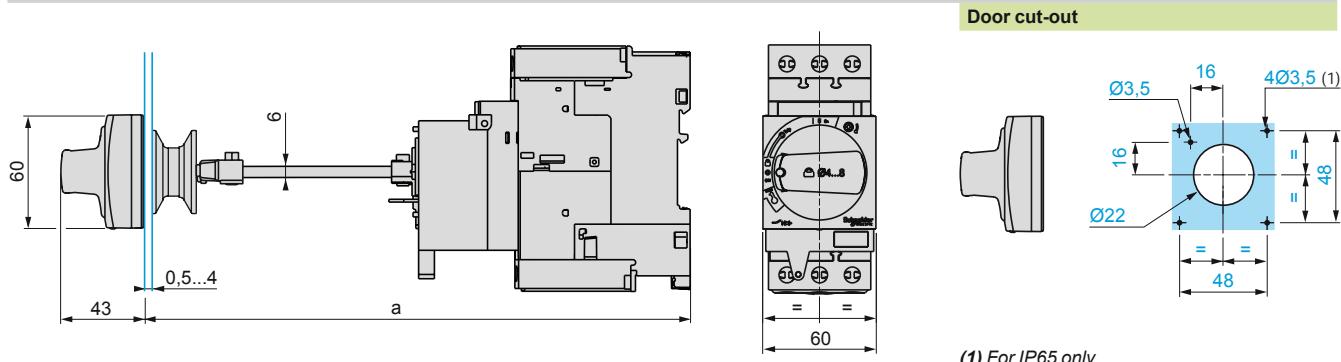

Door cut-out

(1) For IP65 only.

Mounting of external operator GV APH03 for motor circuit-breakers GV3 L

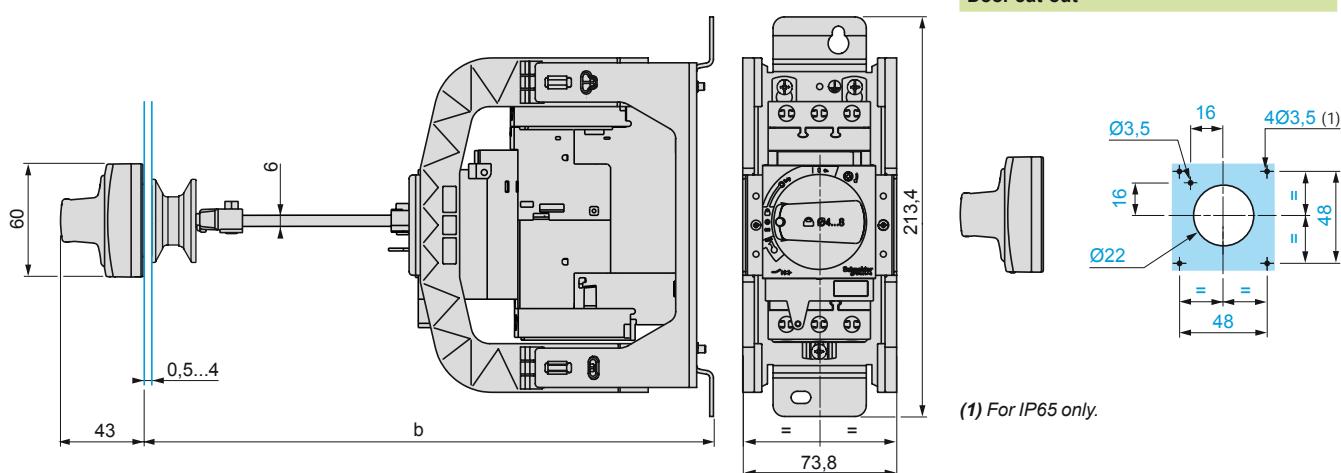


Door cut-out

(1) For IP65 only.

	a Mini	a Maxi	b Mini	b Maxi
GV3 APN••	189	300	-	-
GV3 APN•• + GV APK12	300	481	-	-
GV3 APN•• + GV APH03	-	-	200	300
GV3 APN•• + GV APH03 + GV APK12	-	-	300	492

GK3 EF80


GK3 EF80 + 4 GK2 AX

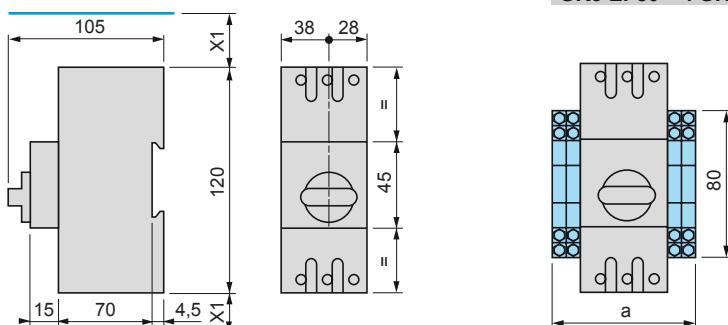


Number of GK2 AX	0	1	2	3	4
a	66	74.8	83.5	92.5	101

Magnetic motor circuit-breakers


GV2 L••




GV2 LE••



GV3 L••



GK3 EF80




Accessories


Front mounting add-on contact blocks

Instantaneous auxiliary contacts


GV AE1




GV AE11



GV AE20




GV AED101 and GV AED011




Side mounting add-on contact blocks

Instantaneous auxiliary contacts and fault signalling contacts


GV AD0110




GV AD0101



GV AD1010




GV AD1001




Instantaneous auxiliary contacts

GV AN11




GV AN20




Short-circuit signalling contacts

GV AM11




Voltage trips

GV AU•••



GV AS•••




Start-Stop signalling contact blocks


GK2 AX10



GK2 AX20



GK2 AX50




Fault signalling contact blocks

GK2 AX12



GK2 AX22



GK2 AX52

